

ARCHITECTURAL DRAWINGS

ISSUE : 24/02/2025 | VERSION : 2.5

GENERAL NOTES

OVERVIEW :

- JSC RustiClad is a cavity based external wall cladding system comprising of:
- Timber weatherboards finished with high quality exterior grade coatings
 - H3.2 treated timber castellated cavity battens
 - fascia boards and moulding profiles

This documentation covers the fixing instructions for the installation of JSC rusticated weatherboards over JSC-U 20mm thick castellated cavity battens.

The information in this document has been specifically grouped in 2 different layouts to help Architects, Designers & Builders on site.

- A3/A1 ARCHITECTURAL DRAWINGS:**
Similar details are grouped in A1/A3 format that make it easier to import into the project plan.
- A4 SITE DRAWINGS**
Same information is made available on a A4 page at a larger scale for builders making it easier to read and distribute the drawings on site.

SCOPE OF USE

- This document is for use exclusively within the scope of JSC RustiClad Rusticated Weatherboard Cladding System technical documentation and Code Compliance CodeMark certificate CMNZ30081.
- Details are subject to change without notification and only the current version is compliant.
- Refer to www.jsctimber.co.nz at the time of use for the current documentation.
- The designer/specifier must be satisfied that these details are applicable for their intended use.

FIXING SPECIFICATION

SPECIES	FIXINGS MATERIAL
Western Red Cedar	316 Stainless Steel or Silicon Bronze annular grooved nails
Alaskan Yellow Cedar	316 Stainless Steel or Silicon Bronze annular grooved nails
Radiata Pine / Nordic Pine	316 Stainless Steel or Silicon Bronze annular grooved nails
JSC-TMT® Thermally Modified Timber	
TMT TAIGA (RW/WW)	316 Stainless Steel or Silicon Bronze annular grooved nails
TMT TAXON	316 Stainless Steel or Silicon Bronze annular grooved nails
TMT TUSCAN	316 Stainless Steel or Silicon Bronze annular grooved nails
TMT AMBA	316 Stainless Steel or Silicon Bronze annular grooved nails

A3/A1 ARCHITECTURAL DRAWINGS INDEX	
Sheet Number	Sheet Title
JSC 20CR RC00	COVER SHEET JSC RUSTICATED WB CLADDING
JSC 20CR RC15	WINDOW DETAILS - Aluminium Joinery
	RC10 - Window Head Detail
	RC11 - Window Sill Detail
	RC12 - Window Jamb Detail
	RC13 - Window Flashing Details
JSC 20CR RC25	DOOR DETAILS - Aluminium Joinery
	RC20 - Door Head Detail
	RC21 - Door Sill Detail
	RC22 - Door Jamb Detail
	RC23 - Door Flashing Details
JSC 20CR RC35	METER BOX DETAILS
	RC30 - Meter Box Head Detail
	RC31 - Meter Box Sill Detail
	RC32 - Meter Box Jamb Detail
	RC33 - Meter Box Flashing Details
JSC 20CR RC46	GENERAL DETAILS 01
	RC40 - Weatherboard Fixing Detail
	RC41 - Weatherboard Scarf Joint Detail
	RC42 - Base of Wall, Concrete Detail
	RC43 - Base of Wall, Timber Detail
	RC44 - Pipe Penetration Detail
	RC45 - 3D - Pipe Penetration Detail
JSC 20CR RC56	GENREAL DETAILS - 02
	RC50 - External Corner - Box Detail
	RC51 - 3D - External Corner Box Detail
	RC52 - External Corner - J42 Detail
	RC53 - 3D - External Corner J42 Detail
JSC 20CR RC66	GENERAL DETAILS - 03
	RC60 - Internal Corner - J44 Detail
	RC61 - 3D - Internal Corner J44 Detail
	RC62 - Internal Corner Detail
	RC63 - 3D - Internal Corner Detail
JSC 20CR RC76	GENREAL DETAILS - 04
	RC70 - Base of Wall, Membrane Roof Detail
	RC71 - Parapet Saddle Flashing - STAGE ONE
	RC72 - Parapet Saddle Flashing - STAGE TWO
	RC73 - Parapet Saddle Flashing - STAGE THREE
	RC74 - Typical Parapet - Capping Joint Details
	RC75 - Parapet Section to Membrane Roof Detail
JSC 20CR RC86	GENERAL DETAILS - 05
	RC80 - Drained Inter Storey Joint Detail
	RC81 - Apron Flashing Roof to Wall Junction Detail
	RC82 - Soffit Detail at Wall
	RC83 - Soffit Detail at Fascia
	RC84 - Parapet Detail

JSC RUSTICLAD Rusticated Weatherboards Flexible Wall Underlay 20mm Cavity Fix



TYPE
RUSTICATED WB - 20MM CAVITY FIX FLEXIBLE WALL UNDERLAY

NAME
COVER SHEET JSC RUSTICATED WB CLADDING


• TO BE READ IN CONJUNCTION WITH COMPLETE JSC RUSTICLAD SYSTEM LITERATURE
• DETAILS MAY BE SUBJECT CHANGE WITHOUT NOTICE

DRAWING SCALE NTS	ISSUE DATE 24/02/2025
DRAWING NUMBER JSC 20CF RC00	VERSION 2.5




EMAIL: TECHHELP@JSC.CO.NZ
WEBSITE: WWW.JSC.CO.NZ
Phone: [09 412 2812 \(Technical\)](tel:094122812)




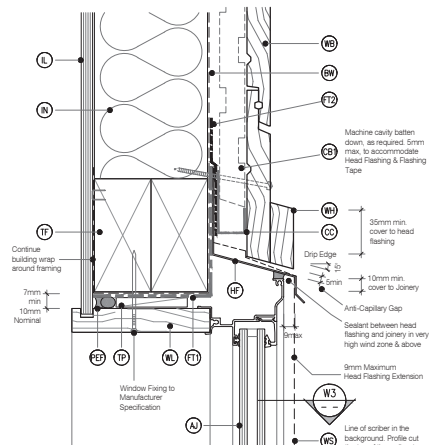

W1 WINDOW HEAD - Rusticated WB
RC10 Cavity Fix - Aluminium Joinery - Double Glazing
SCALE 1:2 @ A1, 1:4 @ A3

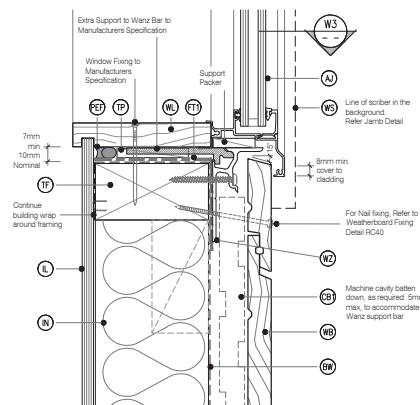

W2 WINDOW SILL - Rusticated WB
RC11 Cavity Fix - Aluminium Joinery - Double Glazing
SCALE 1:2 @ A1, 1:4 @ A3

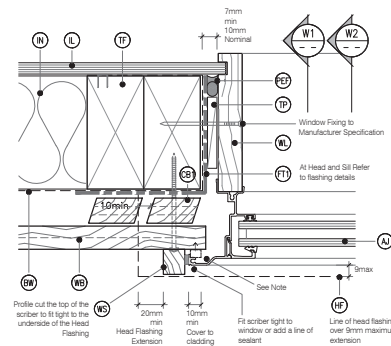

DETAIL NOTES :

1. No Scriber Option : The Aluminium Joinery must sit hard against the back of the joinery flange and the timber weatherboards with a E.P.S. Compressible bond breaker foam seal between


W3 WINDOW JAMB - Rusticated WB
RC12 Cavity Fix - Aluminium Joinery - Double Glazing
SCALE 1:2 • A1, 1:4 • A3

LEGEND:


- | | | | |
|-----------|---|------------|---|
| AJ | ALUMINUM JOINTS: Selected double glazed aluminum joinery. To EN ISO 9110 | F72 | FLEXIBLE FLASHING TAPE: Flexible flashing tape lapped over aluminum head flashing & 2nd layer of Building Wrap, taped joint on top of timber frame |
| BW | BUILDING WRAP: Flexible Wat Underlay, as per NZBC E2/AS1 - Table 23. In extra high wind zones, EN ISO 9110 (EN 917.2 E2/AS1) | HF | HEAD FLASHING: Aluminum head flashing with minimum 15 degree fall, optional hemmed edges as per table E2/AS1 |
| BI | CAVITY BATTERY - NON STRUCTURAL: Vertically installed JSC-41 150mm x 30mm Radius Fire 10.2 treated, both face castellated and 18" beveled edges. Size matched to allow for flashing. | IL | INTERNAL LINING: Selected Internal Lining |
| CC | CAVITY CLOSURE: Cavity closure strip, positioned to give a 15mm min. drip edge to cladding | IN | INSULATION: Selected Insulation |
| CF | FLASHING TAPE: Flashing tape over wrap 70mm (50 min) turn-down required in corners only. Must be 5m, 7.5m or 10m long | PEF | PEF ROD BACKING: Foam backing rod with sealant to cavity in Window perimeter that forms a waterproof air-seal. (Sealant 2:1 Ratio) |
| TF | | TF | TIMBER FRAME: H:1.2m dried timber frame |

GENERAL NOTES:


- | | | | | | |
|----|--|----|---|-----|--|
| 1. | JSC RustClad System must be installed by a suitably qualified and experienced trade person. Where Restricted Building Work (RBW) applied the installer shall be a Licensed Building Practitioner (LBP) or supervised by LBP. | 4. | Any loose or bark encased knots or other timber defects need to be removed. | 7. | Cavity closer/vermin proofing must be installed continuously around the bottom of the cavity. |
| 2. | Weatherboards must be dry and free of any contamination. | 5. | Weatherboards must be coated with exterior grade premium coating on all 4 sides in accordance with coating manufacturer specification. | 8. | Cavity closer/vermin proofing openings must be kept clear and unobstructed to maintain draining and venting of the cavity. |
| 3. | Board lengths must be optimised prior the installation to avoid any unnecessary wastage and joints. | 6. | Where weatherboards have an exposed bottom edge, the back of the boards should be cut with a 15° drip edge and cut end should be coated up to 75-150mm up from the bottom edge. | 9. | For windows and doors, head flashing stop ends must be in place. |
| | | | | 10. | Flashings at corners, doors, windows and wall intersections must be installed to prevent water from entering the cavity. |

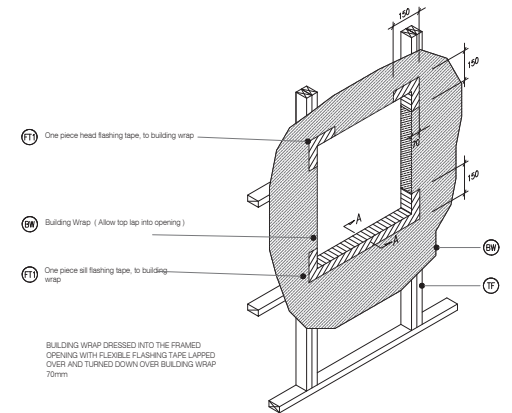

W4 TYPICAL WINDOW OPENING (FLASHING TAPE)
RC13 SCALE : N.T.S

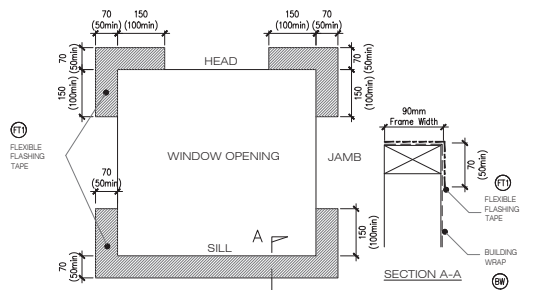

W5 FLEXIBLE BUILDING WRAP AT OPENING
RC13 SCALE : 1 / 5 @ A1, 1 / 10 @ A3

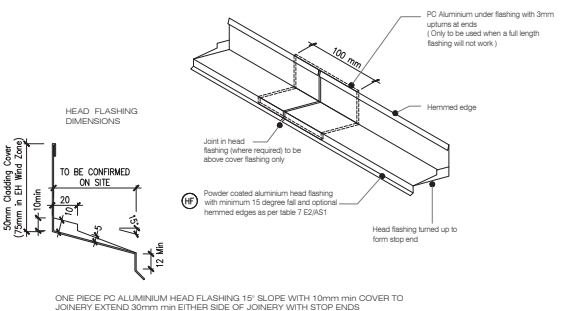

W6 TYPICAL HEAD & FLASHING JOINT
RC13 SCALE : 1 / 2 @ A1, 1 / 4 @ A3







EMAIL: TECHHELP@JSC.CO.NZ
WEBSITE: WWW.JSC.CO.NZ
Phone: 09 412 2812 (Technical)

TYPE
RUSTICATED WB - 20MM CAVITY FIX FLEXIBLE WALL UNDERLAY

NAME
DOOR DETAILS - Aluminium Joinery


- TO BE READ IN CONJUNCTION WITH COMPLETE JSC RUSTICAD SYSTEM LITERATURE
- DETAILS MAY BE SUBJECT CHANGE WITHOUT NOTICE

DRAWING SCALE 1:2 @ A1 1:4 @ A3	ISSUE DATE 24/02/2025
DRAWING NUMBER JSC 20CF RC25	VERSION 2.5

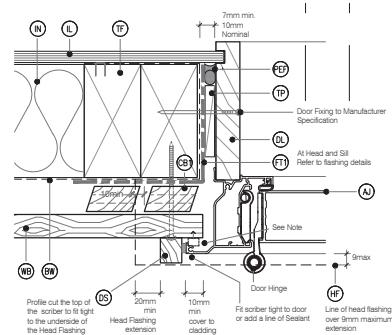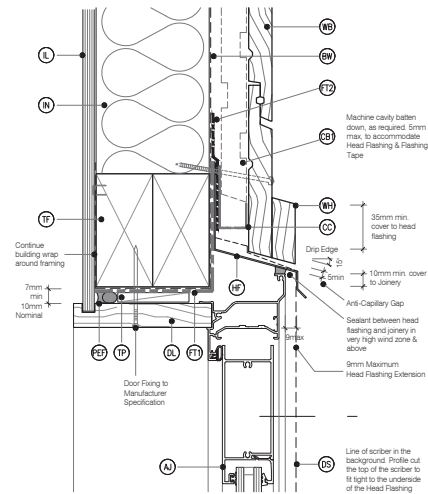

DETAIL NOTES :

1. No Scriber Option : The Aluminium Joinery must sit hard against the back of the joinery flange and the timber weatherboards with a E.P.S Compressible bond breaker foam seal between



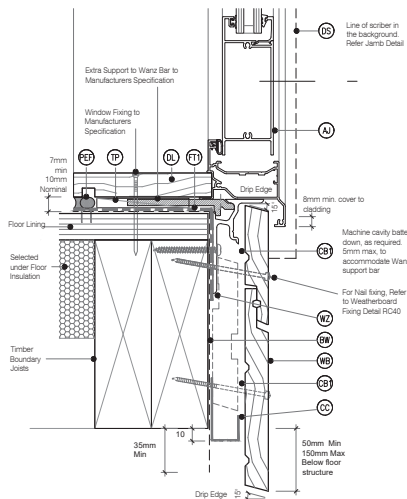


LEGEND:


- | | | | |
|------------|--|------------|---|
| AL | ALUMINIUM JOINERY: Selected double glazed aluminium joinery. To E2/AS1 9:1:10 | FT2 | FLExIBLE FLASHING TApe: Flexible flashing tape applied over aluminium head flashing or 2nd layer of Building Wrap, taped joint to top of timber frame |
| BW | BUILDING WRAP: Flexible Wat Underlay. As per NZBC E2/AS1 - Table 23, in extra high wind zones. Refer to E2/AS1 | HF | HEAD FLASHING: Aluminium head flashing with minimum 15 degree fall, optional hemmed edges as per table E2/AS1 |
| CB | CAVITY BATTEN - NON STRUCTURAL : Vertically installed USC-U 45mm x 200mm Radiata Pine H3.2, with both face caulked and 10° bevelled edges. Site machine to allow for flashing. | IL | INTERNAL LINING: Selected Internal Lining |
| CC | CAVITY CLOSURE: Cavity closure strip, positioned to give a 15mm Min drip edge to cladding | IN | INSULATION: Selected Insulation |
| DS | FLASHING TApe: Flashing tape over wrap 70mm (50 min) turn-down required in corners only. Refer to F2 of NZBC E2/AS1 | PF | PEF ROD BAKING: Foam backing rod with sealant to join in Window perimeter that forms a waterproof air-seal. (Sealant 2:1 Ratio) |
| FT1 | DOOR SCRAPER: Sealant to back of batten and 75 x 3.15mm 316 Stainless Steel nail in 30mm predrilled hole. | TF | TIMBER FRAME: H:12 min treated timber framing |

GENERAL NOTES:


- | | | | | | |
|----|--|----|---|-----|--|
| 1. | JSC RustClad System must be installed by a suitably qualified and experienced trade person. Where Restricted Building Work (RBW) applied the installer shall be a Licensed Building Practitioner (LBP) or supervised by LBP. | 4. | Any loose or bark encased knots or other timber defects need to be removed. | 7. | Cavity closer/vermin proofing must be installed continuously around the bottom of the cavity. |
| 2. | Weatherboards must be dry and free of any contamination. | 5. | Weatherboards must be coated with exterior grade premium coating on all 4 sides in accordance with coating manufacturer specification. | 8. | Cavity closer/vermin proofing openings must be kept clear and unobstructed to maintain draining and venting of the cavity. |
| 3. | Board lengths must be optimised prior the installation to avoid any unnecessary wastage and joints. | 6. | Where weatherboards have an exposed bottom edge, the back of the boards should be cut with a 15° drip edge and cut end should be coated up to 75-150mm up from the bottom edge. | 9. | For windows and doors, head flashing stop ends must be in place. |
| | | | | 10. | Flashings at corners, doors, windows and wall intersections must be installed to prevent water from entering the cavity. |

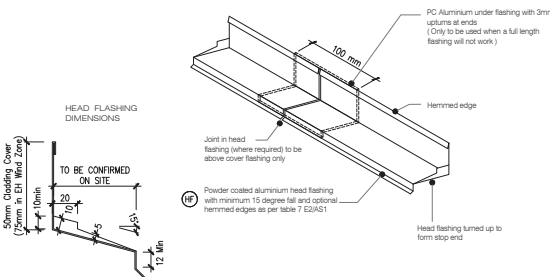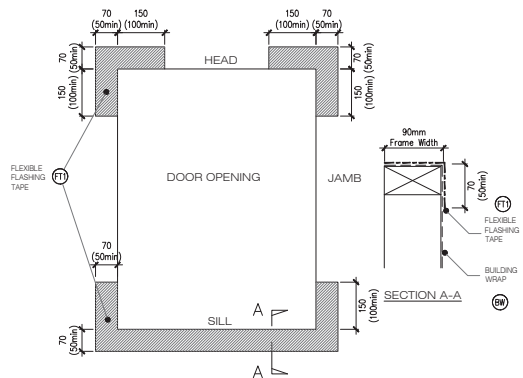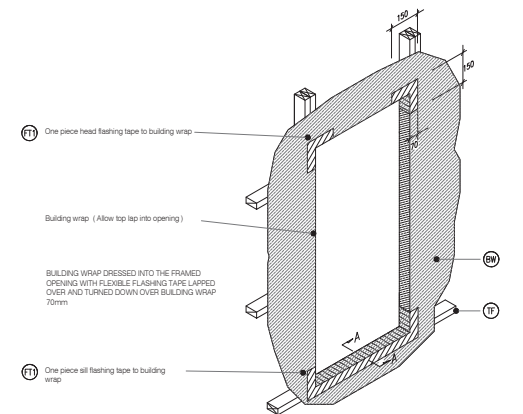


ONE PIECE PC ALUMINIUM HEAD FLASHING 15° SLOPE WITH 10mm minimum COVER TO JOINERY EXTEND 30mm min EITHER SIDE OF JOINERY WITH STOP ENDS

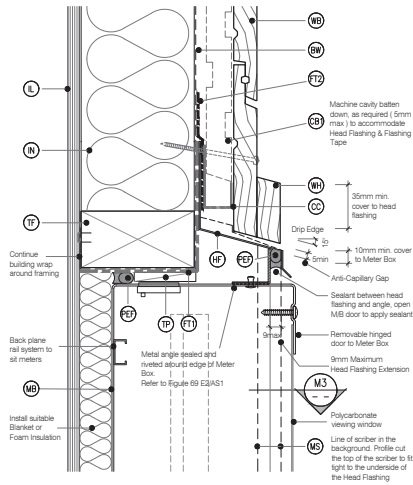

M1 METER BOX HEAD
Cavity Fix - Rusticated WB
SCALE 1:2 @ A1, 1:4 @ A3

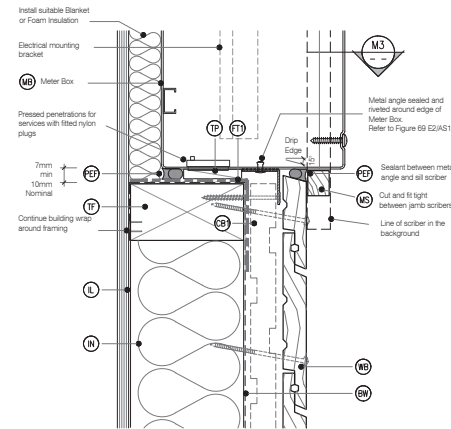

M2 METER BOX SILL
Cavity Fix - Rusticated WB
SCALE 1:2 @ A1, 1:4 @ A3

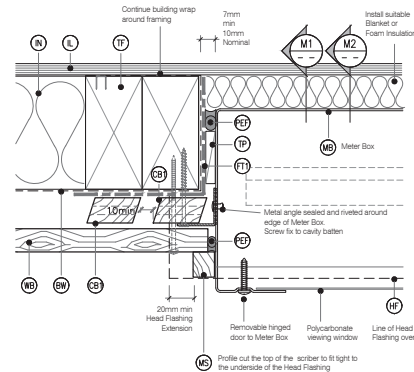


M3 METER BOX JAMB
Cavity Fix - Rusticated WB
SCALE 1:2 @ A1, 1:4 @ A3

LEGEND:


- BW** BUILDING WRAP: Flexible Wall Underlay, As per NZBC E2/AS1 - Table 23, in extra high wind zones, Rigid Underlay required (9.1.7.2 E2/AS1)
- CB** CAVITY BATTEN - NON STRUCTURAL: Horizontally installed JSC-U 45mm x 20mm Radiata Pine H3.2 treated, both face castellated and 18° bevelled edges.
- CC** CAVITY CLOSURE: Cavity closure strip, positioned to give a 15mm minimum drip edge to cladding
- FT1** FLASHING TAPE: Flashing tape over wrap 70mm (50 mm) turn-down required in corners only. Refer to Fig. 72 of NZBC E2/AS1
- FT2** FLEXIBLE FLASHING TAPE: Flexible flashing tape lapped over aluminium head flashing or 2nd layer of Building Wrap, taped joint to top of timber frame
- HF** HEAD FLASHING: Aluminium head flashing with minimum 15 degree fall, optional hemmed edges as per table 7 E2/AS1
- IL** INTERNAL LINING: Selected Internal Lining
- IN** INSULATION: Selected Insulation
- PEF** PEF ROD BACKING: Foam backing rod with sealant to cavity in Window perimeter that forms a waterproof air-seal. (Sealant 2:1 Ratio)
- MB** METER BOX: Electrical meter box, with removable hinged door and polycarbonate viewing window
- MS** METER BOX SCRIBER: Sealant to back of scriber and 75 x 3.15mm 316 Stainless Steel nail in 3mm predrilled hole.
- TF** TIMBER FRAME: H1.2 min treated timber framing
- TP** TIMBER PACKER: Tan H3.2 Treated Packer
- WB** WEATHER BOARD: Selected JSC Rusticated Weatherboard
- WL** WINDOW LINER: As Specified
- WH** WEATHERHEAD (OPTIONAL): Selected JSC Horizontal batten above meter box as necessary to suit profile, shaped to shed water, sealant to back of head scriber

GENERAL NOTES:


- JSC RustiClad System must be installed by a suitably qualified and experienced trade person. Where Restricted Building Work (RBW) applied the installer shall be a Licensed Building Practitioner (LBP) or supervised by LBP.
- Weatherboards must be dry and free of any contamination.
- Board lengths must be optimised prior the installation to avoid any unnecessary wastage and joints.
- Any loose or bark encased knots or other timber defects need to be removed.
- Weatherboards must be coated with exterior grade premium coating on all 4 sides in accordance with coating manufacturer specification.
- Where weatherboards have an exposed bottom edge, the back of the boards should be cut with a 15° drip edge and cut end should be coated up to 75-150mm up from the bottom edge.
- Cavity closer/vermin proofing must be installed continuously around the bottom of the cavity.
- Cavity closer/vermin proofing openings must be kept clear and unobstructed to maintain draining and venting of the cavity.
- For windows and doors, head flashing stop ends must be in place.
- Flashings at corners, doors, windows and wall intersections must be installed to prevent water from entering the cavity.

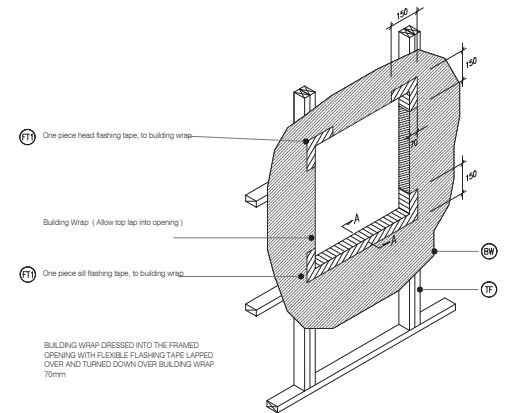

M4 TYPICAL METER BOX OPENING (FLASHING TAPE)
SCALE : N.T.S

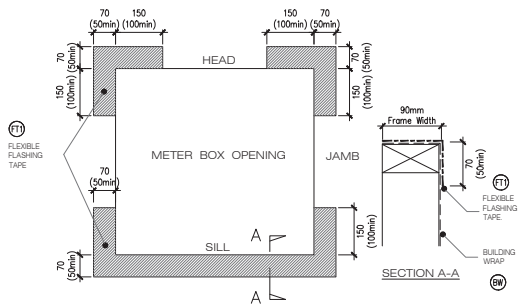

M5 FLEXIBLE BUILDING WRAP AT OPENING
SCALE : 1 / 5 @ A1, 1 / 10 @ A3

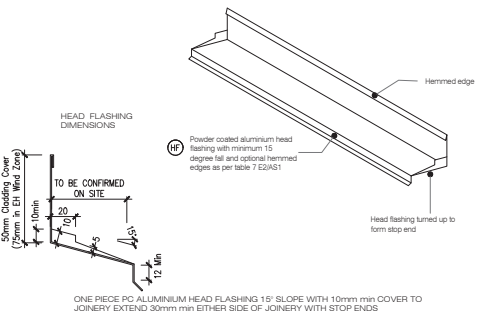

M6 TYPICAL HEAD & FLASHING JOINT
SCALE : 1 / 2 @ A1, 1 / 4 @ A3

C1 WEATHERBOARD FIXING
RC40 Cavity Fix - Rusticated WB
SCALE 1:2 @ A1, 1:4 @ A3

C3 BASE OF WALL, CONCRETE
RC42 Cavity Fix - Rusticated WB
SCALE 1:2 @ A1, 1:4 @ A3

C4 BASE OF WALL, TIMBER
RC43 Cavity Fix - Rusticated WB
SCALE 1:2 @ A1, 1:4 @ A3

C5 PIPE PENETRATION - PLAN VIEW
RC44 Cavity Fix - Rusticated WB
SCALE 1:2 @ A1, 1:4 @ A3

C2 WEATHERBOARD SCARF JOINT
RC41 Cavity Fix - Rusticated WB
SCALE 1:2 @ A1, 1:4 @ A3


LEGEND:

- | | | | | | |
|-----------|--|------------|--|-----------|---|
| BF | BACK FLASHING: Minimum 100mm Polypropylene or PVC rear flashing to provide 50mm cover past the scarf joint on each side | CC | CAVITY CLOSURE: Cavity closure strip, positioned to give a 15mm minimum drip edge to cladding | IN | INSULATION: Selected insulation |
| BW | BUILDING WRAP: Flexible Water Underlay, as per NZBC E2/AS1 - Table 23. In extra high wind zones, Rigid Underlay required (9.1.7.2 E2/AS1) | FT4 | FLEXIBLE FLASHING TAPE: Flexible flashing tape is lapped into corner, Refer NZBC E2/AS1 4.3.1.1 Flashing tape to be applied in accordance to movement that may occur in corners. Not required by E2/AS1 | TF | TIMBER FRAME: H1.2 min treated timber framing |
| | | IL | INTERNAL LINING: Selected internal Lining | WE | WEATHERBOARD: Selected JSC Rusticated Weatherboard |

GENERAL NOTES:

- | | | | | | |
|----|--|----|---|-----|--|
| 1. | JSC RustClad System must be installed by a suitably qualified and experienced trade person. Where Restricted Building Work (RBW) applied the installer shall be a Licensed Building Practitioner (LBP) or supervised by LBP. | 4. | Any loose or bark encased knots or other timber defects need to be removed. | 7. | Cavity closer/vermin proofing must be installed continuously around the bottom of the cavity. |
| 2. | Weatherboards must be dry and free of any contamination. | 5. | Weatherboards must be coated with exterior grade premium coating on all 4 sides in accordance with coating manufacturer specification. | 8. | Cavity closer/vermin proofing openings must be kept clear and unobstructed to maintain draining and venting of the cavity. |
| 3. | Board lengths must be optimised prior the installation to avoid any unnecessary wastage and joints. | 6. | Where weatherboards have an exposed bottom edge, the back of the boards should be cut with a 15° drip edge and cut end should be coated up to 75-150mm up from the bottom edge. | 9. | For windows and doors, head flashing stop ends must be in place. |
| | | | | 10. | Flashings at corners, doors, windows and wall intersections must be installed to prevent water from entering the cavity. |


C6 3D PIPE PENETRATION
RC45 Cavity Fix - Rusticated WB
SCALE : N.T.S

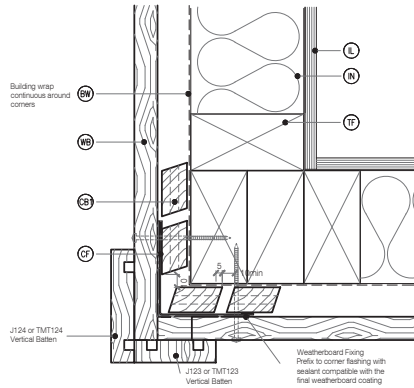

DETAIL NOTES :

1. For VH and GH wind zones a solid batten (non-castellated) is required down one significant side of the external corner to provide pressure isolation between the elevations.


C10 EXTERNAL CORNER - J40
RC50 Cavity Fix - Rusticated WB
SCALE 1:2 @ A1, 1:4 @ A3

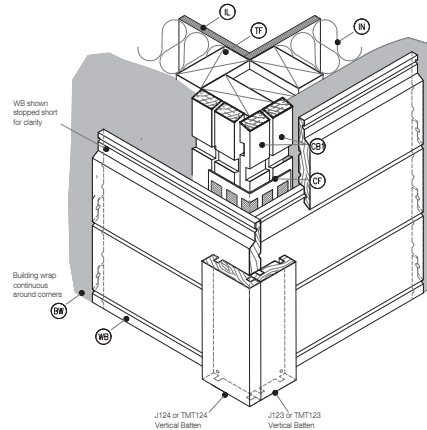

DETAIL NOTES :

1. For VH and GH wind zones a solid batten (non-castellated) is required down one significant side of the external corner to provide pressure isolation between the elevations.


C11 3D EXTERNAL CORNER - J40
RC51 Cavity Fix - Rusticated WB
SCALE : N.T.S

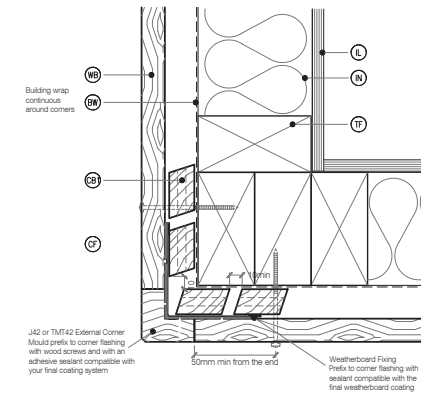

DETAIL NOTES :

1. For VH and GH wind zones a solid batten (non-castellated) is required down one significant side of the external corner to provide pressure isolation between the elevations.

C12 EXTERNAL CORNER J42
RC52 Cavity Fix - Rusticated WB
SCALE 1:2 @ A1, 1:4 @ A3

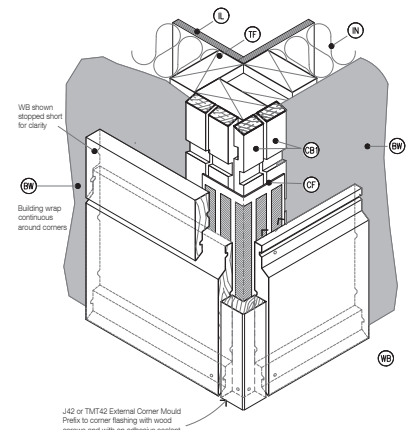

DETAIL NOTES :

1. For VH and GH wind zones a solid batten (non-castellated) is required down one significant side of the external corner to provide pressure isolation between the elevations.


C13 3D EXTERNAL CORNER - J42
RC53 Cavity Fix - Rusticated WB
SCALE : N.T.S

LEGEND :

BW BUILDING WRAP: Flexible Wall Underlay. As per NZBC E2/AS1 - Table 23, In extra high wind zones, Rigid Underlay required (9.1.7.2 E2/AS1)	CF CORNER FLASHING: Aluminium, PVC or Stainless Steel corner flashing. Refer NZBC E2/AS1 Section 4.3 "Acceptable flashing materials" Minimum Flashing Size (mm) as per NZBC E2/AS1 Section 4.5.1.	IL INTERNAL LINING: Selected Internal Lining
CB CAVITY BATTEN - NON STRUCTURAL : Vertically installed JSC-U 45mm x 20mm Radiata Pine H3.2 treated, both face castellated and 18° bevelled edges. Site machined to allow for flashing.	FL FLASHING TYPE L, M, H & VH Wind Zones Hemmed 50x50 75x75 Unhemmed 75x75	IN INSULATION: Selected insulation
FT FLEXIBLE FLASHING TAPE: Flexible flashing tape lapped into corner. Refer NZBC E2/AS1 4.3.11 Flashing tape is recommended due to movement that may occur in corners. Not required by E2/AS1	WB WEATHERBOARD: Selected JSC Rusticated Weatherboard	TF TIMBER FRAME: H1.2 min treated timber framing

GENERAL NOTES :


- JSC RustiClad System must be installed by a suitably qualified and experienced trade person. Where Restricted Building Work (RBW) applied the installer shall be a Licensed Building Practitioner (LBP) or supervised by LBP.
- Weatherboards must be dry and free of any contamination.
- Board lengths must be optimised prior to the installation to avoid any unnecessary wastage and joints.
- Any loose or bark encased knots or other timber defects need to be removed.
- Weatherboards must be coated with exterior grade premium coating on all 4 sides in accordance with coating manufacturer specification.
- Where weatherboards have an exposed bottom edge, the back of the boards should be cut with a 15° drip edge and cut end should be coated up to 75-150mm up from the bottom edge.
- Cavity closer/vermin proofing must be installed continuously around the bottom of the cavity.
- Cavity closer/vermin proofing openings must be kept clear and unobstructed to maintain draining and venting of the cavity.
- For windows and doors, head flashing stop ends must be in place.
- Flashings at corners, doors, windows and wall intersections must be installed to prevent water from entering the cavity.

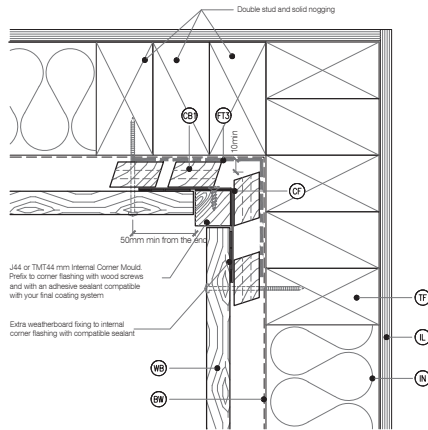


DETAIL NOTES :

1. Flashing tape is recommended due to movement that may occur in corners but it is not required by E2/AS1
2. Aluminium extrusion must not be continuous over solid floor joists.

C16 INTERNAL CORNER - J44
RC60
Cavity Fix - Rusticated WB
SCALE 1:2 @ A1, 1:4 @ A3

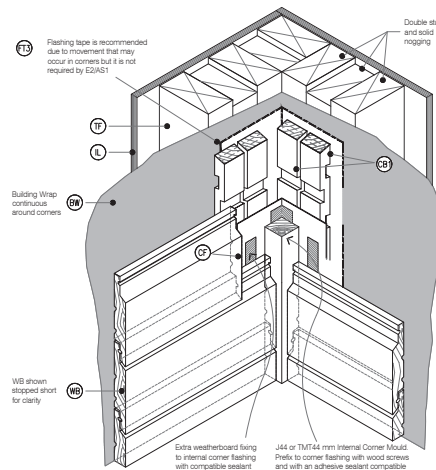


C17 3D INTERNAL CORNER - J44
RC61
Cavity Fix - Rusticated WB
SCALE : N.T.S

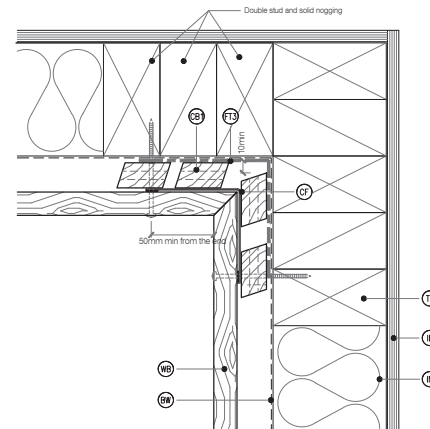

DETAIL NOTES :

1. Flashing tape is recommended due to movement that may occur in corners but it is not required by E2/AS1
2. Aluminium extrusion must not be continuous over solid floor joists.

C18 INTERNAL CORNER
RC62
Cavity Fix - Rusticated WB
SCALE 1:2 @ A1, 1:4 @ A3

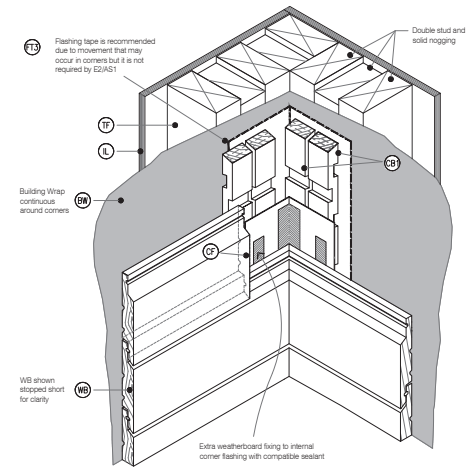

C19 3D INTERNAL CORNER
RC63
Cavity Fix - Rusticated WB
SCALE : N.T.S

LEGEND :

BW BUILDING WRAP: Flexible Wall Underlay, As per NZBC E2/AS1 - Table 23, In extra high wind zones, Rigid Underlay required (9.1.7.2 E2/AS1)	CF CORNER FLASHING: Aluminium, PVC or Stainless Steel corner flashing. Refer NZBC E2/AS1 Section 4.3 'Acceptable flashing materials' Minimum Flashing Size (mm) as per NZBC E2/AS1 Section 4.5.1: FLASHING TYPE L,M,H & VH Wind Zones EH Wind Zones Hemmed 50x50 75x75 Unhemmed 75x75 100x100	IL INTERNAL LINING: Selected Internal Lining
CB CAVITY BATTEN - NON STRUCTURAL: Vertically installed JSC-U 45mm x 20mm Radiata Pine H3.2 treated, both face castellated and 18° bevelled edges. Site machined to allow for flashing.	WB WEATHERBOARD: Selected JSC Rusticated Weatherboard	IN INSULATION: Selected Insulation
FT3 FLEXIBLE FLASHING TAPE: Flexible flashing tape lapped into corner. Refer NZBC E2/AS1 4.3.1.1 Flashing tape is recommended due to movement that may occur in corners. Not required by E2/AS1		TF TIMBER FRAME: H1.2 min treated timber framing

GENERAL NOTES :

1. JSC RustiClad System must be installed by a suitably qualified and experienced trade person. Where Restricted Building Work (RBW) applied the installer shall be a Licensed Building Practitioner (LBP) or supervised by LBP.
2. Weatherboards must be dry and free of any contamination.
3. Board lengths must be optimised prior the installation to avoid any unnecessary wastage and joints.
4. Any loose or bark encased knots or other timber defects need to be removed.
5. Weatherboards must be coated with exterior grade premium coating on all 4 sides in accordance with coating manufacturer specification.
6. Where weatherboards have an exposed bottom edge, the back of the boards should be cut with a 15° drip edge and out end should be coated up to 75-150mm up from the bottom edge.
7. Cavity closer/vermin proofing must be installed continuously around the bottom of the cavity.
8. Cavity closer/vermin proofing openings must be kept clear and unobstructed to maintain draining and venting of the cavity.
9. For windows and doors, head flashing stop ends must be in place.
10. Flashings at corners, doors, windows and wall intersections must be installed to prevent water from entering the cavity.


EMAIL: TECHHELP@JSC.CO.NZ
WEBSITE: WWW.JSC.CO.NZ
Phone: **09 412 2812 (Technical)**

CodeMark
CMNZ30081


TYPE
RUSTICATED WB - 20MM CAVITY FIX FLEXIBLE WALL UNDERLAY
NAME
GENERAL DETAILS 03
• TO BE READ IN CONJUNCTION WITH COMPLETE JSC RUSTICLAD SYSTEM LITERATURE
• DETAILS MAY BE SUBJECT CHANGE WITHOUT NOTICE

DRAWING SCALE 1:2 @ A1 1:4 @ A3	ISSUE DATE 24/02/2025
DRAWING NUMBER JSC 20CF RC66	VERSION 2.5




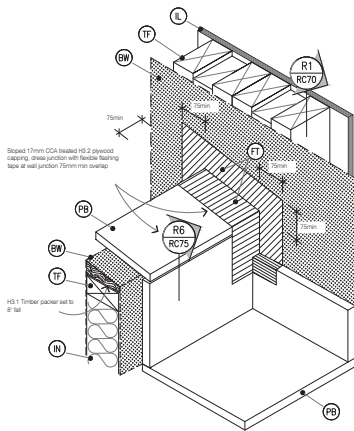


STAGE ONE

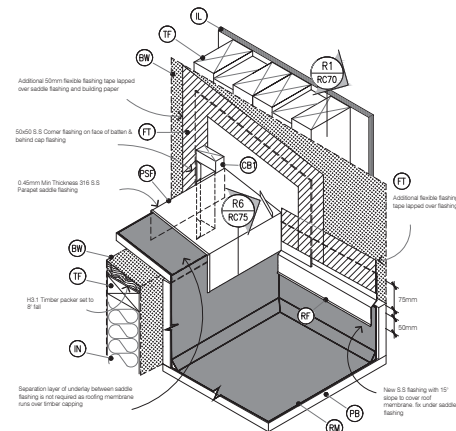

STAGE TWO

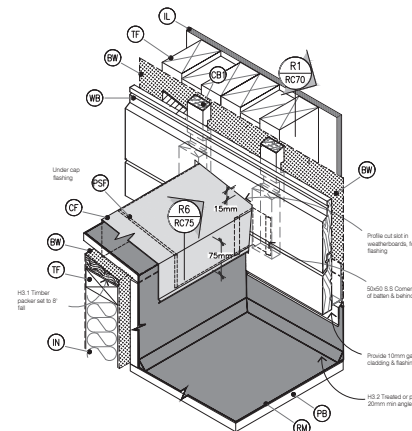

STAGE THREE

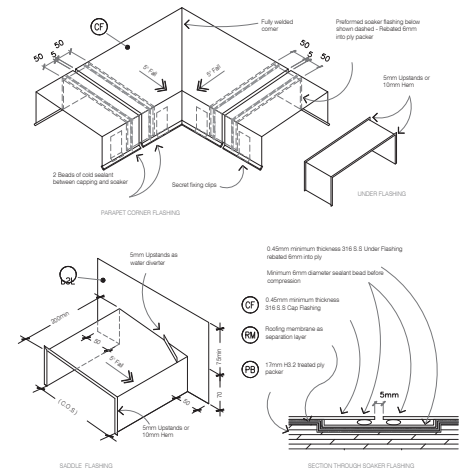

5
4


TYPICAL PARAPET
CAPPING JOINT DETAILS

Cavity Fix - Rusticated WB

SCALE 1:5 @ A1, 1:10 @ A3

DECK OR ROOF MEMBRANE PARAPET SADDLE FLASHING

Cavity Fix - Rusticated WB
SCALE 1:5 @ A1, 1:10 @ A3

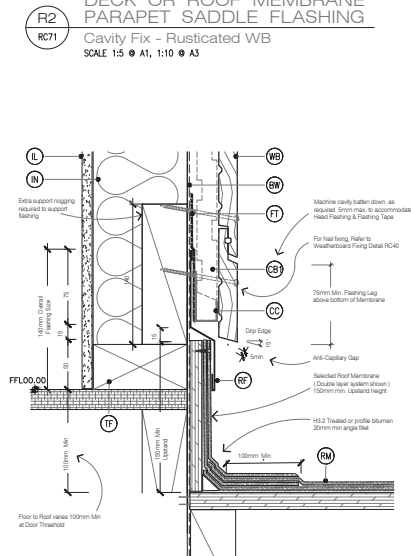


LEGEND:

- | | | | |
|----|---|----|--|
| EW | BUILDING WRAP: Flexible Wind Underlayment, as per NZBC EAS/AS1 - Table 29, in estra high wind zones. Rigid Underlayment required (9.17.2 EAS/1) | FT | FLASHING TAPE: as per E2/AS1 A3.4.11 |
| CB | CAVITY BATTEN - NON STRUCTURAL:
Horizontally installed JSC-U 45mm x 20mm
Rusticla Fire H3.2 treated, both faces castelated and 16° bevelled edges | IL | INTERNAL LINING: Selected Internal Lining |
| CB | CAVITY CLOSURE: Cavity closure strip, positioned over the 15mm gap between battens to clad. | IN | INSULATION: Selected Insulation |
| CB | CAP FLASHING: Continuous parpet flashing. Materials as per E2/AS1 A3.3 - Figure 9.8, Table 7 | | PARAPET SADDLE FLASHING: Materials as per E2/AS1 A4.0, refer E2/AS1 Figure 11.8.12. Typically 150mm min. Sills 315. Refer Table 21 for Comparability of Materials in Context |

GENERAL NOTES:

- | | | | | | |
|----|--|----|---|-----|--|
| 1. | JSC RustClad System must be installed by a suitably qualified and experienced trade person. Where Restricted Building Work (RBW) applied the installer shall be a Licensed Building Practitioner (LBP) or supervised by LBP. | 4. | Any loose or bark encased knots or other timber defects need to be removed. | 7. | Cavity closer/vermin proofing must be installed continuously around the bottom of the cavity. |
| 2. | Weatherboards must be dry and free of any contamination. | 5. | Weatherboards must be coated with exterior grade premium coating on all 4 sides in accordance with coating manufacturer specification. | 8. | Cavity closer/vermin proofing openings must be kept clear and unobstructed to maintain draining and venting of the cavity. |
| 3. | Board lengths must be optimised prior the installation to avoid any unnecessary wastage and joints. | 6. | Where weatherboards have an exposed bottom edge, the back of the boards should be cut with a 15° drip edge and cut end should be coated up to 75-150mm up from the bottom edge. | 9. | For windows and doors, head flashing stop ends must be in place. |
| | | | | 10. | Flashings at corners, doors, windows and wall intersections must be installed to prevent water from entering the cavity. |

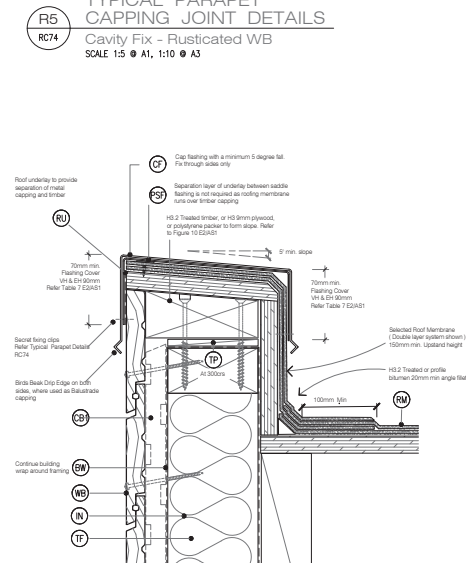

PARAPET SECTION
TO MEMBRANE ROOF

Cavity Fix - Rusticated WB

SCALE 1:2.5 @ A1, 1:5 @ A3

BASE OF WALL, MEMBRANE ROOF

Cavity Fix - Rusticated WB
SCALE 1:2.5 @ A1, 1:5 @ A3

TYPE
RUSTICATED WB - 20MM CAVITY FIX FLEXIBLE WALL UNDERLAY


NAME
GENERAL DETAILS 04

- TO BE READ IN CONJUNCTION WITH COMPLETE JSC RUSTICLAD SYSTEM LITERATURE
- DETAILS MAY BE SUBJECT CHANGE WITHOUT NOTICE


DRAWING SCALE	ISSUE DATE
1:2.5 @ A1	24/02/2025
1:5 @ A3	

JSC 20CF RC76


2.5

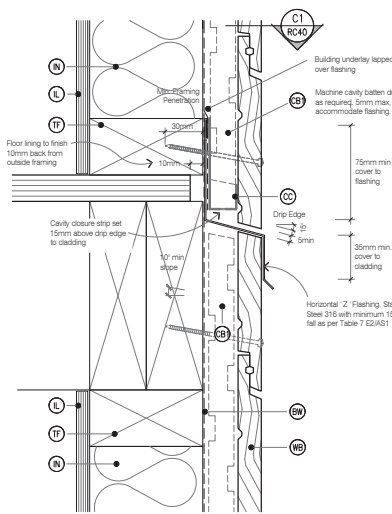


C17 DRAINED INTER-STOREY JOINT
Cavity Fix - Rusticated WB
SCALE 1:2 @ A1, 1:4 @ A3

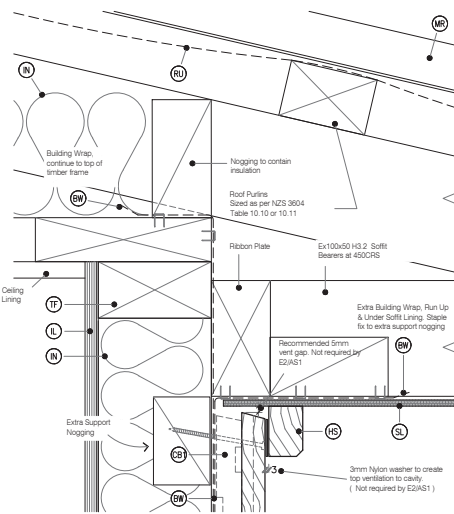


C18 SOFFIT DETAIL AT WALL
Cavity Fix - Rusticated WB
SCALE 1:2 @ A1, 1:4 @ A3

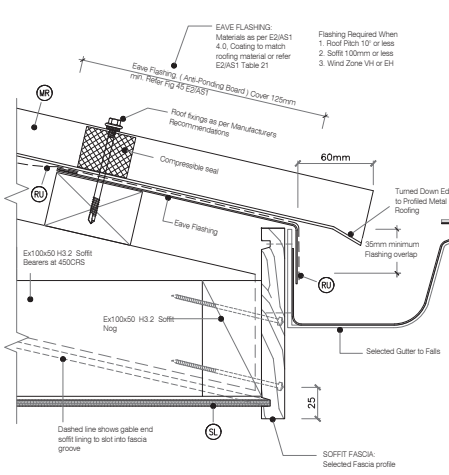

C19 SOFFIT DETAIL AT FASCIA
Cavity Fix - Rusticated WB
SCALE 1:2 @ A1, 1:4 @ A3

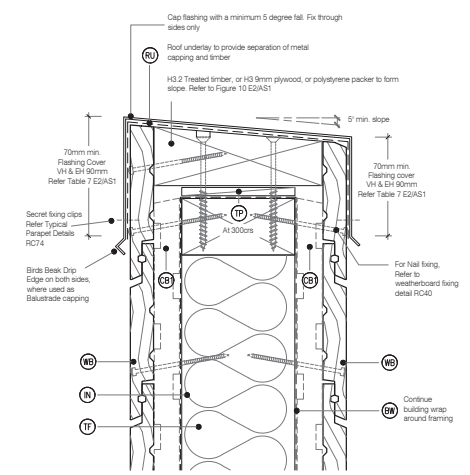

C21 BALUSTARDE CAPPING OR PARAPET DETAIL
Cavity Fix - Rusticated WB
SCALE 1:2 @ A1, 1:4 @ A3

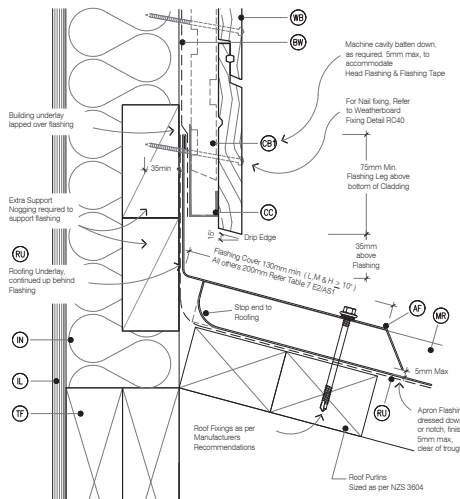

C18 APRON FLASHING ROOF TO WALL JUNCTION
Cavity Fix - Rusticated WB
SCALE 1:2 @ A1, 1:4 @ A3

LEGEND:

- | | | |
|--|---|---|
| (AF) APRON FLASHING: Materials as per E2/AS1 4.0, Coating to match roofing material or refer E2/AS1 Table 21. Flashing Cover 130mm min. (L & H ≥ 10°) All others 200mm Refer Table 7 E2/AS1 | (CC) CAVITY CLOSURE: Cavity closure strip, positioned to give a 15mm Min drip edge to cladding | (SL) SOFFIT LINING: JSC Soffit Lining |
| (BW) BUILDING WRAP: Flexible Wall Underlay, As per NZBC E2/AS1 - Table 23, In extra high wind zones, Rigid Underlay required (9.1.7.2 E2/AS1) | (IL) INTERNAL LINING: Selected Internal Lining | (TF) TIMBER FRAME: H1.2 min treated timber framing |
| (CB) CAVITY BATTEN - NON STRUCTURAL: Vertically installed JSC-U 45mm x 20mm Radiata Pine H3.2 treated, both face castellated and 18° bevelled edges. | (IN) INSULATION: Selected Insulation | (TP) TIMBER PACKER: H3.2 Treated at 300c to allow ventilation over the top of the wall. |
| | (HS) HEAD SOFFIT SCRIBER: JSC 27 mm x 40 mm Fix with 75 x 3.15mm 316 S.S nail in 2.5mm predrilled hole | (RU) ROOFING UNDERLAY: Selected Roofing Underlay As Per AS/AZS4200 with Mesh or Self Supported |
| | (MR) METAL ROOFING: Selected Metal Roofing | (WB) WEATHERBOARD: Selected JSC Rusticated Weatherboard |

GENERAL NOTES:

- JSC RustiClad System must be installed by a suitably qualified and experienced trade person. Where Restricted Building Work (RBW) applied the installer shall be a Licensed Building Practitioner (LBP) or supervised by LBP.
- Weatherboards must be dry and free of any contamination.
- Board lengths must be optimised prior to the installation to avoid any unnecessary wastage and joints.
- Any loose or bark encased knots or other timber defects need to be removed.
- Weatherboards must be coated with exterior grade premium coating on all 4 sides in accordance with coating manufacturer specification.
- Where weatherboards have an exposed bottom edge, the back of the boards should be cut with a 15° drip edge and cut end should be coated up to 75-150mm up from the bottom edge.
- Cavity closer/vermin proofing must be installed continuously around the bottom of the cavity.
- Cavity closer/vermin proofing openings must be kept clear and unobstructed to maintain draining and venting of the cavity.
- For windows and doors, head flashing stop ends must be in place.
- Flashings at corners, doors, windows and wall intersections must be installed to prevent water from entering the cavity.