

SITE DRAWINGS

JSC Rusticated Weatherboard Flexible Wall Underlay 20mm Cavity Fix

ISSUE : 25/08/2023 | VERSION : 2.3

© J SCOTT & COMPANY LIMITED 2022



TYPE
RUSTICATED WB - 20MM CAVITY FIX

NAME
COVER SHEET

- TO BE READ IN CONJUNCTION WITH COMPLETE JSC RUSTICLAD SYSTEM LITERATURE
- DETAILS MAY BE SUBJECT CHANGE WITHOUT NOTICE



DRAWING SCALE
1:2 @ A4

ISSUE DATE
25/08/2023

DRAWING NUMBER
JSC 20CF RC01

VERSION
2.3

INDEX

ISSUE : 25/08/2023 | VERSION : 2.3

© J SCOTT & COMPANY LIMITEID 2022

Sheet Number	Sheet Title
JSC 20CF RC01	COVER SHEET
JSC 20CF RC02	INDEX
JSC 20CF RC03	GENERAL NOTES
WINDOW DETAILS - Aluminium Joinery	
JSC 20CF RC10	Window Head Detail
JSC 20CF RC11	Window Sill Detail
JSC 20CF RC12	Window Jamb Detail
JSC 20CF RC13	Window Flashing Detail
DOOR DETAILS - Aluminium Joinery	
JSC 20CF RC20	Door Head Detail
JSC 20CF RC21	Door Sill Detail
JSC 20CF RC22	Door Jamb Detail
JSC 20CF RC23	Door Flashing Detail
METER BOX DETAILS	
JSC 20CF RC30	Meter Box Head Detail
JSC 20CF RC31	Meter Box Sill Detail
JSC 20CF RC32	Meter Box Jamb Detail
JSC 20CF RC33	Meter Box Flashing Detail
GENERAL DETAILS 01	
JSC 20CF RC40	Weatherboard Fixing Detail
JSC 20CF RC41	Weatherboard Scarf Joint
JSC 20CF RC42	Base of Wall, Concrete
JSC 20CF RC43	Base of Wall, Timber
JSC 20CF RC44	Pipe Penetration
JSC 20CF RC45	3D - Pipe Penetration
GENERAL DETAILS 02	
JSC 20CF RC50	External Corner
JSC 20CF RC51	3D - External Corner
JSC 20CF RC52	External Corner
JSC 20CF RC53	3D - External Corner
GENERAL DETAILS 03	
JSC 20CF RC60	Internal Corner
JSC 20CF RC61	3D - Internal Corner
JSC 20CF RC62	Internal Corner
JSC 20CF RC63	3D - Internal Corner
GENERAL DETAILS 04	
JSC 20CF RC70	Base of Wall, Membrane Roof
JSC 20CF RC71	Parapet Saddle Flashing - Stage ONE
JSC 20CF RC72	Parapet Saddle Flashing - Stage TWO
JSC 20CF RC73	Parapet Saddle Flashing - Stage THREE
JSC 20CF RC74	Typical Parapet - Capping Joint Detail
JSC 20CF RC75	Parapet Section to Membrane Roof
GENERAL DETAILS 05	
JSC 20CF RC80	Drained Inter Storey Joint
JSC 20CF RC81	Apron Flashing Roof to Wall Junction
JSC 20CF RC82	Soffit Detail at Wall
JSC 20CF RC83	Soffit Detail at Fascia
JSC 20CF RC84	Parapet Detail



GENERAL NOTES

ISSUE : 25/08/2023 | VERSION : 2.3

OVERVIEW :

JSC RustiClad is a cavity based external wall cladding system comprising of:

- timber weatherboards finished with high quality exterior grade coatings
- H3.2 treated timber castellated cavity battens
- fascia boards and moulding profiles

This documentation covers the fixing instructions for the installation of JSC rusticated weatherboards over JSC-U 20mm thick castellated cavity battens.

The information in this document has been specifically grouped in 2 different layouts to help Architects, Designers & Builders on site.

1. A3/A1 ARCHITECTURAL DRAWINGS:

Similar details are grouped to make up a completed A1/A3 drawings make it easier to import into the project plan.

2. A4 SITE DRAWINGS

Same information is made available on a A4 page at a larger scale for builders making it easier to read and distribute the drawings on site.

SCOPE OF USE

- This document is for use exclusively within the scope of JSC RustiClad rusticated Weatherboard Cladding System technical documentation and Code Compliance CodeMark certificate CMNZ30081.
- Details are subject to change without notification and only the current version is compliant.
- Refer to www.jsctimber.co.nz at the time of use for the current documentation.
- The designer/specifier must be satisfied that these details are applicable for their intended use.


FIXING SPECIFICATION

SPECIES	FIXINGS MATERIAL
Western Red Cedar	316 Stainless Steel or Silicon Bronze annular grooved nails
Alaskan Yellow Cedar	316 Stainless Steel or Silicon Bronze annular grooved nails
Iroko	316 Stainless Steel or Silicon Bronze annular grooved nails
Radiata Pine	316 Stainless Steel or Silicon Bronze annular grooved nails
JSC-TMT® Thermally Modified Timber	
TMT TAIGA (RW/WW)	316 Stainless Steel annular grooved nails
TMT TAXON	316 Stainless Steel annular grooved nails
TMT TUSCAN	316 Stainless Steel annular grooved nails




LEGEND :

- | | | |
|---|--|--|
| <ul style="list-style-type: none"> (AJ) ALUMINIUM JOINERY: Selected double glazed aluminium joinery. To E2/AS1 9.1.10 (BW) BUILDING WRAP: Flexible Wall Underlay, As per NZBC E2/AS1 - Table 23, In extra high wind zones, Rigid Underlay required (9.1.7.2 E2/AS1) (CB1) CAVITY BATTEN - NON STRUCTURAL : Vertically installed JSC-U 45mm x 20mm Radiata Pine H3.2 treated, both face castellated and 18° bevelled edges. Site machined to allow for flashing. (CC) CAVITY CLOSURE: Cavity closure strip, positioned to give a 15mm min. drip edge to cladding (FT1) FLASHING TAPE: Flashing tape over wrap 70mm (50 min) turn-down required in corners only. Refer to Fig. 72 of NZBC E2/AS1 | <ul style="list-style-type: none"> (FT2) FLEXIBLE FLASHING TAPE: Flexible flashing tape lapped over aluminium head flashing or 2nd layer of Building Wrap, taped joint to top of timber frame (HF) HEAD FLASHING: Aluminium head flashing with minimum 15 degree fall, optional hemmed edges as per table 7 E2/AS1 (IL) INTERNAL LINING: Selected Internal Lining (IN) INSULATION: Selected Insulation (PEF) PEF ROD BACKING: Foam backing rod with sealant to cavity in Window perimeter that forms a waterproof air-seal. (Sealant 2:1 Ratio) (TF) TIMBER FRAME: H1.2 min treated timber framing | <ul style="list-style-type: none"> (TP) TIMBER PACKER: Tan H3.2 Treated Packer (WL) WINDOW LINER: As Specified (WB) WEATHER BOARD: JSC Rusticated Weatherboard (WH) WEATHERHEAD: (OPTIONAL) Selected JSC Horizontal batten above window as necessary to suit profile, shaped to shed water, sealant to back of head scriber (WS) WINDOW SCRIBER: Sealant to back of scriber and 75 x 3.15mm 316 Stainless Steel nail in 3mm predrilled hole. (WZ) WANZ SUPPORT: Provide window support as required by joinery manufacturer |
|---|--|--|

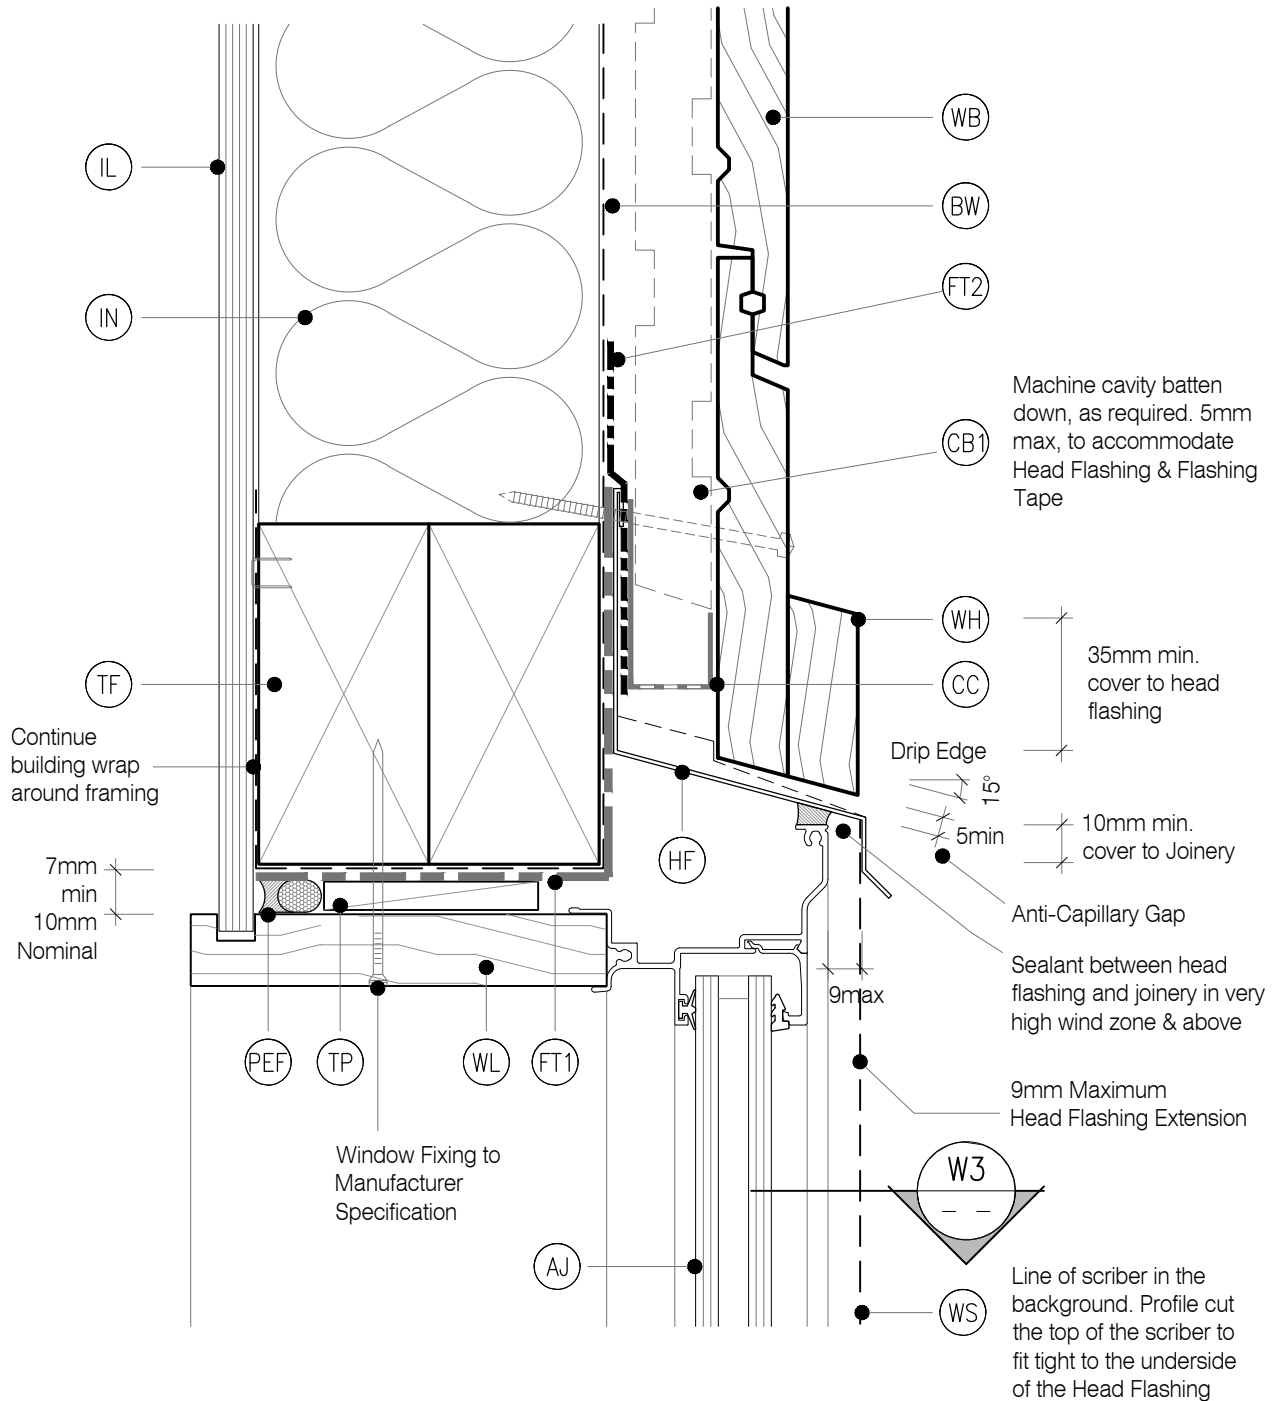


LEGEND :

- | | | |
|---|---|---|
| <p>(AJ) ALUMINIUM JOINERY: Selected double glazed aluminium joinery. To E2/AS1 9.1.10</p> <p>(BW) BUILDING WRAP: Flexible Wall Underlay, As per NZBC E2/AS1 - Table 23, In extra high wind zones, Rigid Underlay required (9.1.7.2 E2/AS1)</p> <p>(CB1) CAVITY BATTEN - NON STRUCTURAL : Vertically installed JSC-U 45mm x 20mm Radiata Pine H3.2 treated, both face castellated and 18° bevelled edges. Site machined to allow for flashing.</p> <p>(CC) CAVITY CLOSURE: Cavity closure strip, positioned to give a 15mm min. drip edge to cladding</p> <p>(FT1) FLASHING TAPE: Flashing tape over wrap 70mm (50 min) turn-down required in corners only. Refer to Fig. 72 of NZBC E2/AS1</p> | <p>(FT2) FLEXIBLE FLASHING TAPE: Flexible flashing tape lapped over aluminium head flashing or 2nd layer of Building Wrap, taped joint to top of timber frame</p> <p>(HF) HEAD FLASHING: Aluminium head flashing with minimum 15 degree fall, optional hemmed edges as per table 7 E2/AS1</p> <p>(IL) INTERNAL LINING: Selected Internal Lining</p> <p>(IN) INSULATION: Selected Insulation</p> <p>(PEF) PEF ROD BACKING: Foam backing rod with sealant to cavity in Window perimeter that forms a waterproof air-seal. (Sealant 2:1 Ratio)</p> <p>(TF) TIMBER FRAME: H1.2 min treated timber framing</p> | <p>(TP) TIMBER PACKER: Tan H3.2 Treated Packer</p> <p>(WL) WINDOW LINER: As Specified</p> <p>(WB) WEATHER BOARD: JSC Rusticated Weatherboard</p> <p>(WH) WEATHERHEAD: (OPTIONAL) Selected JSC Horizontal batten above window as necessary to suit profile, shaped to shed water, sealant to back of head scribe</p> <p>(WS) WINDOW SCRIBER: Sealant to back of scribe and 75 x 3.15mm 316 Stainless Steel nail in 3mm predrilled hole.</p> <p>(WZ) WANZ SUPPORT: Provide window support as required by joinery manufacturer</p> |
|---|---|---|

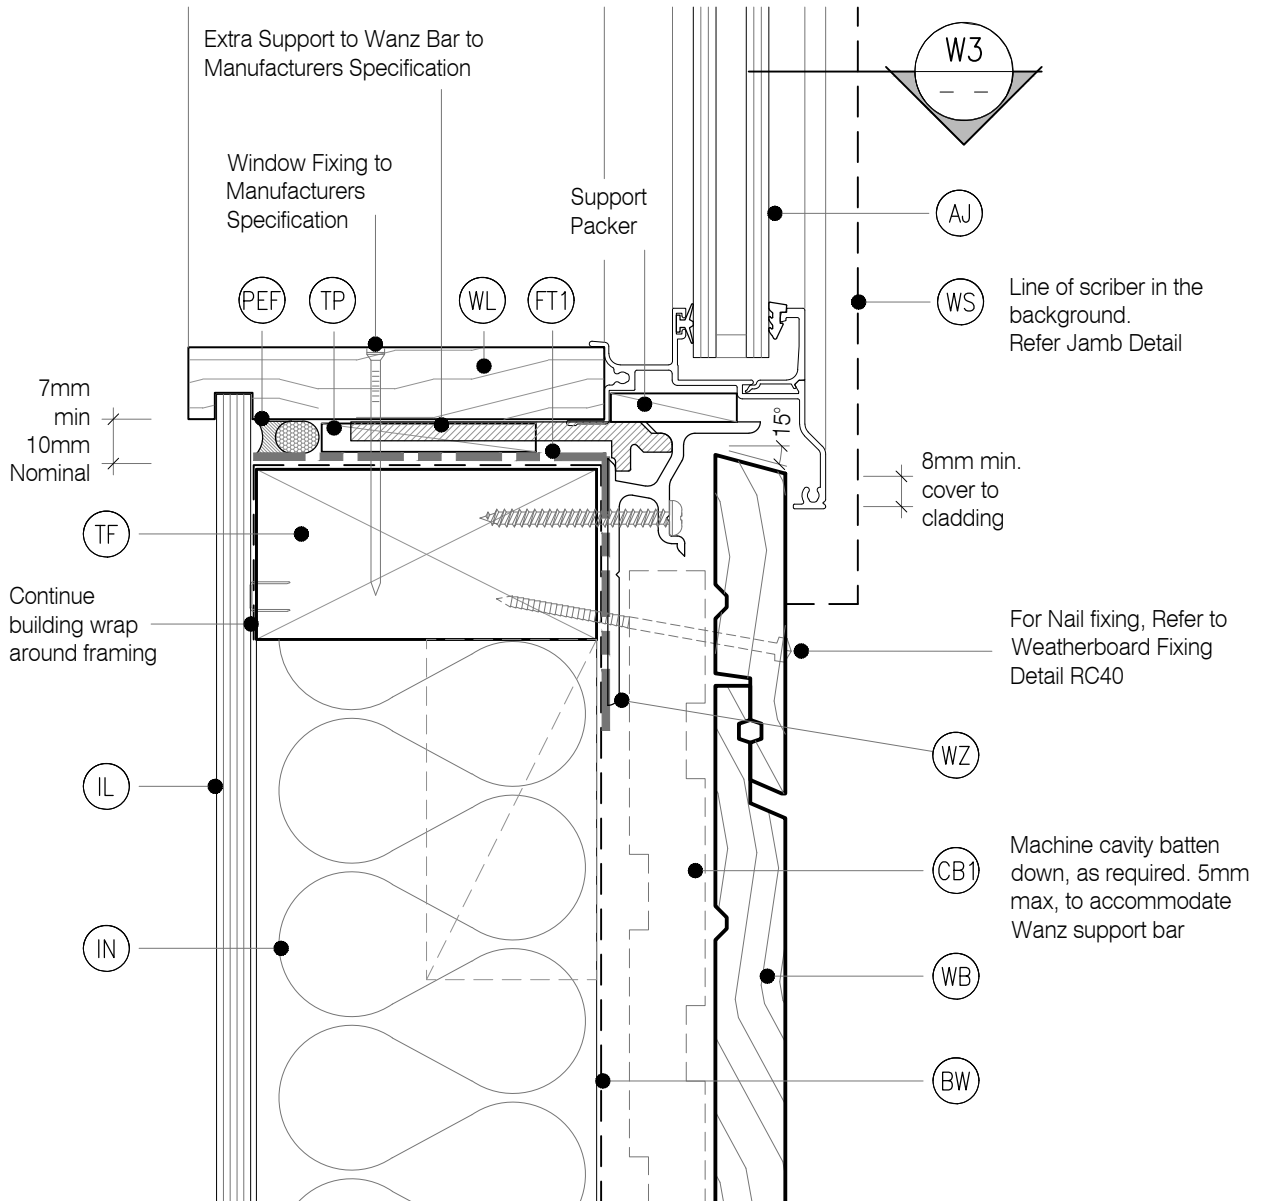


LEGEND :

- | | | |
|--|---|---|
| <p>(AJ) ALUMINIUM JOINERY: Selected double glazed aluminium joinery. To E2/AS1 9.1.10</p> <p>(BW) BUILDING WRAP: Flexible Wall Underlay, As per NZBC E2/AS1 - Table 23, In extra high wind zones, Rigid Underlay required (9.1.7.2 E2/AS1)</p> <p>(CB1) CAVITY BATTEN - NON STRUCTURAL : Vertically installed JSC-U 45mm x 20mm Radiata Pine H3.2 treated, both face castellated and 18° bevelled edges. Site machined to allow for flashing.</p> <p>(CC) CAVITY CLOSURE: Cavity closure strip, positioned to give a 15mm min. drip edge to cladding</p> <p>(FT1) FLASHING TAPE: Flashing tape over wrap 70mm (50 min) turn-down required in corners only. Refer to Fig. 72 of NZBC E2/AS1</p> | <p>(FT2) FLEXIBLE FLASHING TAPE: Flexible flashing tape lapped over aluminium head flashing or 2nd layer of Building Wrap, taped joint to top of timber frame</p> <p>(HF) HEAD FLASHING: Aluminium head flashing with minimum 15 degree fall, optional hemmed edges as per table 7 E2/AS1</p> <p>(IL) INTERNAL LINING: Selected Internal Lining</p> <p>(IN) INSULATION: Selected Insulation</p> <p>(PEF) PEF ROD BACKING: Foam backing rod with sealant to cavity in Window perimeter that forms a waterproof air-seal. (Sealant 2:1 Ratio)</p> <p>(TF) TIMBER FRAME: H1.2 min treated timber framing</p> | <p>(TP) TIMBER PACKER: Tan H3.2 Treated Packer</p> <p>(WL) WINDOW LINER: As Specified</p> <p>(WB) WEATHER BOARD: JSC Rusticated Weatherboard</p> <p>(WH) WEATHERHEAD: (OPTIONAL) Selected JSC Horizontal batten above window as necessary to suit profile, shaped to shed water, sealant to back of head scriber</p> <p>(WS) WINDOW SCRIBER: Sealant to back of scriber and 75 x 3.15mm 316 Stainless Steel nail in 3mm predrilled hole.</p> <p>(WZ) WANZ SUPPORT: Provide window support as required by joinery manufacturer</p> |
|--|---|---|

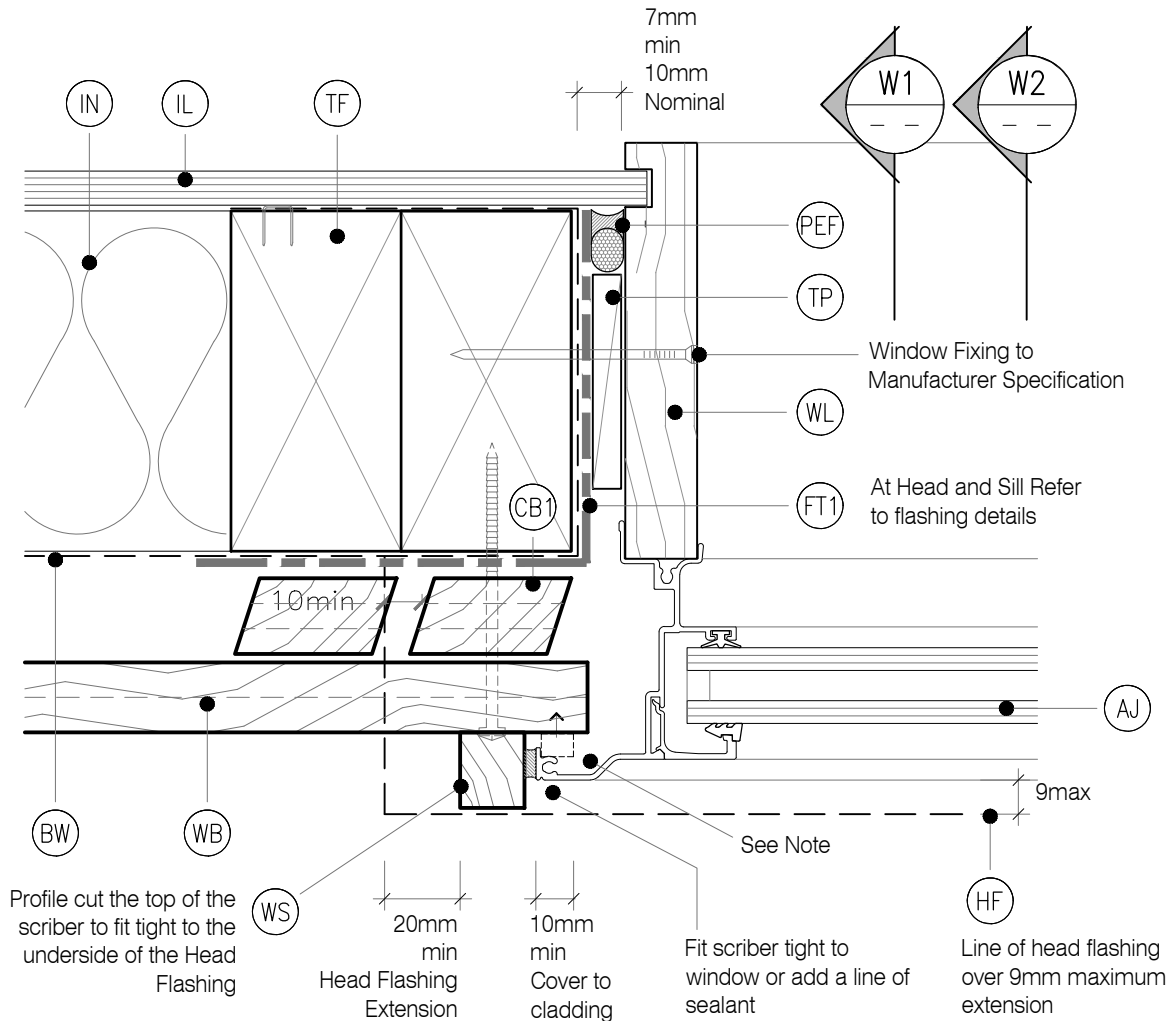


DETAIL NOTES :


1. No Scriber Option : The Aluminium Joinery must sit hard against the back of the joinery flange and the timber weatherboards with a E.P.S Compressible bond breaker foam seal between

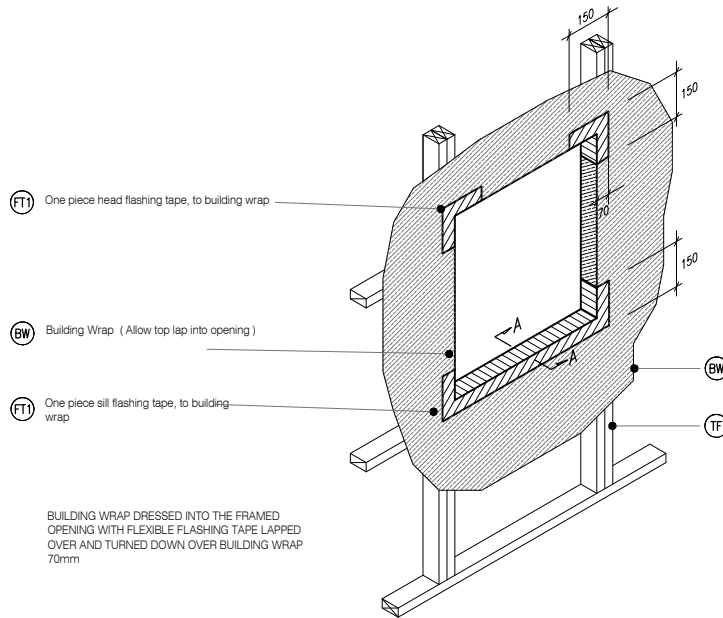

W4 TYPICAL WINDOW OPENING (FLASHING TAPE)
RC13 SCALE : N.T.S

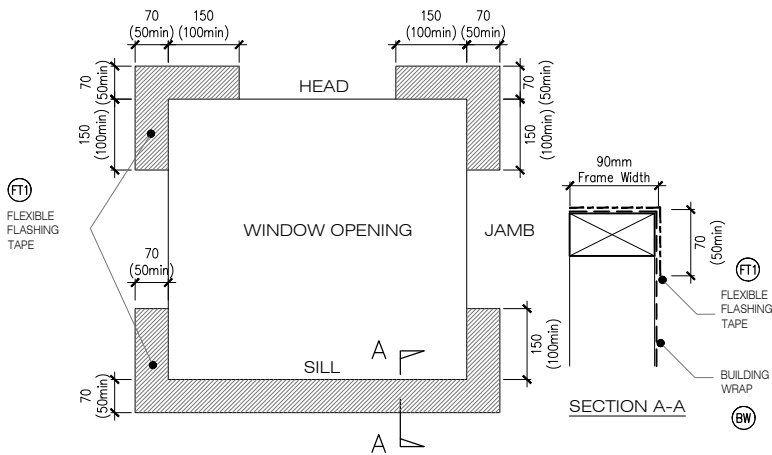

W5 FLEXIBLE BUILDING WRAP AT OPENING
RC13 SCALE : 1 / 5 @ A1, 1 / 10 @ A3

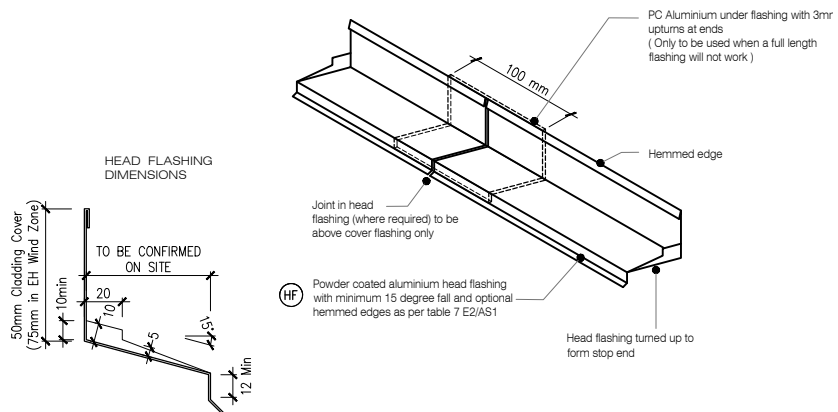


ONE PIECE PC ALUMINIUM HEAD FLASHING 15° SLOPE WITH 10mm min COVER TO JOINERY EXTEND 30mm min EITHER SIDE OF JOINERY WITH STOP ENDS

W6 TYPICAL HEAD & FLASHING JOINT
RC13 SCALE : 1 / 2 @ A1, 1 / 4 @ A3


LEGEND :

- | | | |
|--|---|---|
| <p>(AJ) ALUMINIUM JOINERY: Selected double glazed aluminium joinery. To E2/AS1 9.1.10</p> <p>(BW) BUILDING WRAP: Flexible Wall Underlay, As per NZBC E2/AS1 - Table 23, In extra high wind zones, Rigid Underlay required (9.1.7.2 E2/AS1)</p> <p>(CB1) CAVITY BATTEN - NON STRUCTURAL : Vertically installed JSC-U 45mm x 20mm Radiata Pine H3.2 treated, both face castellated and 18° bevelled edges. Site machined to allow for flashing.</p> <p>(CC) CAVITY CLOSURE: Cavity closure strip, positioned to give a 15mm Min drip edge to cladding</p> <p>(DS) FLASHING TAPE: Flashing tape over wrap 70mm (50 min) turn-down required in corners only. Refer to Fig. 72 of NZBC E2/AS1</p> <p>(FT1) DOOR SCRIBER: Sealant to back of scribe and 75 x 3.15mm 316 Stainless Steel nail in 3mm predrilled hole.</p> | <p>(FT2) FLEXIBLE FLASHING TAPE: Flexible flashing tape lapped over aluminium head flashing or 2nd layer of Building Wrap, taped joint to top of timber frame</p> <p>(HF) HEAD FLASHING: Aluminium head flashing with minimum 15 degree fall, optional hemmed edges as per table 7 E2/AS1</p> <p>(IL) INTERNAL LINING: Selected Internal Lining</p> <p>(IN) INSULATION: Selected Insulation</p> <p>(PEF) PEF ROD BACKING: Foam backing rod with sealant to cavity in Window perimeter that forms a waterproof air-seal. (Sealant 2:1 Ratio)</p> <p>(TF) TIMBER FRAME: H1.2 min treated timber framing</p> | <p>(TP) TIMBER PACKER: Tan H3.2 Treated Packer</p> <p>(WB) WEATHER BOARD: Selected JSC Rusticated Weatherboard</p> <p>(DL) DOOR LINER: As Specified</p> <p>(WB) WEATHER BOARD: JSC Rusticated Weatherboard</p> <p>(WH) WEATHERHEAD: (OPTIONAL) Selected JSC Horizontal batten above meter box as necessary to suit profile, shaped to shed water, sealant to back of head scribe</p> <p>(WZ) WANZ SUPPORT: Provide window support as required by joinery manufacturer</p> |
|--|---|---|

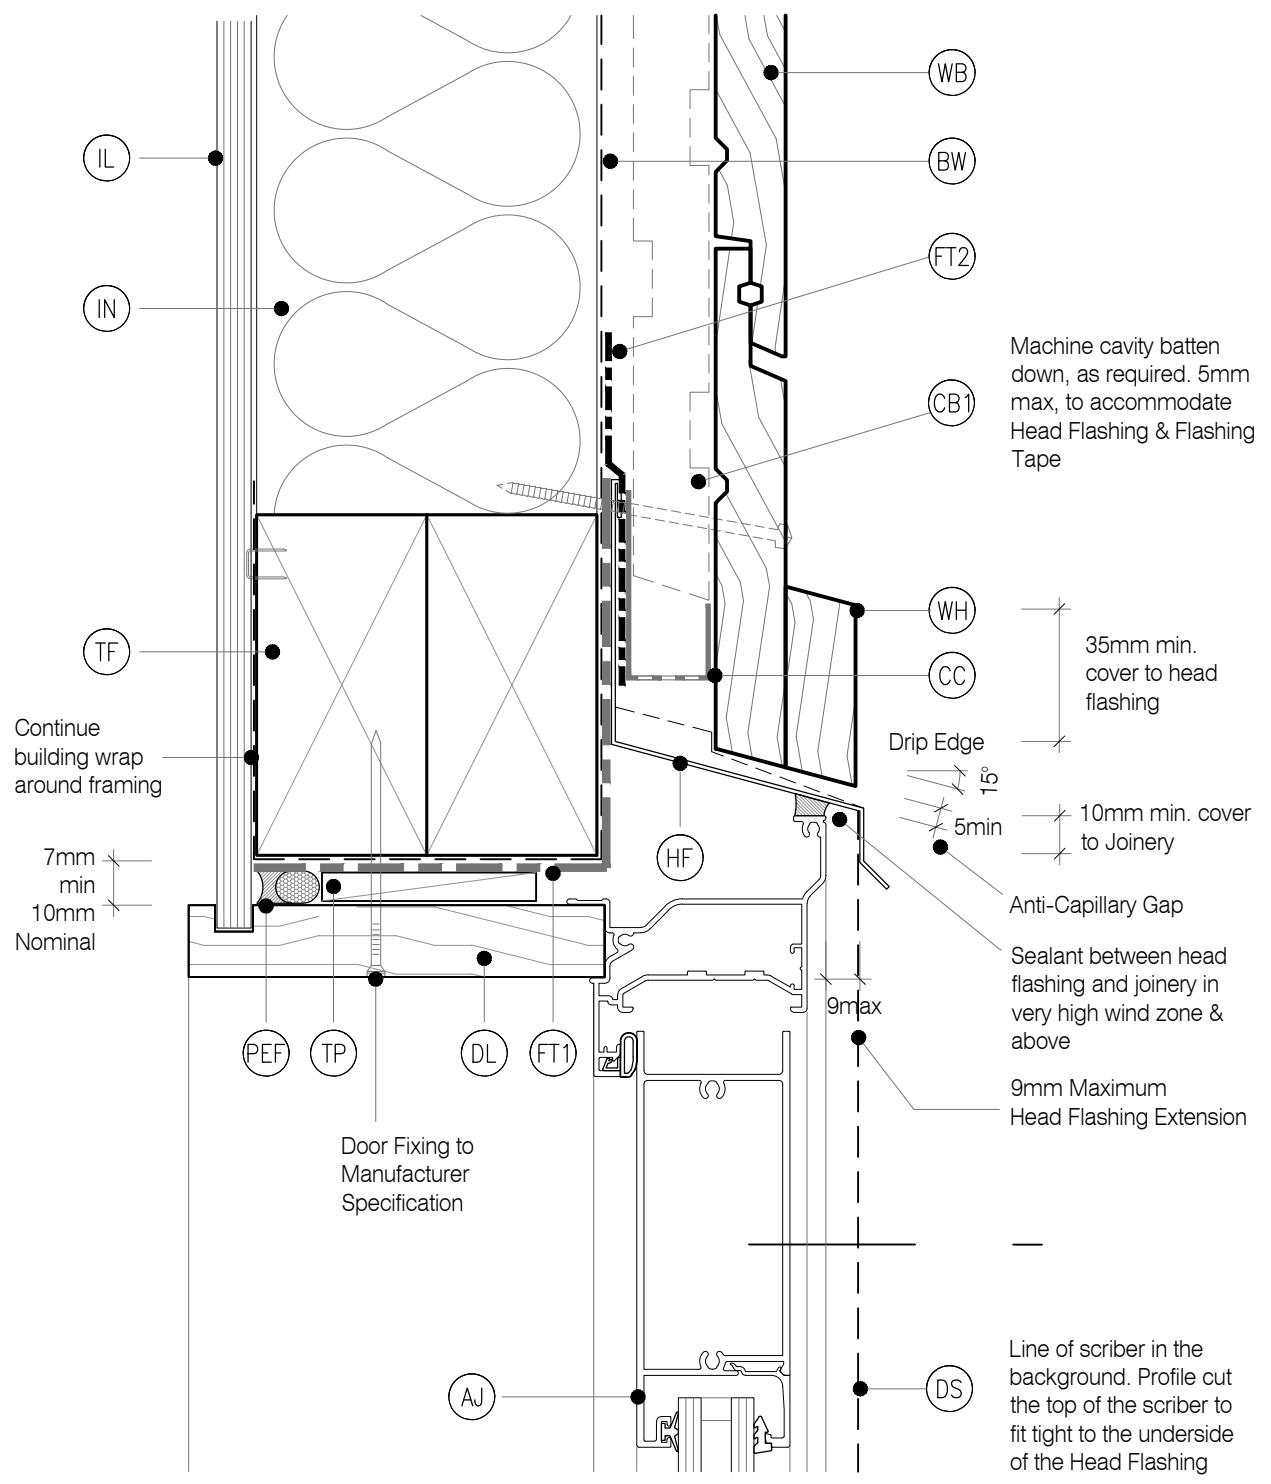


LEGEND :

- | | | |
|---|---|--|
| <p>(AJ) ALUMINIUM JOINERY: Selected double glazed aluminium joinery. To E2/AS1 9.1.10</p> <p>(BW) BUILDING WRAP: Flexible Wall Underlay, As per NZBC E2/AS1 - Table 23, In extra high wind zones, Rigid Underlay required (9.1.7.2 E2/AS1)</p> <p>(CB1) CAVITY BATTEN - NON STRUCTURAL : Vertically installed JSC-U 45mm x 20mm Radiata Pine H3.2 treated, both face castellated and 18° bevelled edges. Site machined to allow for flashing.</p> <p>(CC) CAVITY CLOSURE: Cavity closure strip, positioned to give a 15mm Min drip edge to cladding</p> <p>(DS) FLASHING TAPE: Flashing tape over wrap 70mm (50 min) turn-down required in corners only. Refer to Fig. 72 of NZBC E2/AS1</p> <p>(FT1) DOOR SCRIBER: Sealant to back of scriber and 75 x 3.15mm 316 Stainless Steel nail in 3mm predrilled hole.</p> | <p>(FT2) FLEXIBLE FLASHING TAPE: Flexible flashing tape lapped over aluminium head flashing or 2nd layer of Building Wrap, taped joint to top of timber frame</p> <p>(HF) HEAD FLASHING: Aluminium head flashing with minimum 15 degree fall, optional hemmed edges as per table 7 E2/AS1</p> <p>(IL) INTERNAL LINING: Selected Internal Lining</p> <p>(IN) INSULATION: Selected Insulation</p> <p>(PEF) PEF ROD BACKING: Foam backing rod with sealant to cavity in Window perimeter that forms a waterproof air-seal. (Sealant 2:1 Ratio)</p> <p>(TF) TIMBER FRAME: H1.2 min treated timber framing</p> | <p>(TP) TIMBER PACKER: Tan H3.2 Treated Packer</p> <p>(WB) WEATHER BOARD: Selected JSC Rusticated Weatherboard</p> <p>(DL) DOOR LINER: As Specified</p> <p>(WB) WEATHER BOARD: JSC Rusticated Weatherboard</p> <p>(WH) WEATHERHEAD: (OPTIONAL) Selected JSC Horizontal batten above meter box as necessary to suit profile, shaped to shed water, sealant to back of head scriber</p> <p>(WZ) WANZ SUPPORT: Provide window support as required by joinery manufacturer</p> |
|---|---|--|

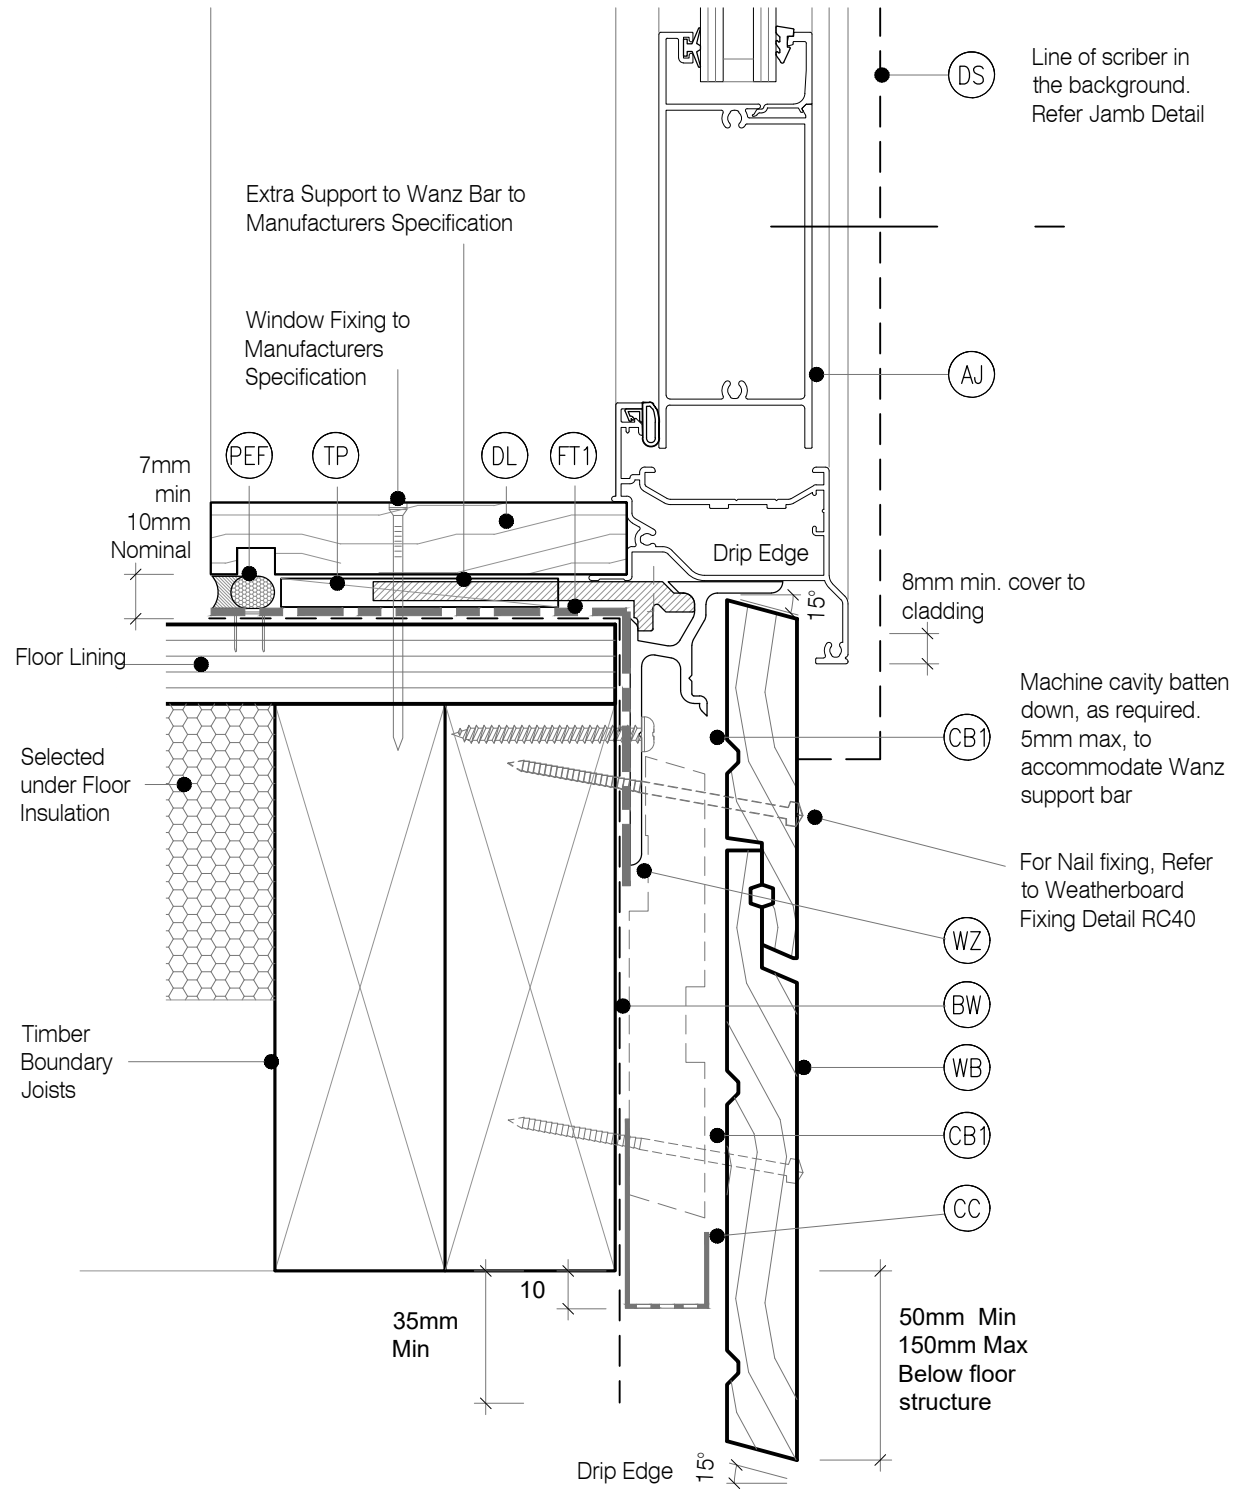




LEGEND :

- | | | |
|--|---|---|
| <p>(AJ) ALUMINIUM JOINERY: Selected double glazed aluminium joinery. To E2/AS1 9.1.10</p> <p>(BW) BUILDING WRAP: Flexible Wall Underlay, As per NZBC E2/AS1 - Table 23, In extra high wind zones, Rigid Underlay required (9.1.7.2 E2/AS1)</p> <p>(CB1) CAVITY BATTEN - NON STRUCTURAL : Vertically installed JSC-U 45mm x 20mm Radiata Pine H3.2 treated, both face castellated and 18° bevelled edges. Site machined to allow for flashing.</p> <p>(CC) CAVITY CLOSURE: Cavity closure strip, positioned to give a 15mm Min drip edge to cladding</p> <p>(DS) FLASHING TAPE: Flashing tape over wrap 70mm (50 min) turn-down required in corners only. Refer to Fig. 72 of NZBC E2/AS1</p> <p>(FT1) DOOR SCRIBER: Sealant to back of scribe and 75 x 3.15mm 316 Stainless Steel nail in 3mm predrilled hole.</p> | <p>(FT2) FLEXIBLE FLASHING TAPE: Flexible flashing tape lapped over aluminium head flashing or 2nd layer of Building Wrap, taped joint to top of timber frame</p> <p>(HF) HEAD FLASHING: Aluminium head flashing with minimum 15 degree fall, optional hemmed edges as per table 7 E2/AS1</p> <p>(IL) INTERNAL LINING: Selected Internal Lining</p> <p>(IN) INSULATION: Selected Insulation</p> <p>(PEF) PEF ROD BACKING: Foam backing rod with sealant to cavity in Window perimeter that forms a waterproof air-seal. (Sealant 2:1 Ratio)</p> <p>(TF) TIMBER FRAME: H1.2 min treated timber framing</p> | <p>(TP) TIMBER PACKER: Tan H3.2 Treated Packer</p> <p>(WB) WEATHER BOARD: Selected JSC Rusticated Weatherboard</p> <p>(DL) DOOR LINER: As Specified</p> <p>(WB) WEATHER BOARD: JSC Rusticated Weatherboard</p> <p>(WH) WEATHERHEAD: (OPTIONAL) Selected JSC Horizontal batten above meter box as necessary to suit profile, shaped to shed water, sealant to back of head scribe</p> <p>(WZ) WANZ SUPPORT: Provide window support as required by joinery manufacturer</p> |
|--|---|---|

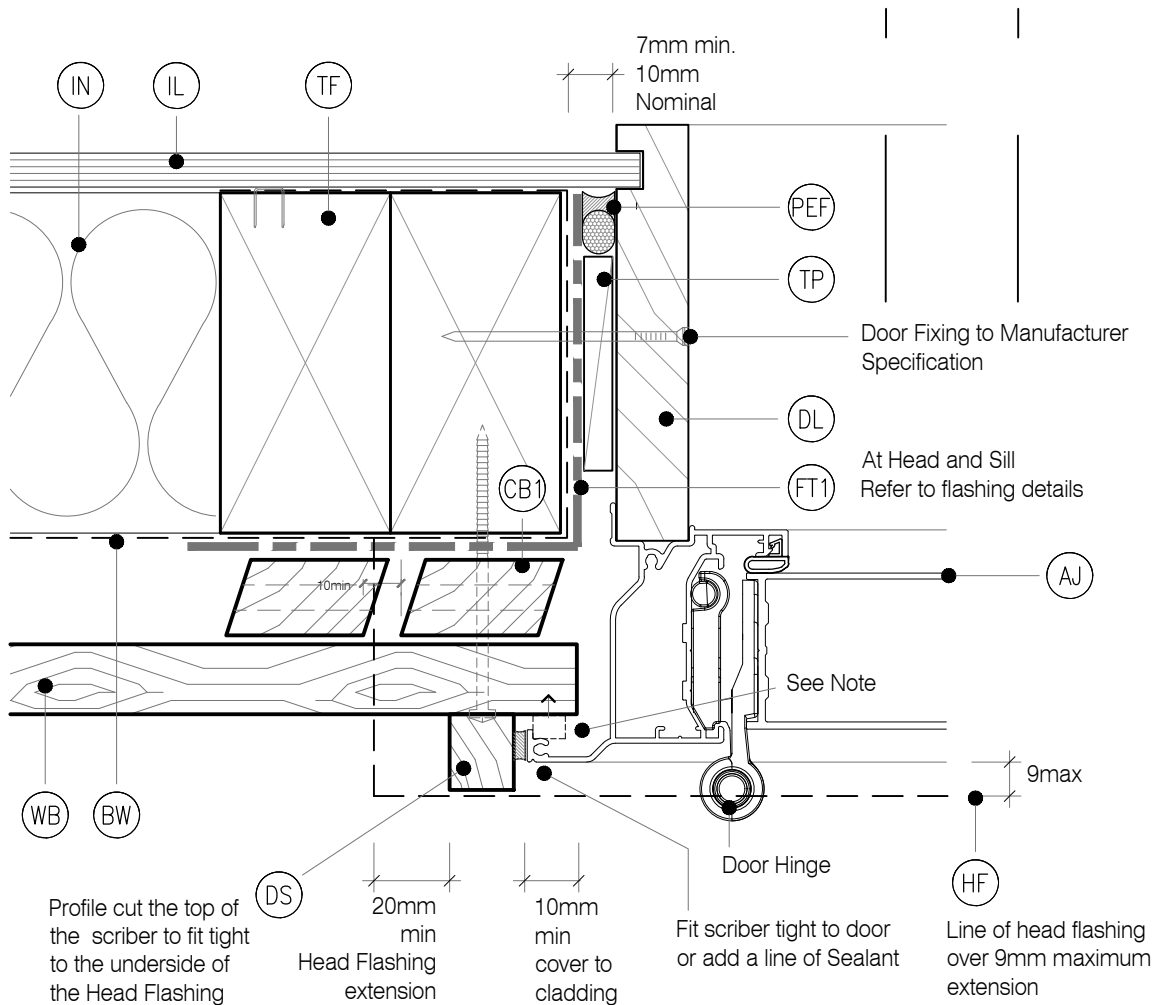

DETAIL NOTES :


1. No Scribe Option : The Aluminium Joinery must sit hard against the back of the joinery flange and the timber weatherboards with a E.P.S Compressible bond breaker foam seal between

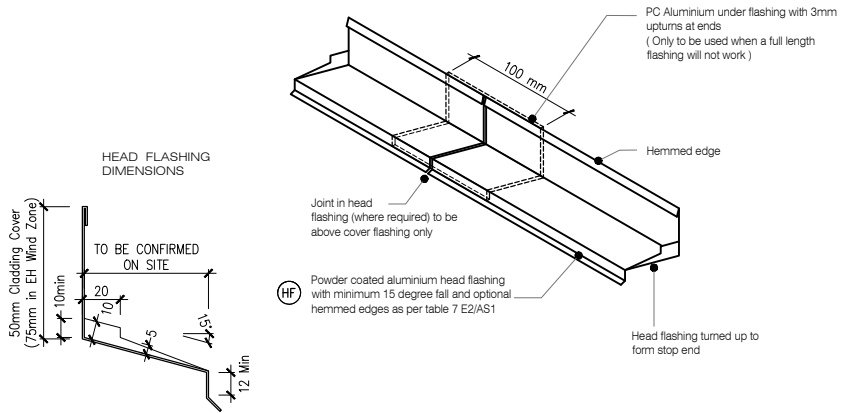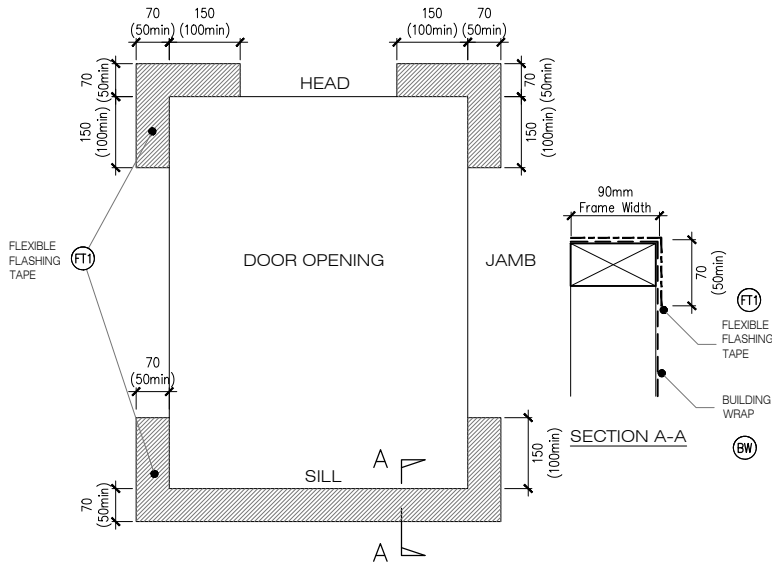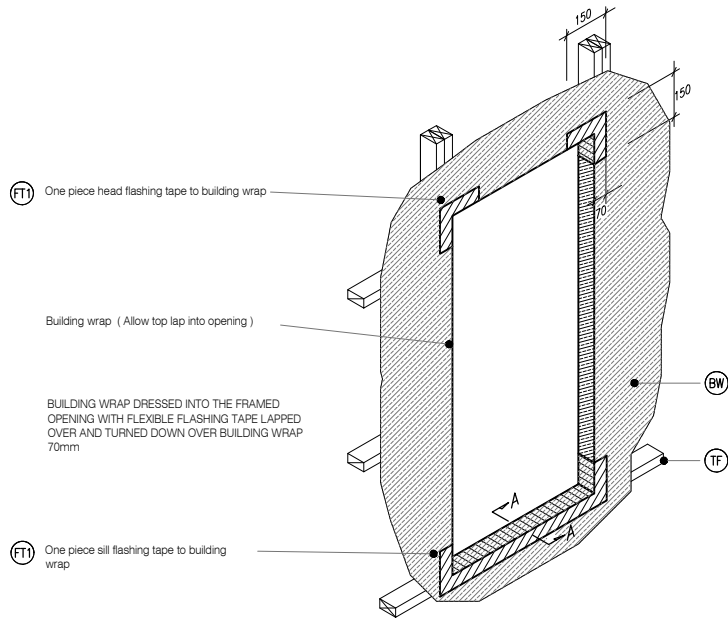

ONE PIECE PC ALUMINIUM HEAD FLASHING 15° SLOPE WITH 10mm minimum COVER TO JOINERY EXTEND 30mm min EITHER SIDE OF JOINERY WITH STOP ENDS


LEGEND :


- | | | |
|---|---|---|
| <p>(BW) BUILDING WRAP: Flexible Wall Underlay, As per NZBC E2/AS1 - Table 23, in extra high wind zones, Rigid Underlay required (9.1.7.2 E2/AS1)</p> <p>(CB1) CAVITY BATTEN - NON STRUCTURAL : Horizontally installed JSC-U 45mm x 20mm Radiata Pine H3.2 treated, both face castellated and 18° bevelled edges.</p> <p>(CC) CAVITY CLOSURE: Cavity closure strip, positioned to give a 15mm minimum drip edge to cladding</p> <p>(FT1) FLASHING TAPE: Flashing tape over wrap 70mm (50 min) turn-down required in corners only. Refer to Fig. 72 of NZBC E2/AS1</p> <p>(FT2) FLEXIBLE FLASHING TAPE: Flexible flashing tape lapped over aluminium head flashing or 2nd layer of Building Wrap, taped joint to top of timber frame</p> | <p>(HF) HEAD FLASHING: Aluminium head flashing with minimum 15 degree fall, optional hemmed edges as per table 7 E2/AS1</p> <p>(IL) INTERNAL LINING: Selected Internal Lining</p> <p>(IN) INSULATION: Selected Insulation</p> <p>(PEF) PEF ROD BACKING: Foam backing rod with sealant to cavity in Window perimeter that forms a waterproof air-seal. (Sealant 2:1 Ratio)</p> <p>(MB) METER BOX: Electrical meter box, with removable hinged door and polycarbonate viewing window</p> <p>(MS) METER BOX SCRIBER: Sealant to back of scriber and 75 x 3.15mm 316 Stainless Steel nail in 3mm predrilled hole.</p> | <p>(TF) TIMBER FRAME: H1.2 min treated timber framing</p> <p>(TP) TIMBER PACKER: Tan H3.2 Treated Packer</p> <p>(WB) WEATHER BOARD: Selected JSC Rusticated Weatherboard</p> <p>(WL) WINDOW LINER: As Specified</p> <p>(WH) WEATHERHEAD: (OPTIONAL) Selected JSC Horizontal batten above meter box as necessary to suit profile, shaped to shed water, sealant to back of head scriber</p> |
|---|---|---|

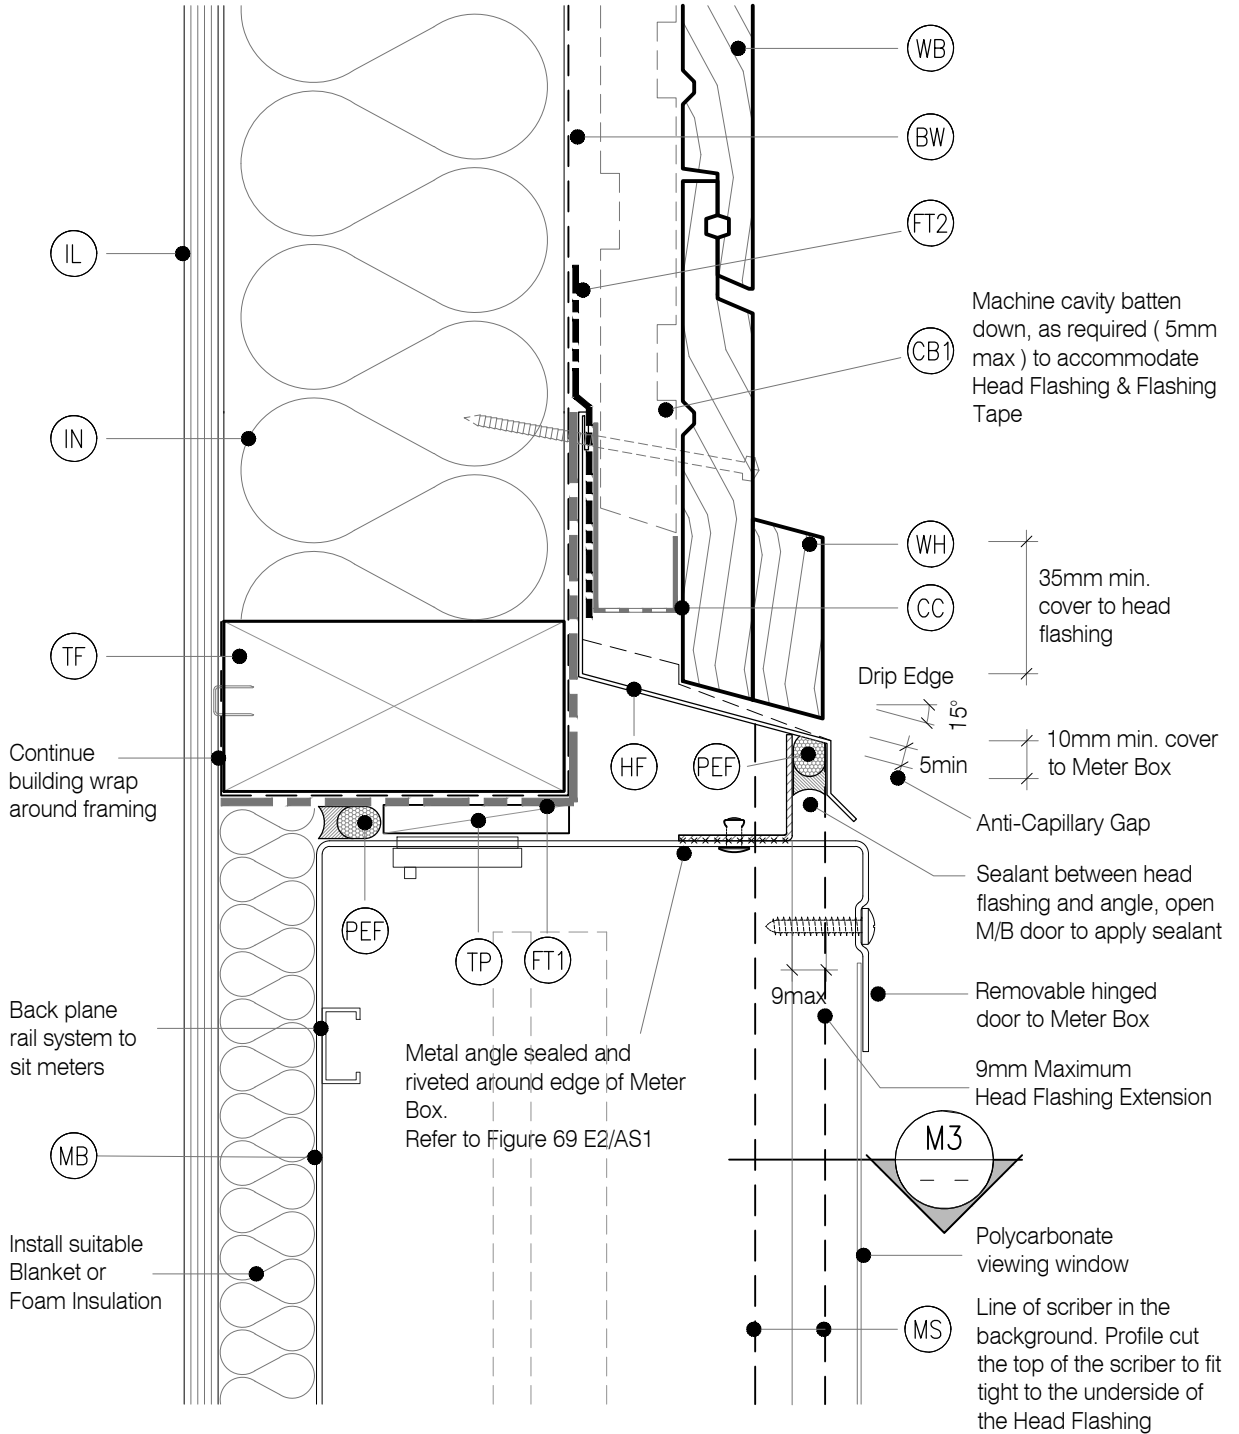


LEGEND :

- | | | |
|---|---|---|
| <p>(BW) BUILDING WRAP: Flexible Wall Underlay, As per NZBC E2/AS1 - Table 23, in extra high wind zones, Rigid Underlay required (9.1.7.2 E2/AS1)</p> <p>(CB1) CAVITY BATTEN - NON STRUCTURAL : Horizontally installed JSC-U 45mm x 20mm Radiata Pine H3.2 treated, both face castellated and 18° bevelled edges.</p> <p>(CC) CAVITY CLOSURE: Cavity closure strip, positioned to give a 15mm minimum drip edge to cladding</p> <p>(FT1) FLASHING TAPE: Flashing tape over wrap 70mm (50 min) turn-down required in corners only. Refer to Fig. 72 of NZBC E2/AS1</p> <p>(FT2) FLEXIBLE FLASHING TAPE: Flexible flashing tape lapped over aluminium head flashing or 2nd layer of Building Wrap, taped joint to top of timber frame</p> | <p>(HF) HEAD FLASHING: Aluminium head flashing with minimum 15 degree fall, optional hemmed edges as per table 7 E2/AS1</p> <p>(IL) INTERNAL LINING: Selected Internal Lining</p> <p>(IN) INSULATION: Selected Insulation</p> <p>(PEF) PEF ROD BACKING: Foam backing rod with sealant to cavity in Window perimeter that forms a waterproof air-seal. (Sealant 2:1 Ratio)</p> <p>(MB) METER BOX: Electrical meter box, with removable hinged door and polycarbonate viewing window</p> <p>(MS) METER BOX SCRIBER: Sealant to back of scriber and 75 x 3.15mm 316 Stainless Steel nail in 3mm predrilled hole.</p> | <p>(TF) TIMBER FRAME: H1.2 min treated timber framing</p> <p>(TP) TIMBER PACKER: Tan H3.2 Treated Packer</p> <p>(WB) WEATHER BOARD: Selected JSC Rusticated Weatherboard</p> <p>(WL) WINDOW LINER: As Specified</p> <p>(WH) WEATHERHEAD: (OPTIONAL) Selected JSC Horizontal batten above meter box as necessary to suit profile, shaped to shed water, sealant to back of head scriber</p> |
|---|---|---|

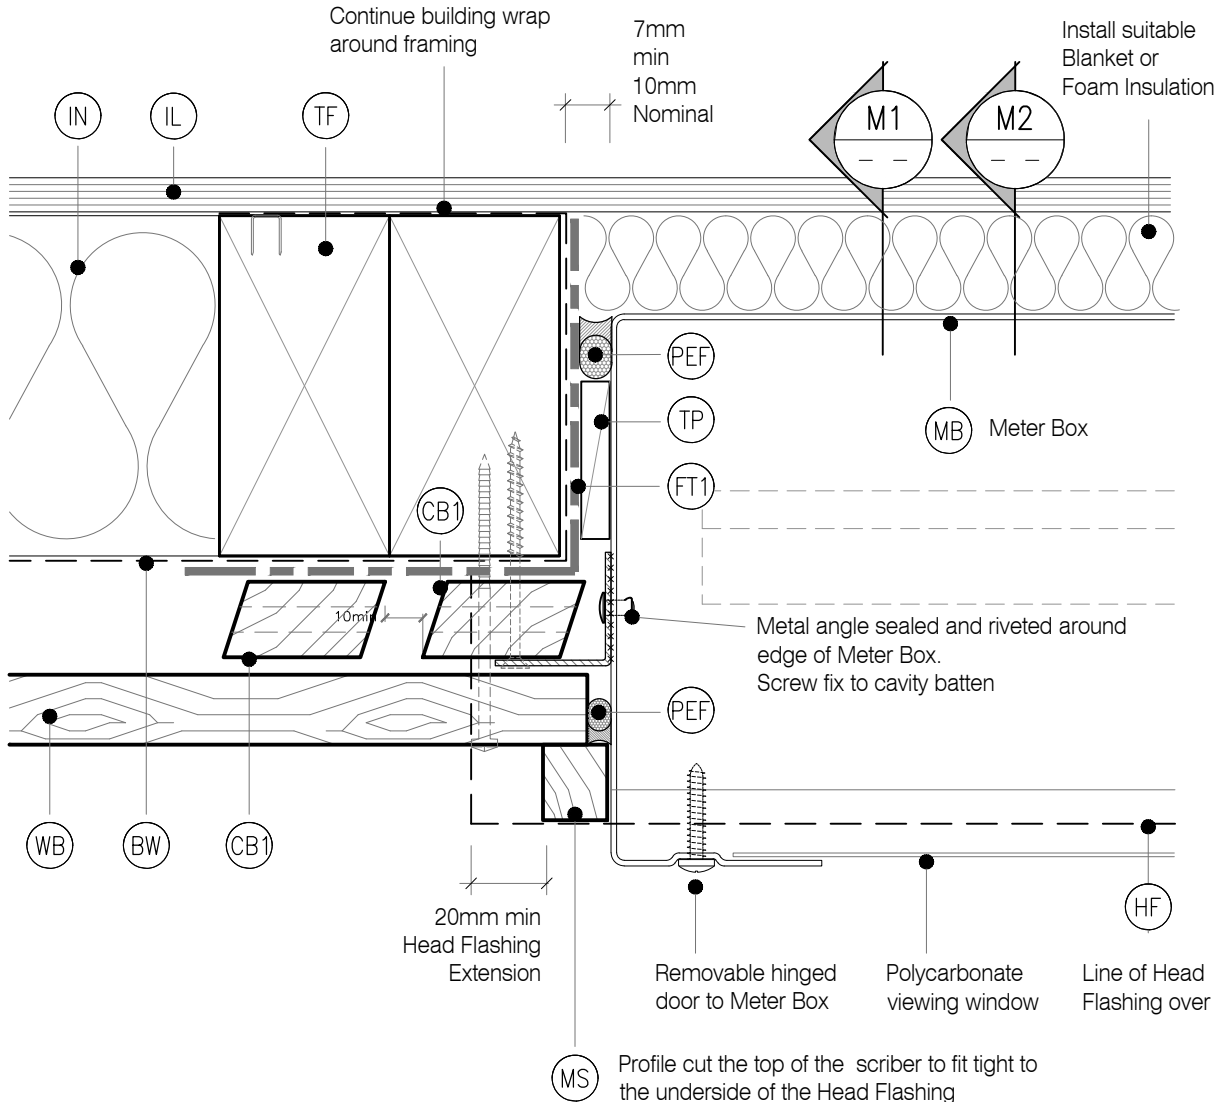


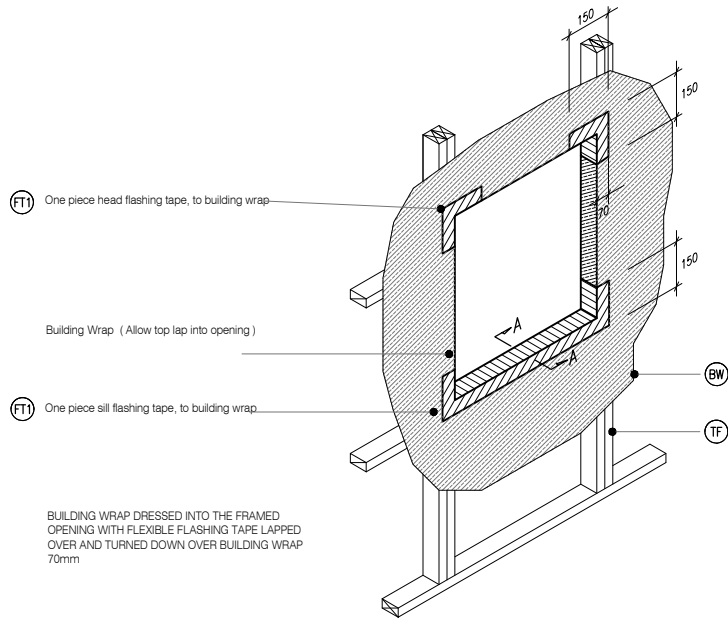

M4 TYPICAL METER BOX OPENING (FLASHING TAPE)
RC33 SCALE : N.T.S

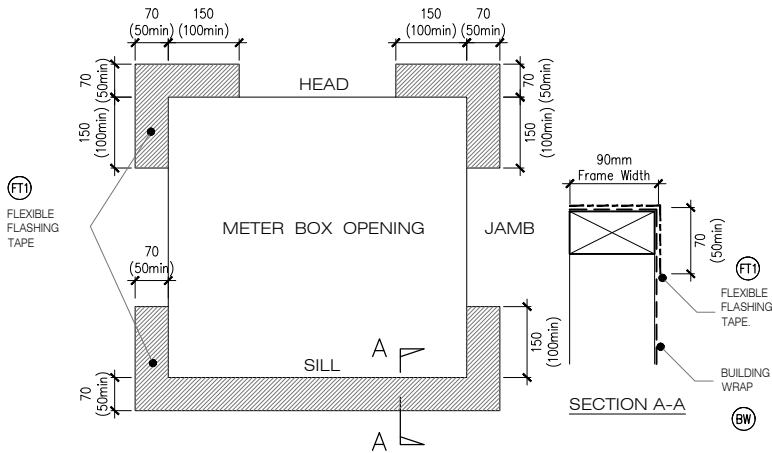


M5 FLEXIBLE BUILDING WRAP AT OPENING
RC33 SCALE : 1 / 5 @ A1, 1 / 10 @ A3

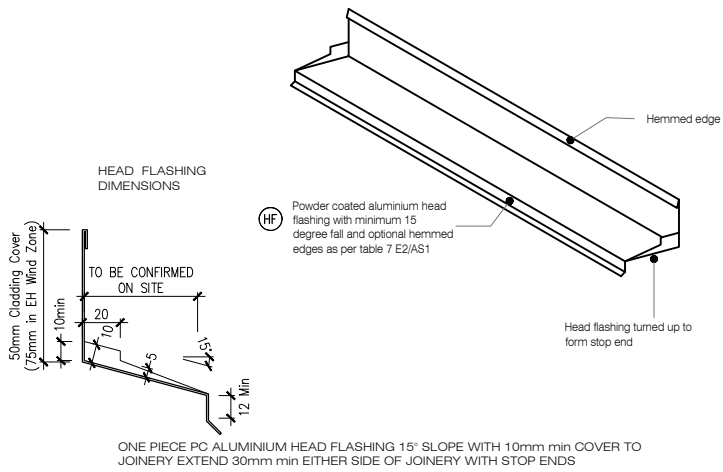

M6 TYPICAL HEAD & FLASHING JOINT
RC33 SCALE : 1 / 2 @ A1, 1 / 4 @ A3


LEGEND :

- | | | |
|--|--|---|
| <p>(BF) BACK FLASHING: Minimum 100mm Polypropylene or PVC rear flashing to provide 50mm cover past the scarf joint on each side</p> <p>(BW) BUILDING WRAP: Flexible Wall Underlay, as per NZBC E2/AS1 - Table 23. In extra high wind zones, Rigid Underlay required (9.1.7.2 E2/AS1)</p> | <p>(CC) CAVITY CLOSURE: Cavity closure strip, positioned to give a 15mm minimum drip edge to cladding</p> <p>(FT4) FLEXIBLE FLASHING TAPE: Flexible flashing tape lapped into corner, Refer NZBC E2/AS1 4.3.11 Flashing tape is recommended due to movement that may occur in corners. Not required by E2/AS1</p> <p>(IL) INTERNAL LINING: Selected Internal Lining</p> | <p>(IN) INSULATION: Selected Insulation</p> <p>(TF) TIMBER FRAME: H1.2 min treated timber framing</p> <p>(WB) WEATHERBOARD: Selected JSC Rusticated Weatherboard</p> |
|--|--|---|

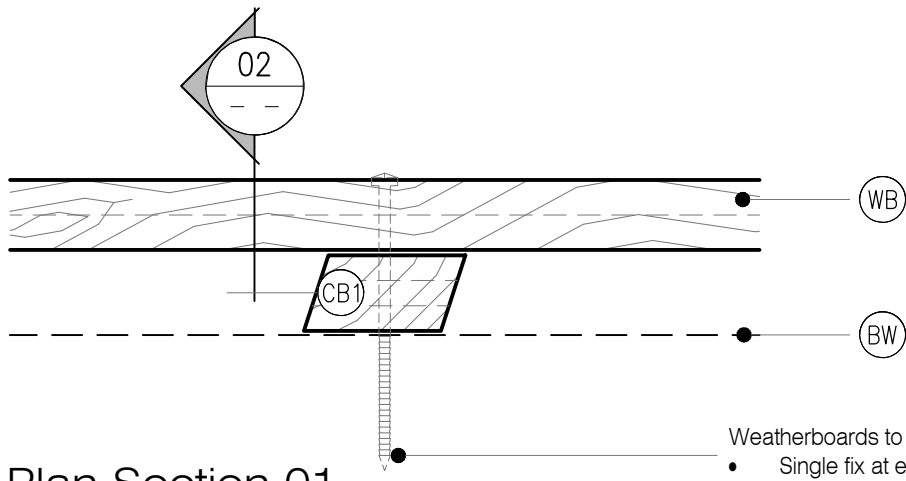

Plan Section 01

- Weatherboards to be
- Single fix at each stud with annular grooved nails as per NZBC E2/AS1 Table 24
 - Pre-drilled 1mm diameter smaller than the nail gauge
 - Nailed with slight (2°+) upward slope
 - Fixed with fixings to achieve a minimum of 30mm penetration into the framing
 - Nailed 10mm above the top of the lower board
 - Minimum 50mm from the ends of boards

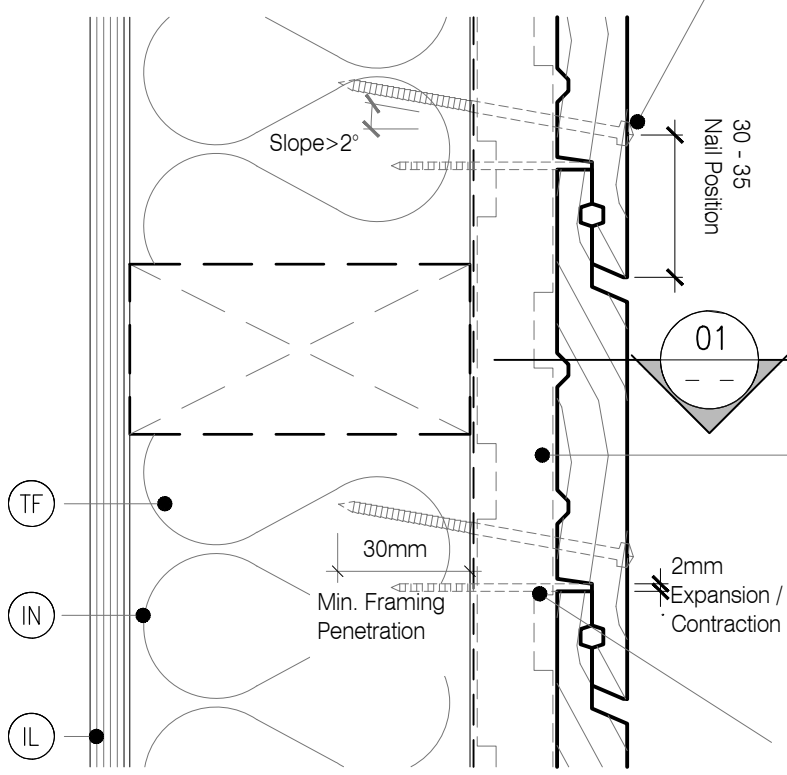

Cavity battens will be fixed by the cladding fixings, which will penetrate the wall framing. Battens only need temporary fixing until the cladding is fixed (E2/AS1 - Table 24)

40 x 2.0mm Stainless Steel Clinch Nail (Optional)
To maintain the 2mm Gap

Cross Section 02

LEGEND :



BACK FLASHING: Minimum 100mm Polypropylene or PVC rear flashing to provide 50mm cover past the scarf joint on each side



BUILDING WRAP: Flexible Wall Underlay, as per NZBC E2/AS1 - Table 23. In extra high wind zones, Rigid Underlay required (9.1.7.2 E2/AS1)



CAVITY CLOSURE: Cavity closure strip, positioned to give a 15mm minimum drip edge to cladding



FLEXIBLE FLASHING TAPE: Flexible flashing tape lapped into corner, Refer NZBC E2/AS1 4.3.11
Flashing tape is recommended due to movement that may occur in corners. Not required by E2/AS1



INTERNAL LINING: Selected Internal Lining




INSULATION: Selected Insulation




TIMBER FRAME: H1.2 min treated timber framing



WEATHERBOARD: Selected JSC Rusticated Weatherboard

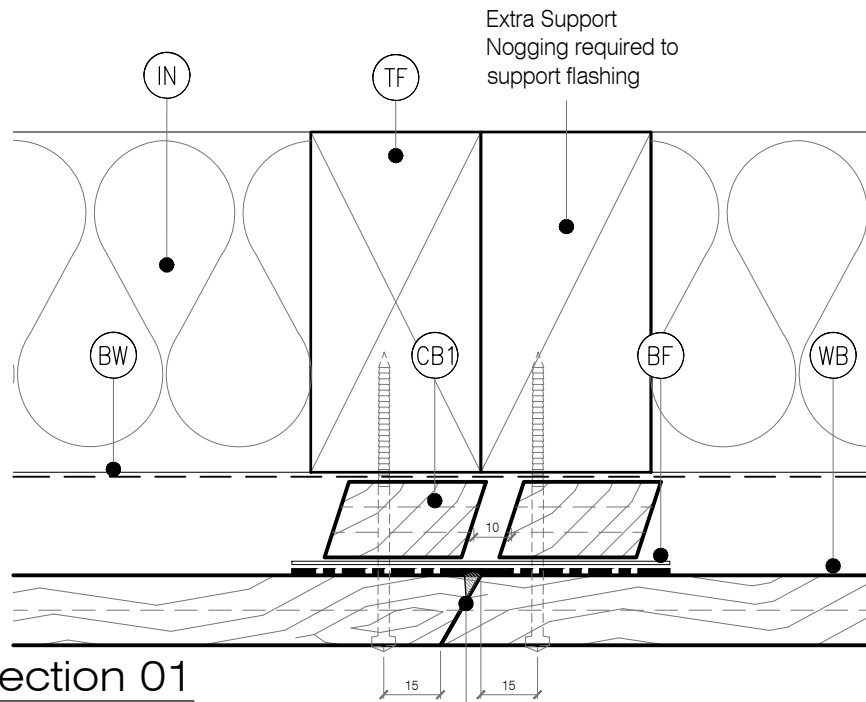

Plan Section 01

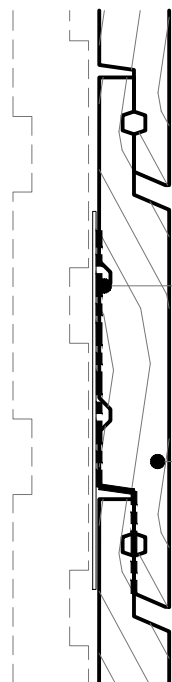

30° Scarf Joint
Continuous bead of sealant.
Notch weatherboard end to allow space

Back Flashing and 70mm Flashing tape lapped over board below

Scarfed Weatherboard

Cross Section 02



LEGEND :

- (BF) BACK FLASHING: Minimum 100mm Polypropylene or PVC rear flashing to provide 50mm cover past the scarf joint on each side


(BW) BUILDING WRAP: Flexible Wall Underlay, as per NZBC E2/AS1 - Table 23. In extra high wind zones, Rigid Underlay required (9.1.7.2 E2/AS1)
- (CC) CAVITY CLOSURE: Cavity closure strip, positioned to give a 15mm minimum drip edge to cladding

(FT4) FLEXIBLE FLASHING TAPE: Flexible flashing tape lapped into corner, Refer NZBC E2/AS1 4.3.11 Flashing tape is recommended due to movement that may occur in corners. Not required by E2/AS1

(IL) INTERNAL LINING: Selected Internal Lining
- (IN) INSULATION: Selected Insulation

(TF) TIMBER FRAME: H1.2 min treated timber framing

(WB) WEATHERBOARD: Selected JSC Rusticated Weatherboard

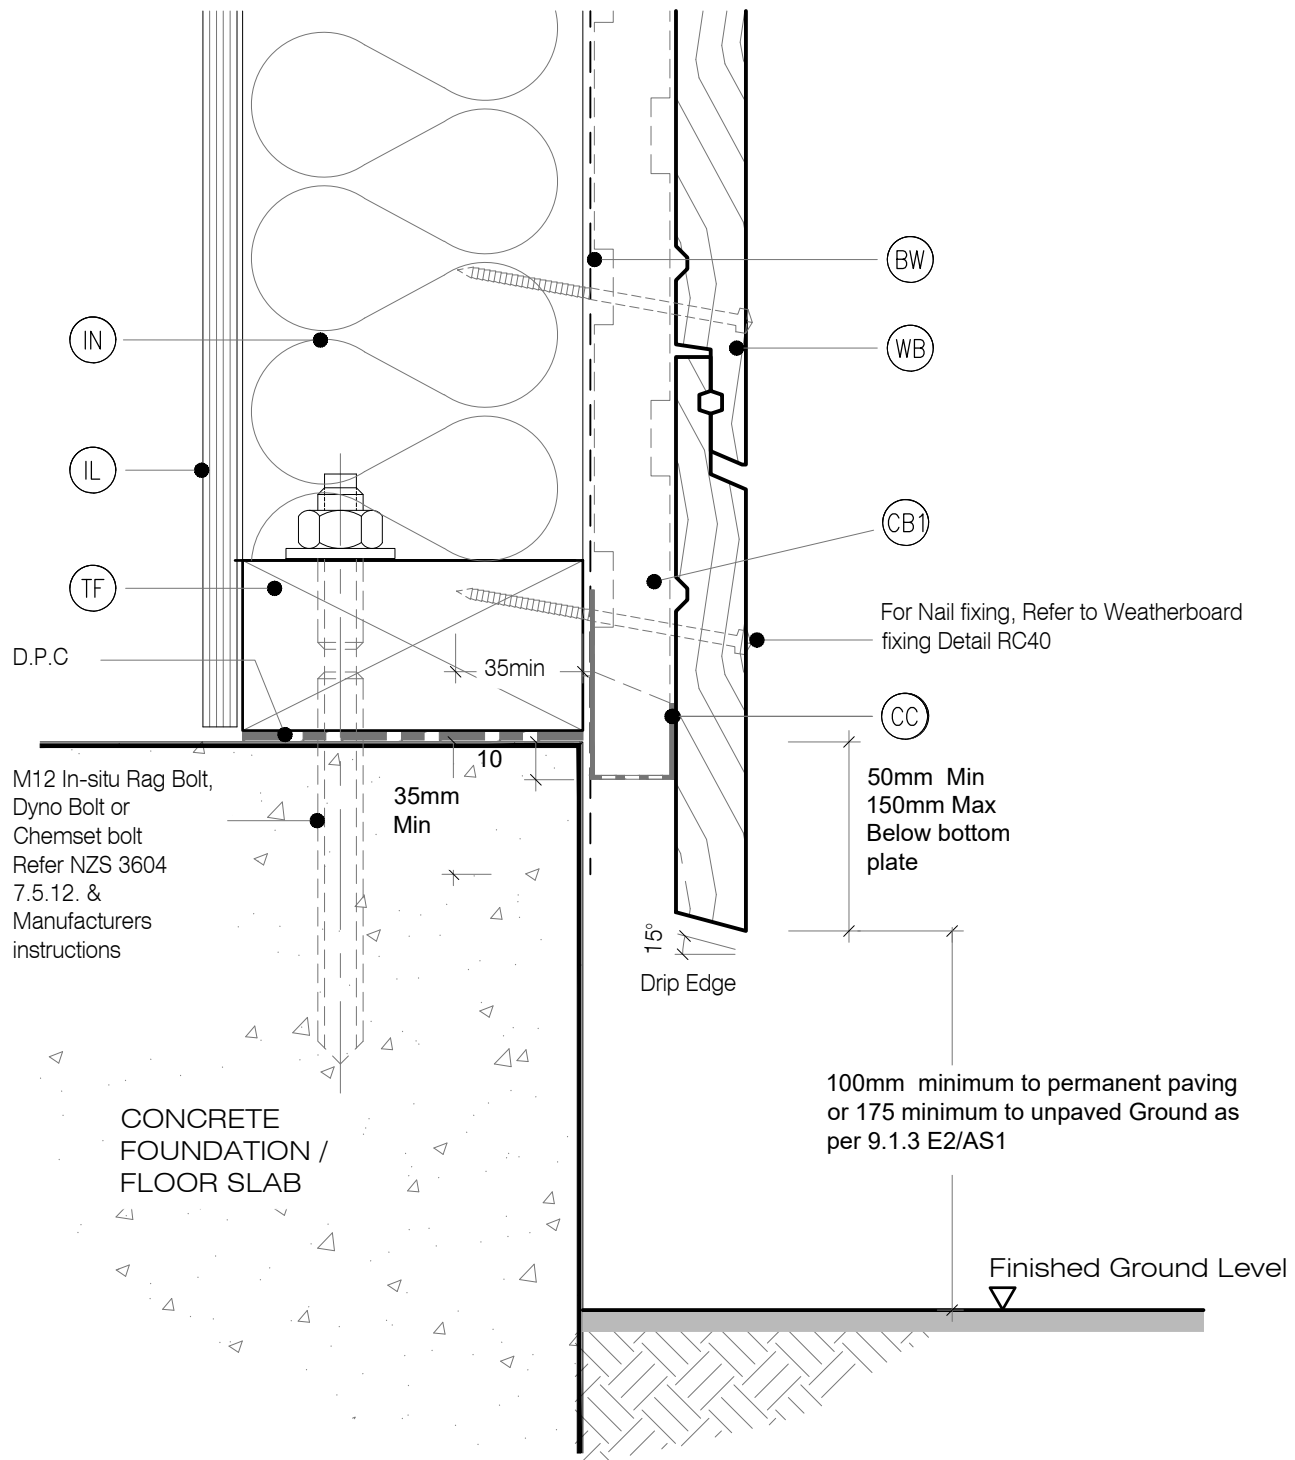

LEGEND :

(BF)

BACK FLASHING: Minimum 100mm Polypropylene or PVC rear flashing to provide 50mm cover past the scarf joint on each side

(BW)

BUILDING WRAP: Flexible Wall Underlay, as per NZBC E2/AS1 - Table 23. In extra high wind zones, Rigid Underlay required (9.1.7.2 E2/AS1)

(CC)

CAVITY CLOSURE: Cavity closure strip, positioned to give a 15mm minimum drip edge to cladding

(FT4)

FLEXIBLE FLASHING TAPE: Flexible flashing tape lapped into corner, Refer NZBC E2/AS1 4.3.11
Flashing tape is recommended due to movement that may occur in corners. Not required by E2/AS1

(IL)

INTERNAL LINING: Selected Internal Lining

(IN)


INSULATION: Selected Insulation

(TF)

TIMBER FRAME: H1.2 min treated timber framing

(WB)

WEATHERBOARD: Selected JSC Rusticated Weatherboard

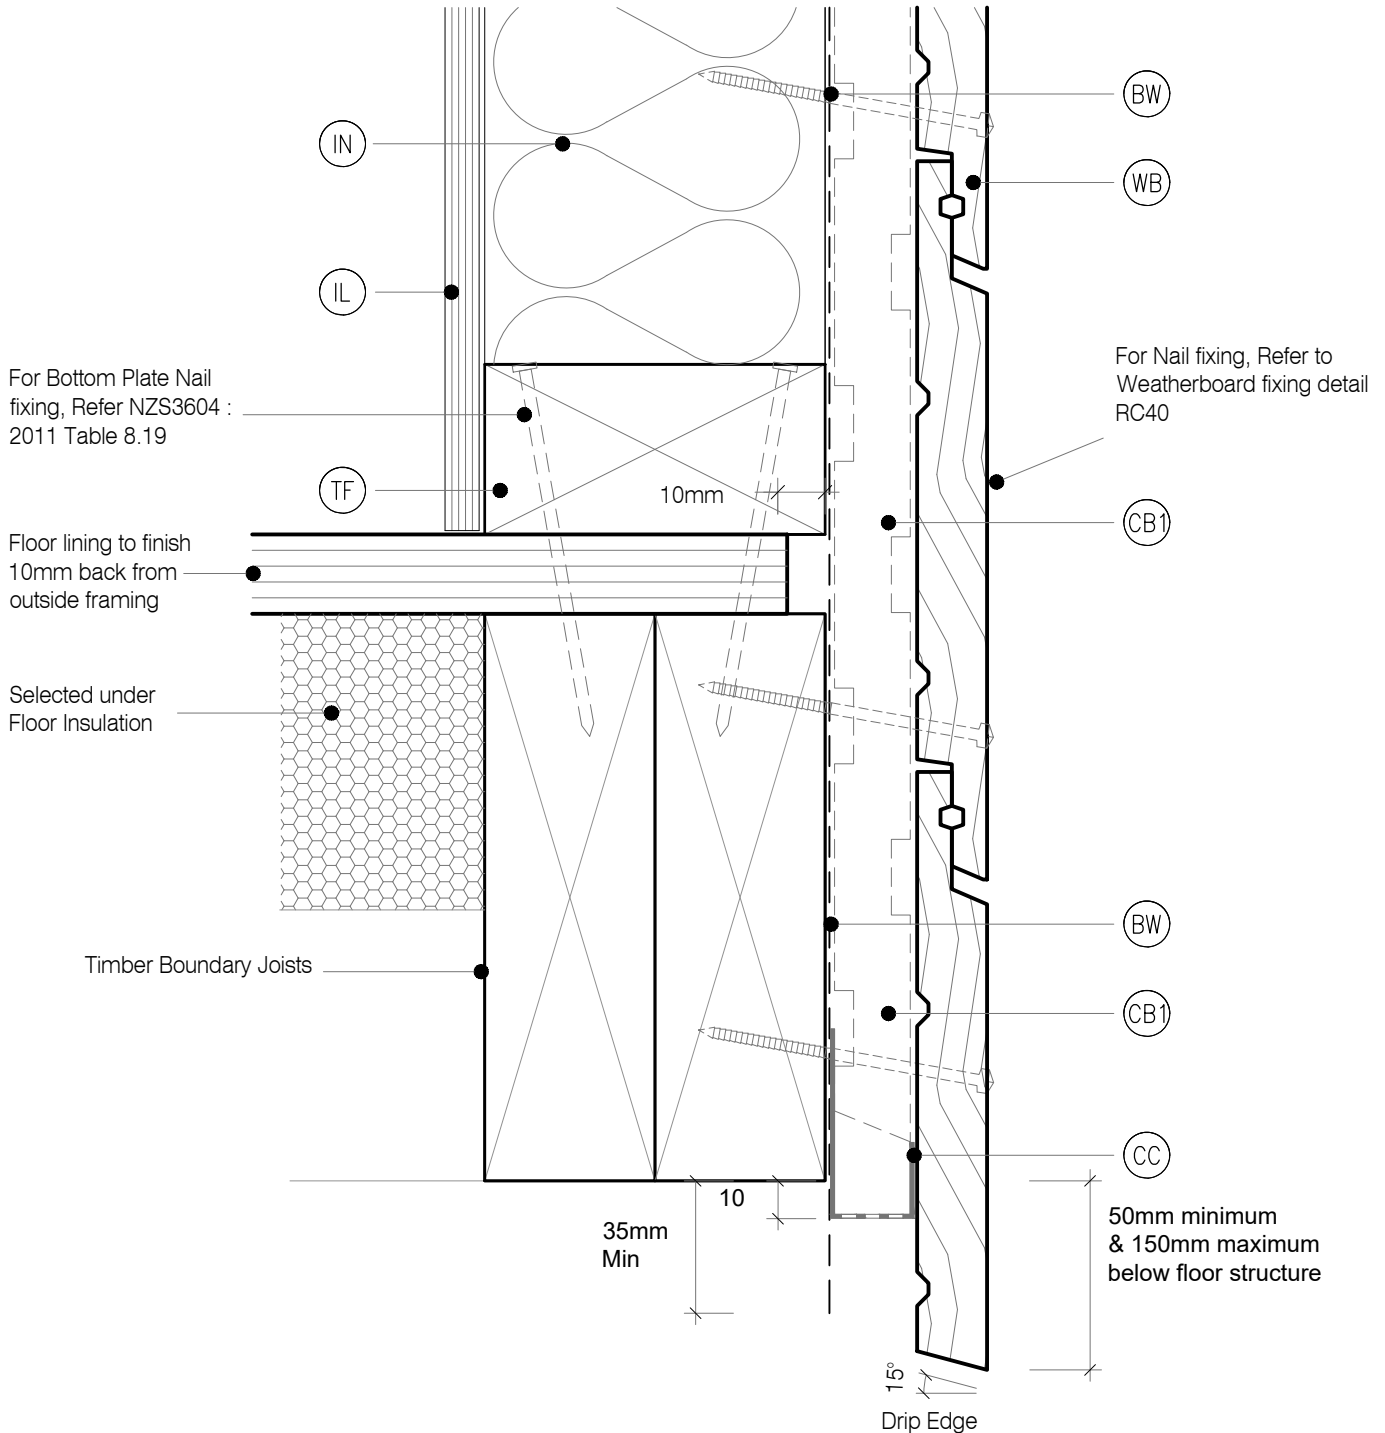

LEGEND :

BF

BACK FLASHING: Minimum 100mm Polypropylene or PVC rear flashing to provide 50mm cover past the scarf joint on each side

BW

BUILDING WRAP: Flexible Wall Underlay, as per NZBC E2/AS1 - Table 23. In extra high wind zones, Rigid Underlay required (9.1.7.2 E2/AS1)

CC

CAVITY CLOSURE: Cavity closure strip, positioned to give a 15mm minimum drip edge to cladding

FT4

FLEXIBLE FLASHING TAPE: Flexible flashing tape lapped into corner, Refer NZBC E2/AS1 4.3.11
Flashing tape is recommended due to movement that may occur in corners. Not required by E2/AS1

IL

INTERNAL LINING: Selected Internal Lining

IN


INSULATION: Selected Insulation

TF

TIMBER FRAME: H1.2 min treated timber framing

WB

WEATHERBOARD: Selected JSC Rusticated Weatherboard

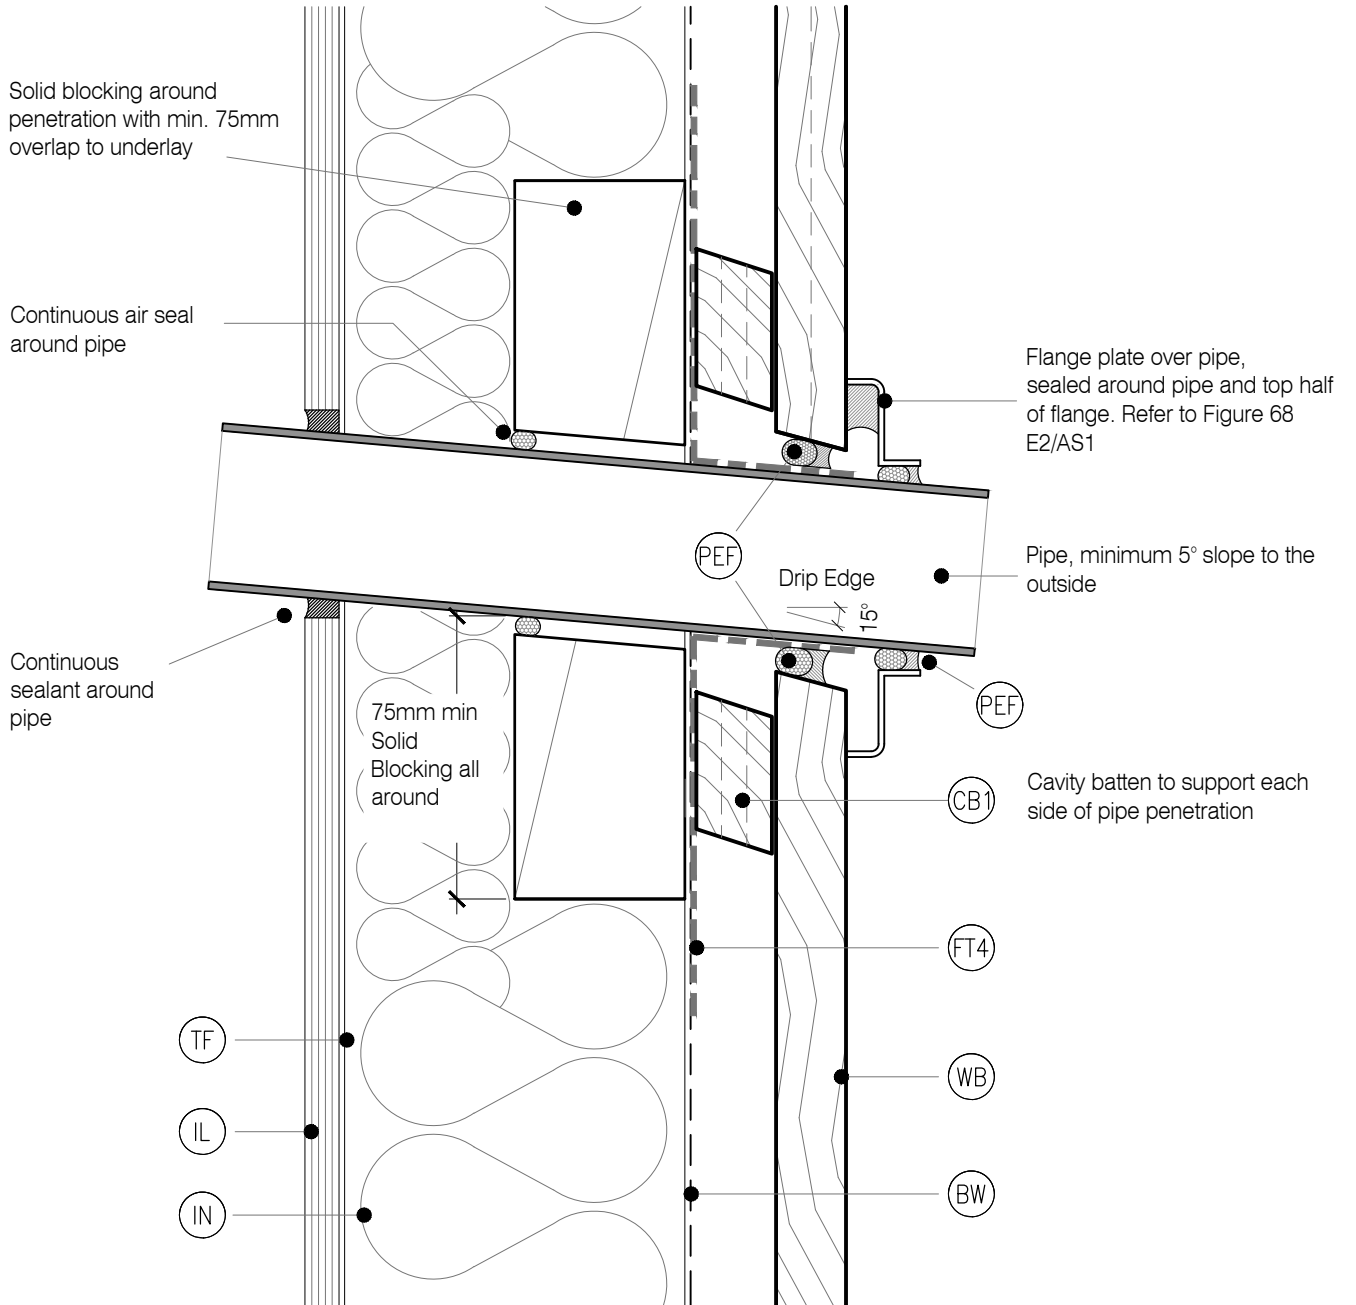

LEGEND :



BACK FLASHING: Minimum 100mm Polypropylene or PVC rear flashing to provide 50mm cover past the scarf joint on each side



BUILDING WRAP: Flexible Wall Underlay, as per NZBC E2/AS1 - Table 23. In extra high wind zones, Rigid Underlay required (9.1.7.2 E2/AS1)



CAVITY CLOSURE: Cavity closure strip, positioned to give a 15mm minimum drip edge to cladding



FLEXIBLE FLASHING TAPE: Flexible flashing tape lapped into corner, Refer NZBC E2/AS1 4.3.11
Flashing tape is recommended due to movement that may occur in corners. Not required by E2/AS1



INTERNAL LINING: Selected Internal Lining




INSULATION: Selected Insulation



TIMBER FRAME: H1.2 min treated timber framing




WEATHERBOARD: Selected JSC Rusticated Weatherboard

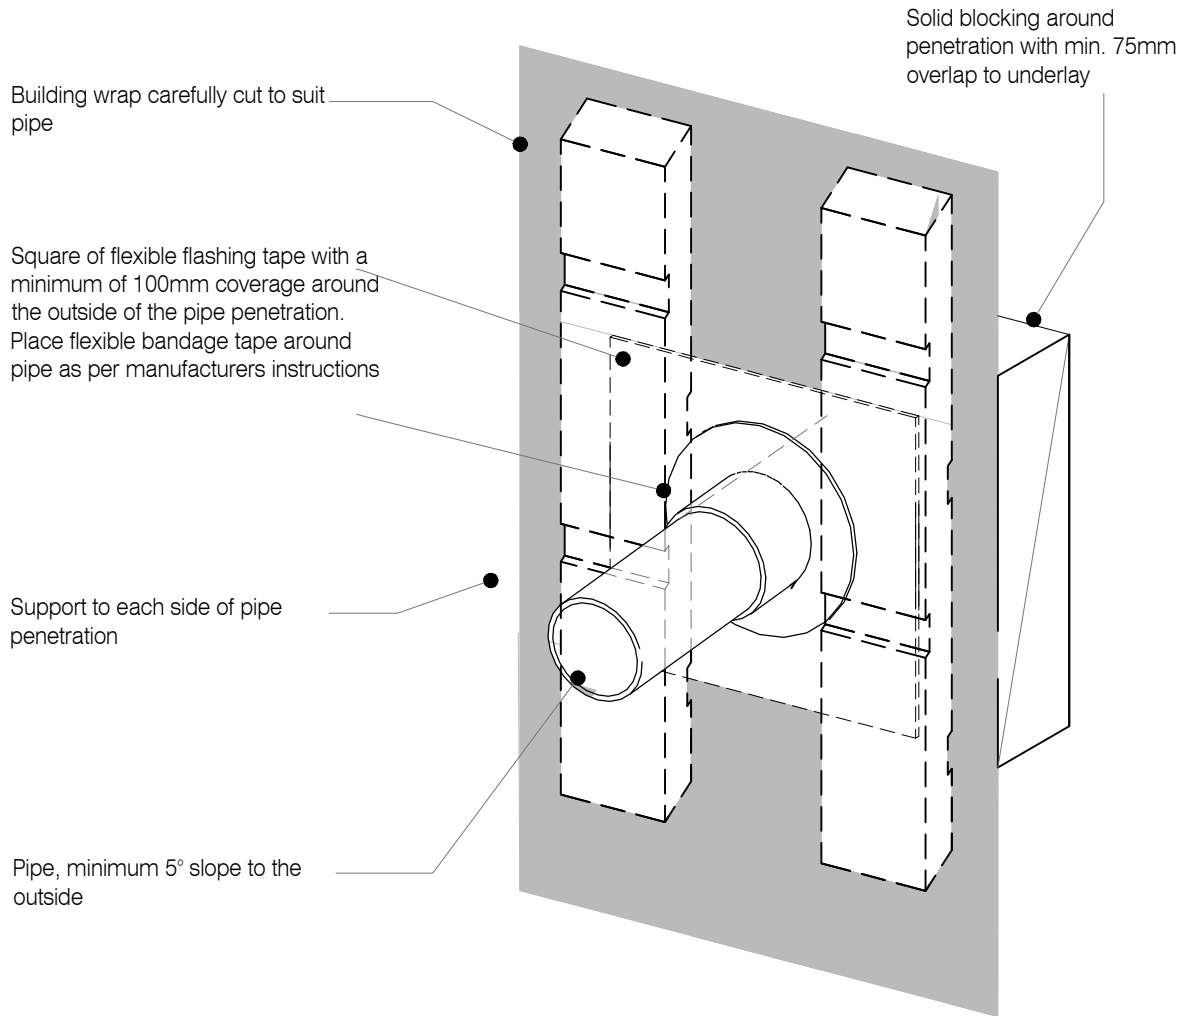


LEGEND :

<p>(BW) BUILDING WRAP: Flexible Wall Underlay, As per NZBC E2/AS1 - Table 23, In extra high wind zones, Rigid Underlay required (9.1.7.2 E2/AS1)</p> <p>(CB1) CAVITY BATTEN - NON STRUCTURAL : Vertically installed JSC-U 45mm x 20mm Radiata Pine H3.2 treated, both face castellated and 18° bevelled edges. Site machined to allow for flashing.</p> <p>(FT3) FLEXIBLE FLASHING TAPE: Flexible flashing tape lapped into corner, Refer NZBC E2/AS1 4.3.11 Flashing tape is recommended due to movement that may occur in corners. Not required by E2/AS1</p>	<p>(CF) CORNER FLASHING: Aluminium, PVC or Stainless Steel corner flashing. Refer NZBC E2/AS1 Section 4.3 "Acceptable flashing materials" Minimum Flashing Size (mm) as per NZBC E2/AS1 Section 4.5.1:</p> <table border="0"> <tr> <td>FLASHING TYPE</td> <td>L, M, H & VH Wind Zones</td> <td>EH Wind Zones</td> </tr> <tr> <td>Hemmed</td> <td>50x50</td> <td>75x75</td> </tr> <tr> <td>Unhemmed</td> <td>75x75</td> <td>100x100</td> </tr> </table> <p>(WB) WEATHERBOARD: Selected JSC Rusticated Weatherboard</p>	FLASHING TYPE	L, M, H & VH Wind Zones	EH Wind Zones	Hemmed	50x50	75x75	Unhemmed	75x75	100x100	<p>(IL) INTERNAL LINING: Selected Internal Lining</p> <p>(IN) INSULATION: Selected Insulation</p> <p>(TF) TIMBER FRAME: H1.2 min treated timber framing</p>
FLASHING TYPE	L, M, H & VH Wind Zones	EH Wind Zones									
Hemmed	50x50	75x75									
Unhemmed	75x75	100x100									

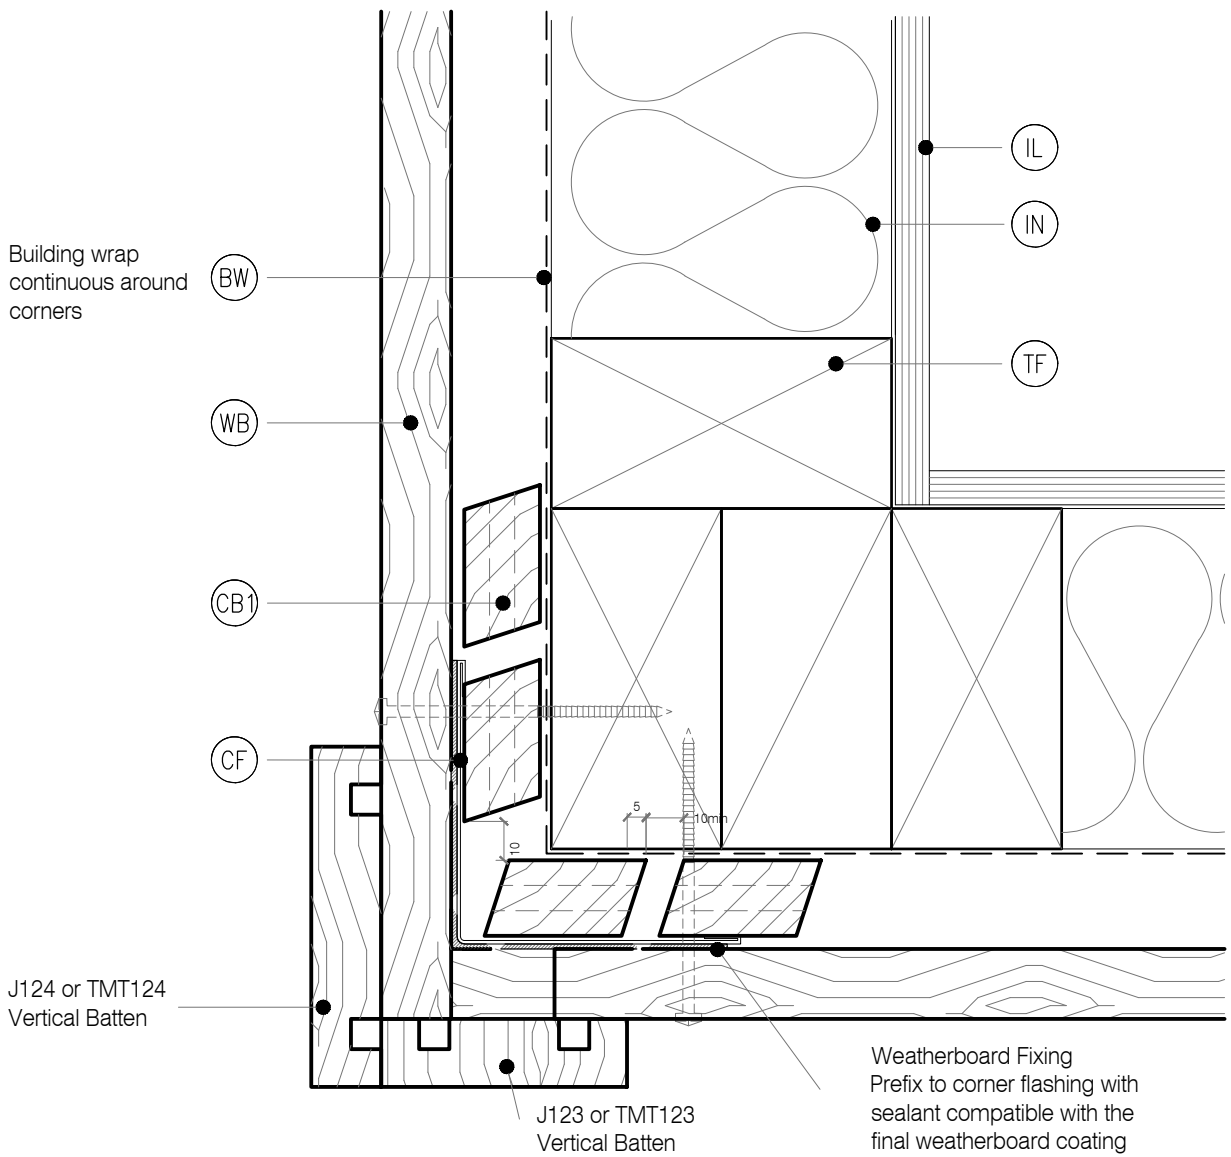


LEGEND :

- | | | | | | | | | | | | |
|--|---|---------------|-------------------------|---------------|--------|-------|-------|----------|-------|---------|--|
| <p>(BW) BUILDING WRAP: Flexible Wall Underlay, As per NZBC E2/AS1 - Table 23, In extra high wind zones, Rigid Underlay required (9.1.7.2 E2/AS1)</p> <p>(CB1) CAVITY BATTEN - NON STRUCTURAL : Vertically installed JSC-U 45mm x 20mm Radiata Pine H3.2 treated, both face castellated and 18° bevelled edges. Site machined to allow for flashing.</p> <p>(FT3) FLEXIBLE FLASHING TAPE: Flexible flashing tape lapped into corner, Refer NZBC E2/AS1 4.3.11 Flashing tape is recommended due to movement that may occur in corners. Not required by E2/AS1</p> | <p>(CF) CORNER FLASHING: Aluminium, PVC or Stainless Steel corner flashing. Refer NZBC E2/AS1 Section 4.3 "Acceptable flashing materials" Minimum Flashing Size (mm) as per NZBC E2/AS1 Section 4.5.1:</p> <table border="0"> <tr> <td>FLASHING TYPE</td> <td>L, M, H & VH Wind Zones</td> <td>EH Wind Zones</td> </tr> <tr> <td>Hemmed</td> <td>50X50</td> <td>75X75</td> </tr> <tr> <td>Unhemmed</td> <td>75X75</td> <td>100X100</td> </tr> </table> <p>(WB) WEATHERBOARD: Selected JSC Rusticated Weatherboard</p> | FLASHING TYPE | L, M, H & VH Wind Zones | EH Wind Zones | Hemmed | 50X50 | 75X75 | Unhemmed | 75X75 | 100X100 | <p>(IL) INTERNAL LINING: Selected Internal Lining</p> <p>(IN) INSULATION: Selected Insulation</p> <p>(TF) TIMBER FRAME: H1.2 min treated timber framing</p> |
| FLASHING TYPE | L, M, H & VH Wind Zones | EH Wind Zones | | | | | | | | | |
| Hemmed | 50X50 | 75X75 | | | | | | | | | |
| Unhemmed | 75X75 | 100X100 | | | | | | | | | |

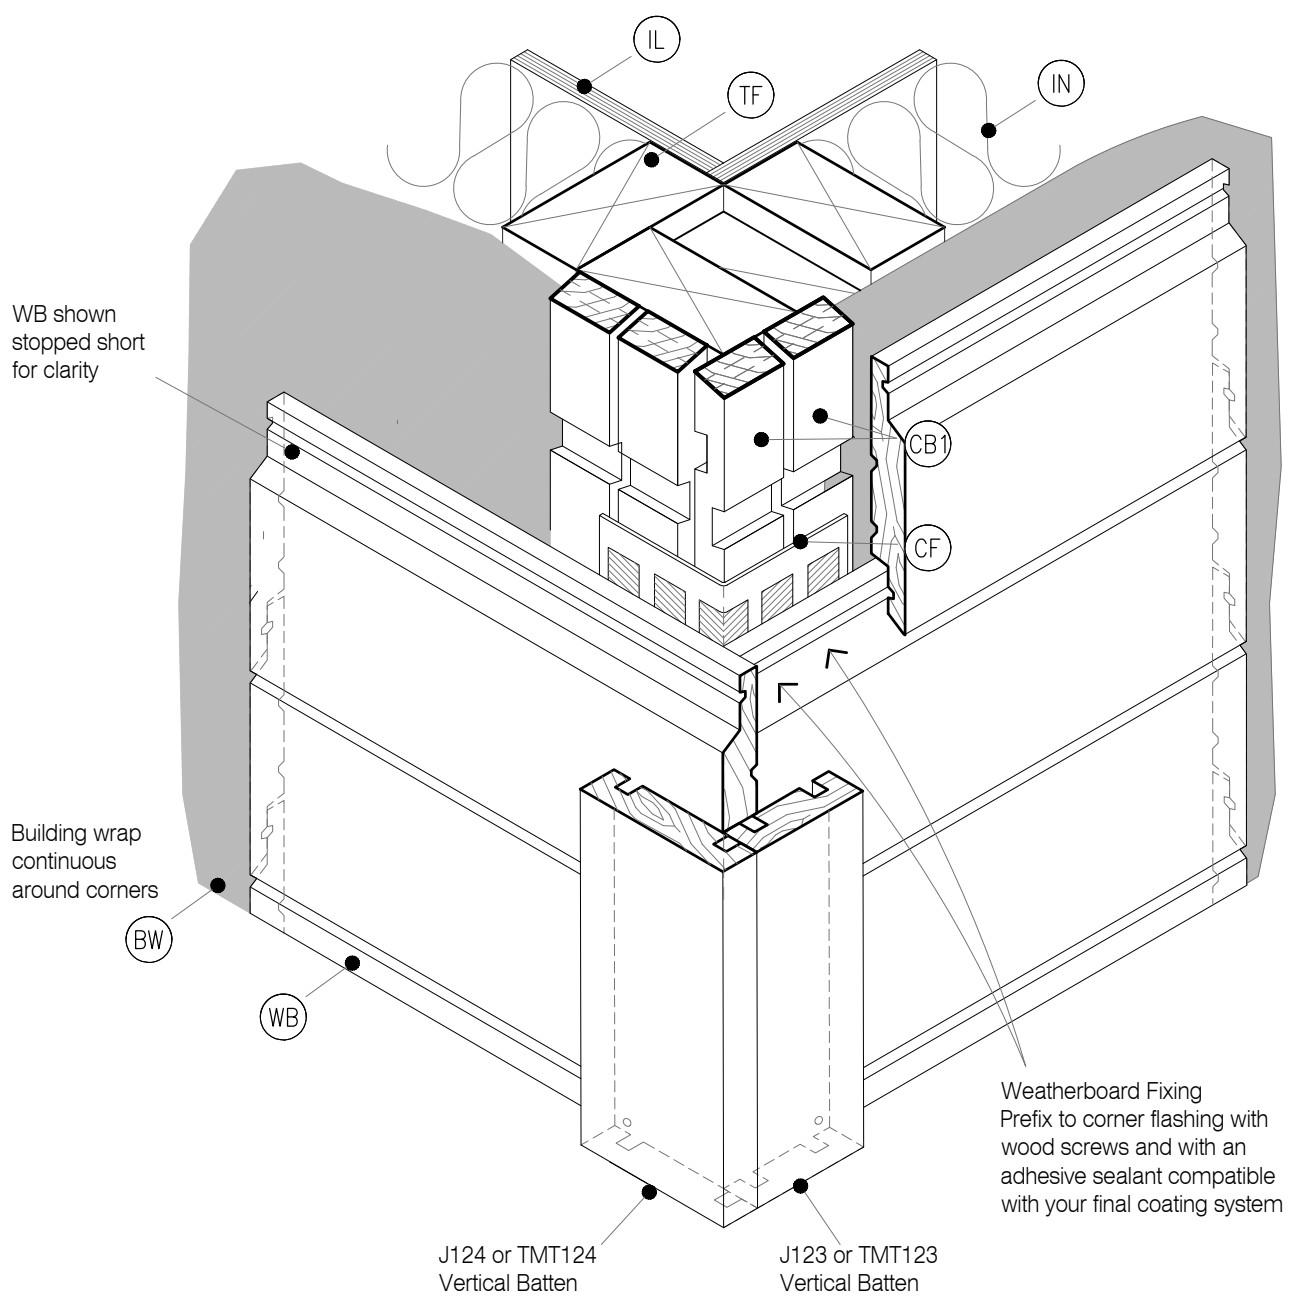

LEGEND :

<p>(BW) BUILDING WRAP: Flexible Wall Underlay, As per NZBC E2/AS1 - Table 23, In extra high wind zones, Rigid Underlay required (9.1.7.2 E2/AS1)</p> <p>(CB1) CAVITY BATTEN - NON STRUCTURAL : Vertically installed JSC-U 45mm x 20mm Radiata Pine H3.2 treated, both face castellated and 18° bevelled edges. Site machined to allow for flashing.</p> <p>(FT3) FLEXIBLE FLASHING TAPE: Flexible flashing tape lapped into corner, Refer NZBC E2/AS1 4.3.11 Flashing tape is recommended due to movement that may occur in corners. Not required by E2/AS1</p>	<p>(CF) CORNER FLASHING: Aluminium, PVC or Stainless Steel corner flashing. Refer NZBC E2/AS1 Section 4.3 "Acceptable flashing materials" Minimum Flashing Size (mm) as per NZBC E2/AS1 Section 4.5.1:</p> <table border="0"> <tr> <td>FLASHING TYPE</td> <td>L, M, H & VH Wind Zones</td> <td>EH Wind Zones</td> </tr> <tr> <td>Hemmed</td> <td>50X50</td> <td>75X75</td> </tr> <tr> <td>Unhemmed</td> <td>75x75</td> <td>100x100</td> </tr> </table> <p>(WB) WEATHERBOARD: Selected JSC Rusticated Weatherboard</p>	FLASHING TYPE	L, M, H & VH Wind Zones	EH Wind Zones	Hemmed	50X50	75X75	Unhemmed	75x75	100x100	<p>(IL) INTERNAL LINING: Selected Internal Lining</p> <p>(IN) INSULATION: Selected Insulation</p> <p>(TF) TIMBER FRAME: H1.2 min treated timber framing</p>
FLASHING TYPE	L, M, H & VH Wind Zones	EH Wind Zones									
Hemmed	50X50	75X75									
Unhemmed	75x75	100x100									

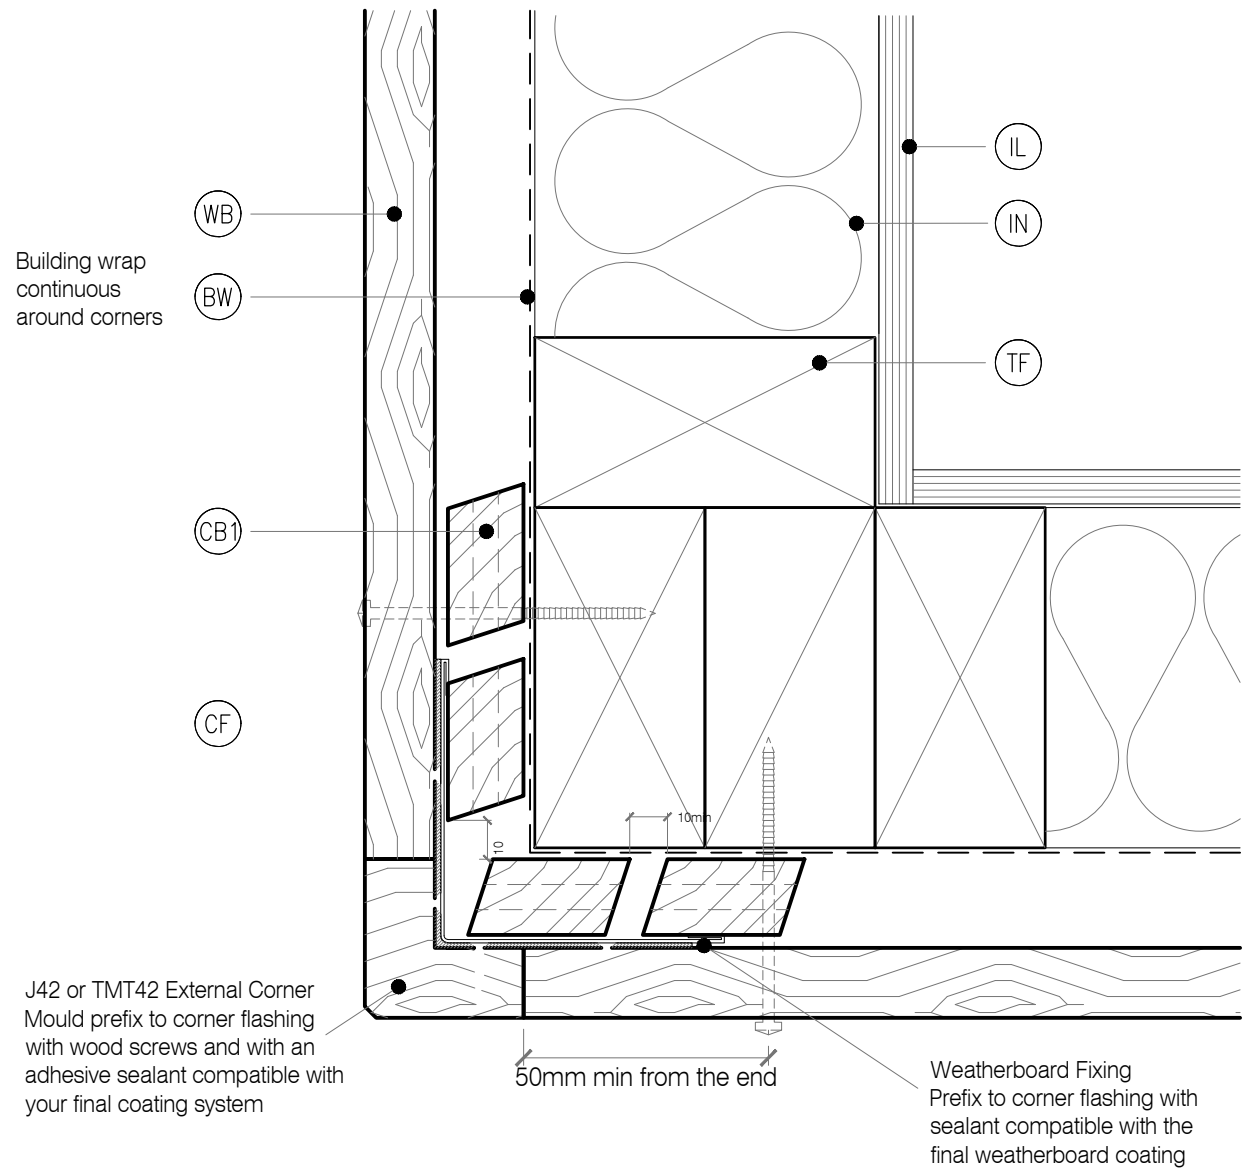


DETAIL NOTES :

1. For VH and EH wind zones a solid batten (non-castellated) is required down one significant side of the external corner to


LEGEND :

- | | | | | | | | | | | | |
|--|---|---------------|-------------------------|---------------|--------|-------|-------|----------|-------|---------|--|
| <p>(BW) BUILDING WRAP: Flexible Wall Underlay, As per NZBC E2/AS1 - Table 23, In extra high wind zones, Rigid Underlay required (9.1.7.2 E2/AS1)</p> <p>(CB1) CAVITY BATTEN - NON STRUCTURAL : Vertically installed JSC-U 45mm x 20mm Radiata Pine H3.2 treated, both face castellated and 18° bevelled edges. Site machined to allow for flashing.</p> <p>(FT3) FLEXIBLE FLASHING TAPE: Flexible flashing tape lapped into corner, Refer NZBC E2/AS1 4.3.11 Flashing tape is recommended due to movement that may occur in corners. Not required by E2/AS1</p> | <p>(CF) CORNER FLASHING: Aluminium, PVC or Stainless Steel corner flashing. Refer NZBC E2/AS1 Section 4.3 "Acceptable flashing materials" Minimum Flashing Size (mm) as per NZBC E2/AS1 Section 4.5.1:</p> <table border="0"> <tr> <td>FLASHING TYPE</td> <td>L, M, H & VH Wind Zones</td> <td>EH Wind Zones</td> </tr> <tr> <td>Hemmed</td> <td>50X50</td> <td>75X75</td> </tr> <tr> <td>Unhemmed</td> <td>75x75</td> <td>100x100</td> </tr> </table> <p>(WB) WEATHERBOARD: Selected JSC Rusticated Weatherboard</p> | FLASHING TYPE | L, M, H & VH Wind Zones | EH Wind Zones | Hemmed | 50X50 | 75X75 | Unhemmed | 75x75 | 100x100 | <p>(IL) INTERNAL LINING: Selected Internal Lining</p> <p>(IN) INSULATION: Selected Insulation</p> <p>(TF) TIMBER FRAME: H1.2 min treated timber framing</p> |
| FLASHING TYPE | L, M, H & VH Wind Zones | EH Wind Zones | | | | | | | | | |
| Hemmed | 50X50 | 75X75 | | | | | | | | | |
| Unhemmed | 75x75 | 100x100 | | | | | | | | | |

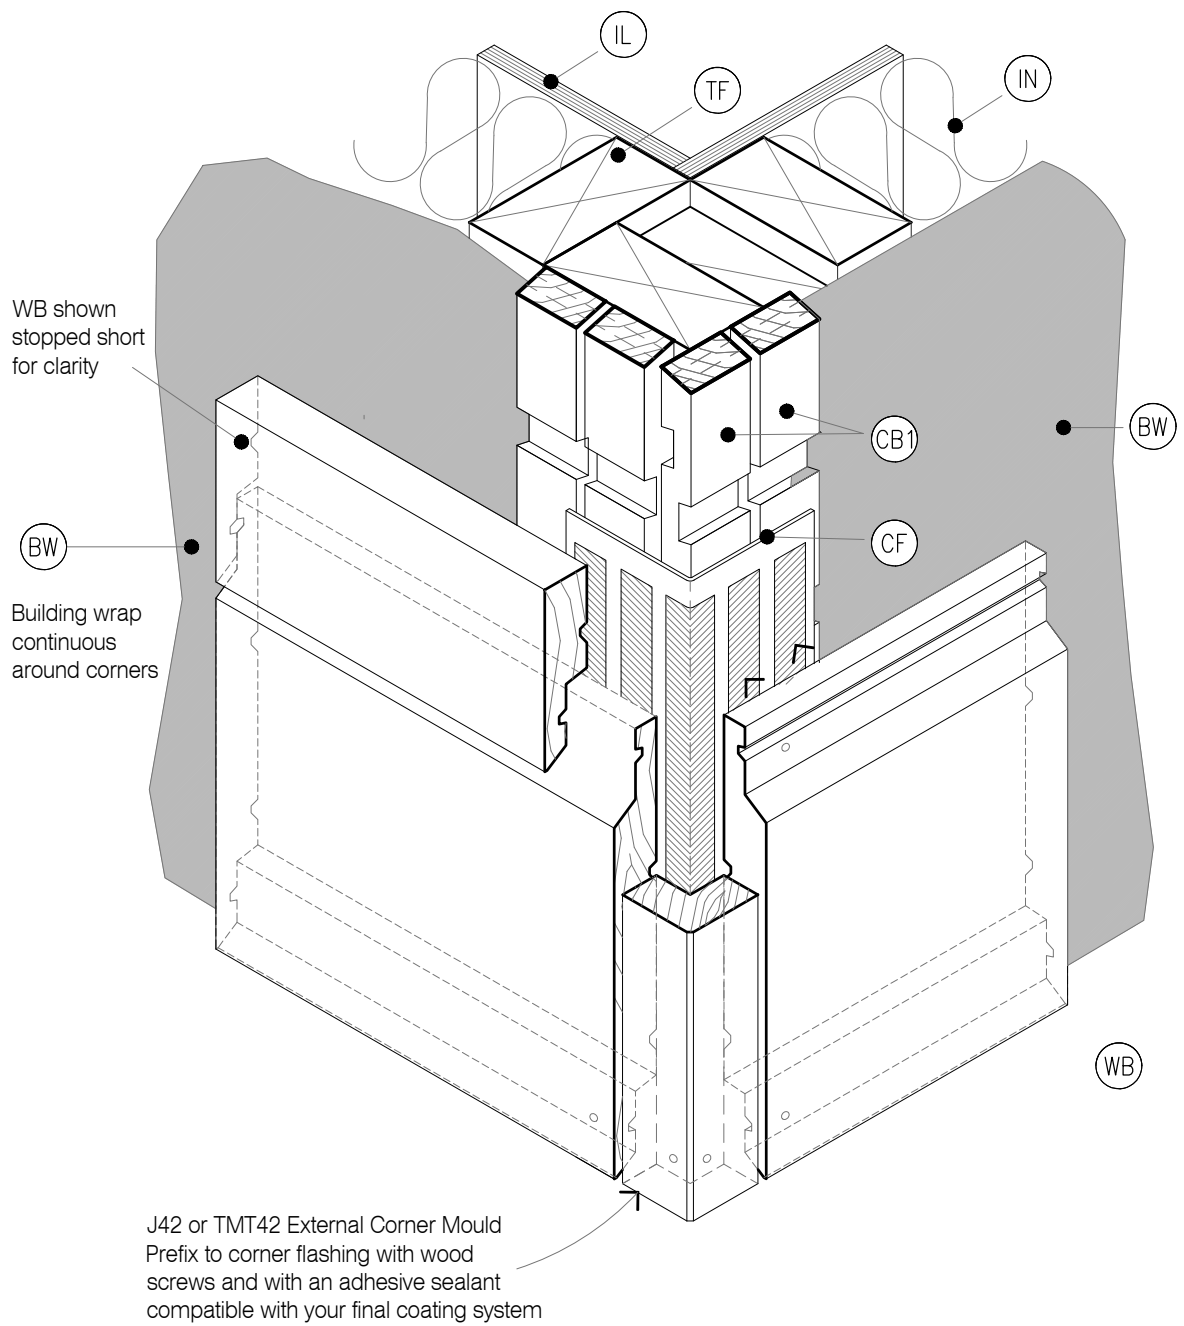

LEGEND :

<p>(BW) BUILDING WRAP: Flexible Wall Underlay, As per NZBC E2/AS1 - Table 23, In extra high wind zones, Rigid Underlay required (9.1.7.2 E2/AS1)</p> <p>(CB1) CAVITY BATTEN - NON STRUCTURAL : Horizontally installed JSC-U 45mm x 20mm Radiata Pine H3.2 treated, both face castellated and 18° bevelled edges.</p> <p>(CC) CAVITY CLOSURE: Cavity closure strip, positioned to give a 15mm Min drip edge to cladding</p> <p>(CF) CAP FLASHING: Continuous parapet flashing. Materials as per E2/AS1 4.3 + Figure 9 & Table 7</p>	<p>(FT) FLASHING TAPE: As per E2/AS1 4.3.11</p> <p>(IL) INTERNAL LINING: Selected Internal Lining</p> <p>(IN) INSULATION: Selected Insulation</p> <p>(PSF) PARAPET SADDLE FLASHING: Materials as per E2/AS1 4.0, refer E2/AS1 Figure 11 & 12 . Typically 0.45mm Min 316 Stainless Steel. Refer Table 20 & Table 21 for Comparability of Materials in Contact</p>	<p>(PB) PLYWOOD BACKING: 17mm CCA treated H3.2 grade plywood substrate</p> <p>(RM) ROOFING MEMBRANE: Selected System on 17mm CCA treated H3.2 grade plywood glued and screwed to Rafters. Roof Membrane requires 400mm solid block support each way & solid support to all sheet edges</p> <p>(TF) TIMBER FRAME: H1.2 min treated timber framing</p> <p>(WB) WEATHERBOARD: Selected JSC Rusticated Weatherboard</p>
--	--	---

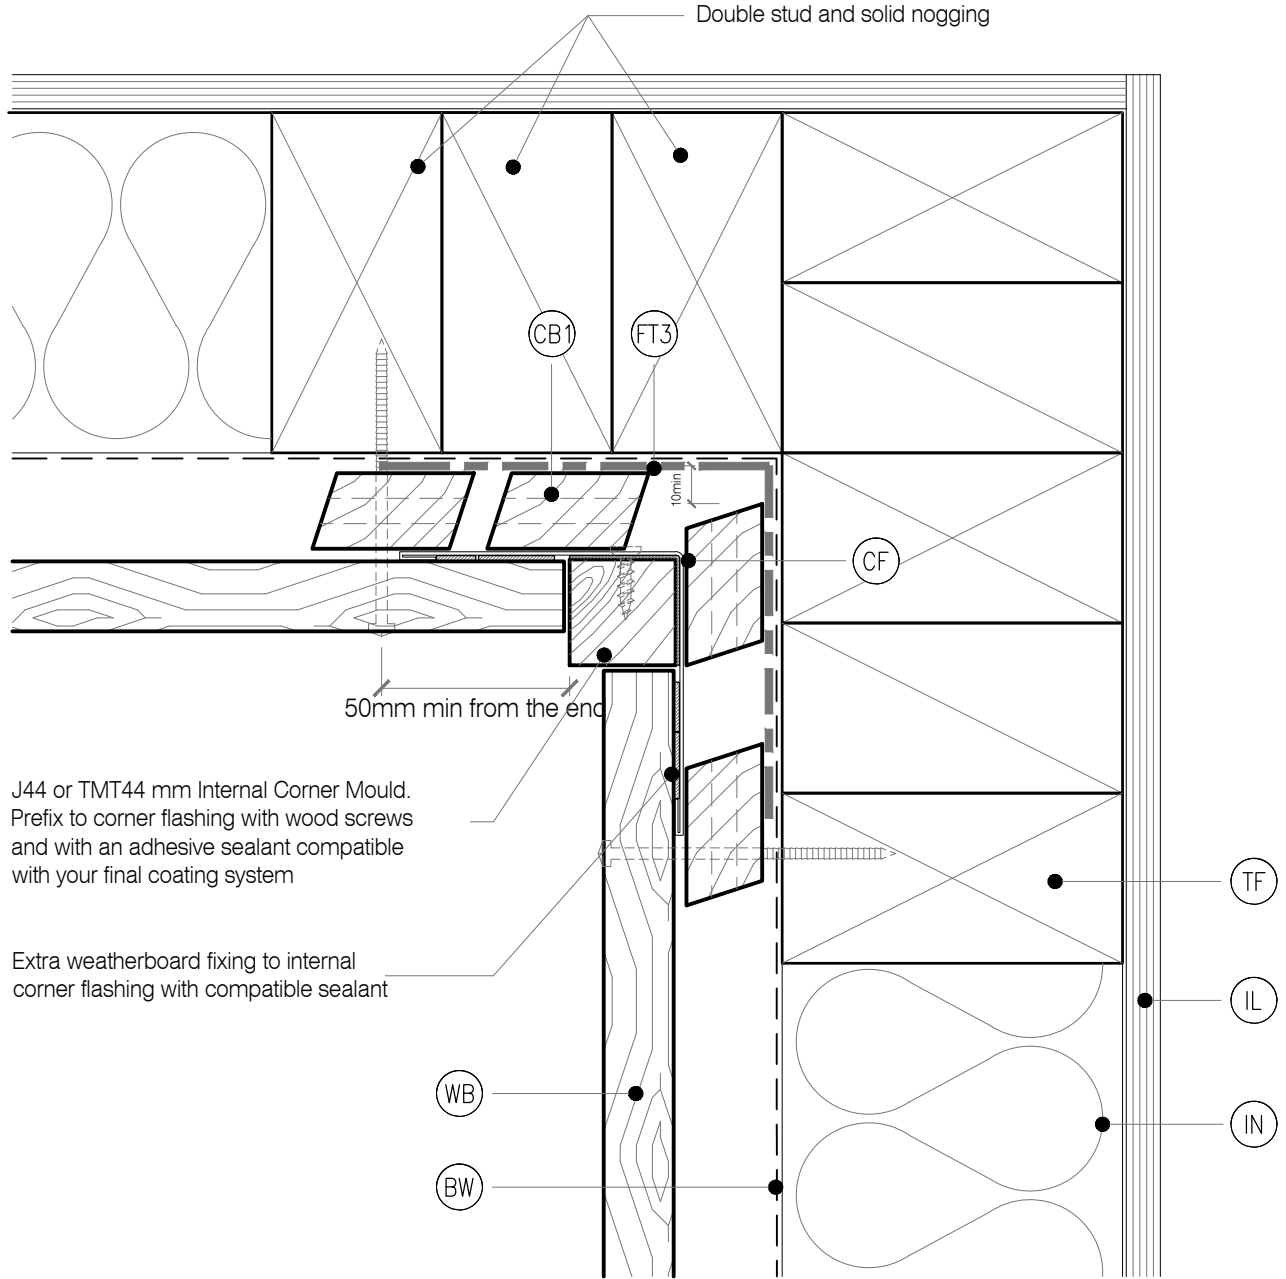


DETAIL NOTES :

1. Flashing tape is recommended due to movement that may occur in corners but it is not required by E2/AS1
2. Aluminium extrusion must not be continuous over solid floor joists.

LEGEND :

- | | | |
|--|--|---|
| <p>(BW) BUILDING WRAP: Flexible Wall Underlay, As per NZBC E2/AS1 - Table 23, In extra high wind zones, Rigid Underlay required (9.1.7.2 E2/AS1)</p> <p>(CB1) CAVITY BATTEN - NON STRUCTURAL : Horizontally installed JSC-U 45mm x 20mm Radiata Pine H3.2 treated, both face castellated and 18° bevelled edges.</p> <p>(CC) CAVITY CLOSURE: Cavity closure strip, positioned to give a 15mm Min drip edge to cladding</p> <p>(CF) CAP FLASHING: Continuous parapet flashing, Materials as per E2/AS1 4.3 + Figure 9 & Table 7</p> | <p>(FT) FLASHING TAPE: As per E2/AS1 4.3.11</p> <p>(IL) INTERNAL LINING: Selected Internal Lining</p> <p>(IN) INSULATION: Selected Insulation</p> <p>(PSF) PARAPET SADDLE FLASHING: Materials as per E2/AS1 4.0, refer E2/AS1 Figure 11 & 12 . Typically 0.45mm Min 316 Stainless Steel. Refer Table 20 & Table 21 for Comparability of Materials in Contact</p> | <p>(PB) PLYWOOD BACKING: 17mm CCA treated H3.2 grade plywood substrate</p> <p>(RM) ROOFING MEMBRANE: Selected System on 17mm CCA treated H3.2 grade plywood glued and screwed to Rafters. Roof Membrane requires 400mm solid block support each way & solid support to all sheet edges</p> <p>(TF) TIMBER FRAME: H1.2 min treated timber framing</p> <p>(WB) WEATHERBOARD: Selected JSC Rusticated Weatherboard</p> |
|--|--|---|

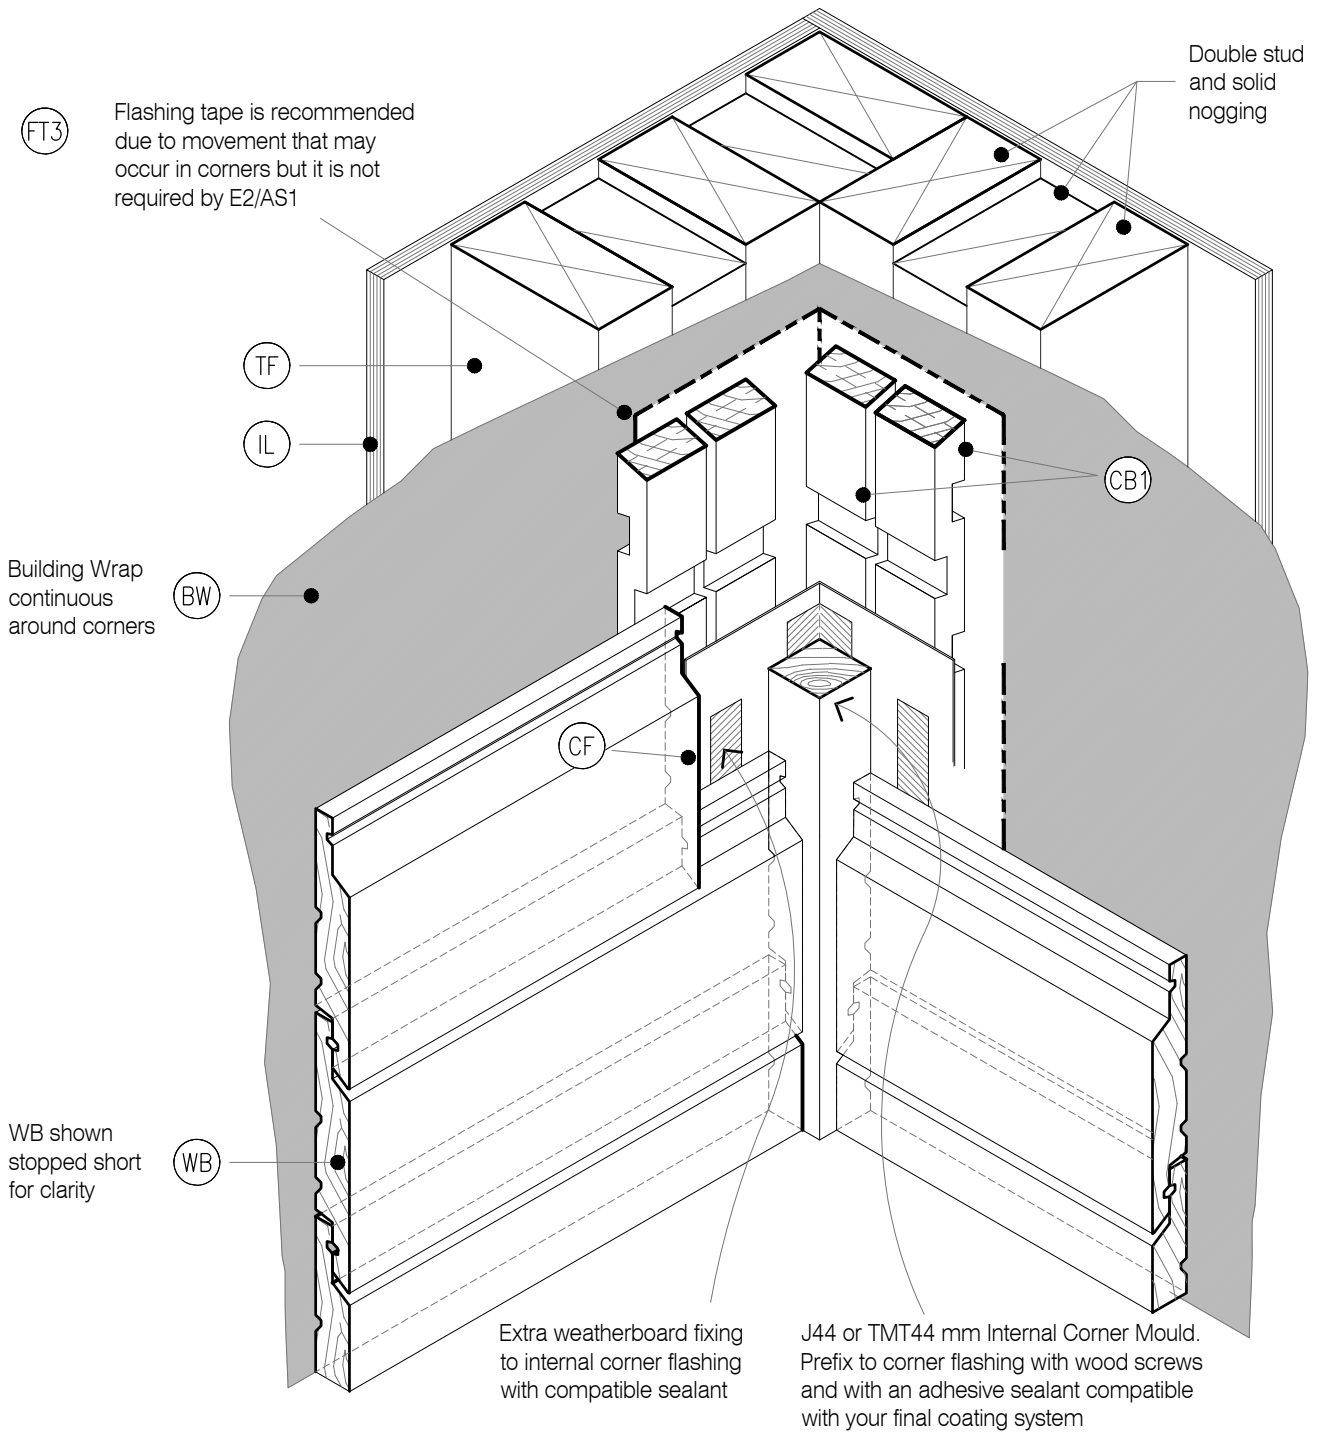

(FT3) Flashing tape is recommended due to movement that may occur in corners but it is not required by E2/AS1

Building Wrap continuous around corners **(BW)**


WB shown stopped short for clarity **(WB)**

Extra weatherboard fixing to internal corner flashing with compatible sealant

J44 or TMT44 mm Internal Corner Mould. Prefix to corner flashing with wood screws and with an adhesive sealant compatible with your final coating system

LEGEND :

- | | | |
|--|--|---|
| <p>(BW) BUILDING WRAP: Flexible Wall Underlay, As per NZBC E2/AS1 - Table 23, In extra high wind zones, Rigid Underlay required (9.1.7.2 E2/AS1)</p> <p>(CB1) CAVITY BATTEN - NON STRUCTURAL : Horizontally installed JSC-U 45mm x 20mm Radiata Pine H3.2 treated, both face castellated and 18° bevelled edges.</p> <p>(CC) CAVITY CLOSURE: Cavity closure strip, positioned to give a 15mm Min drip edge to cladding</p> <p>(CF) CAP FLASHING: Continuous parapet flashing. Materials as per E2/AS1 4.3 + Figure 9 & Table 7</p> | <p>(FT) FLASHING TAPE: As per E2/AS1 4.3.11</p> <p>(IL) INTERNAL LINING: Selected Internal Lining</p> <p>(IN) INSULATION: Selected Insulation</p> <p>(PSF) PARAPET SADDLE FLASHING: Materials as per E2/AS1 4.0, refer E2/AS1 Figure 11 & 12 . Typically 0.45mm Min 316 Stainless Steel. Refer Table 20 & Table 21 for Comparability of Materials in Contact</p> | <p>(PB) PLYWOOD BACKING: 17mm CCA treated H3.2 grade plywood substrate</p> <p>(RM) ROOFING MEMBRANE: Selected System on 17mm CCA treated H3.2 grade plywood glued and screwed to Rafters. Roof Membrane requires 400mm solid block support each way & solid support to all sheet edges</p> <p>(TF) TIMBER FRAME: H1.2 min treated timber framing</p> <p>(WB) WEATHERBOARD: Selected JSC Rusticated Weatherboard</p> |
|--|--|---|

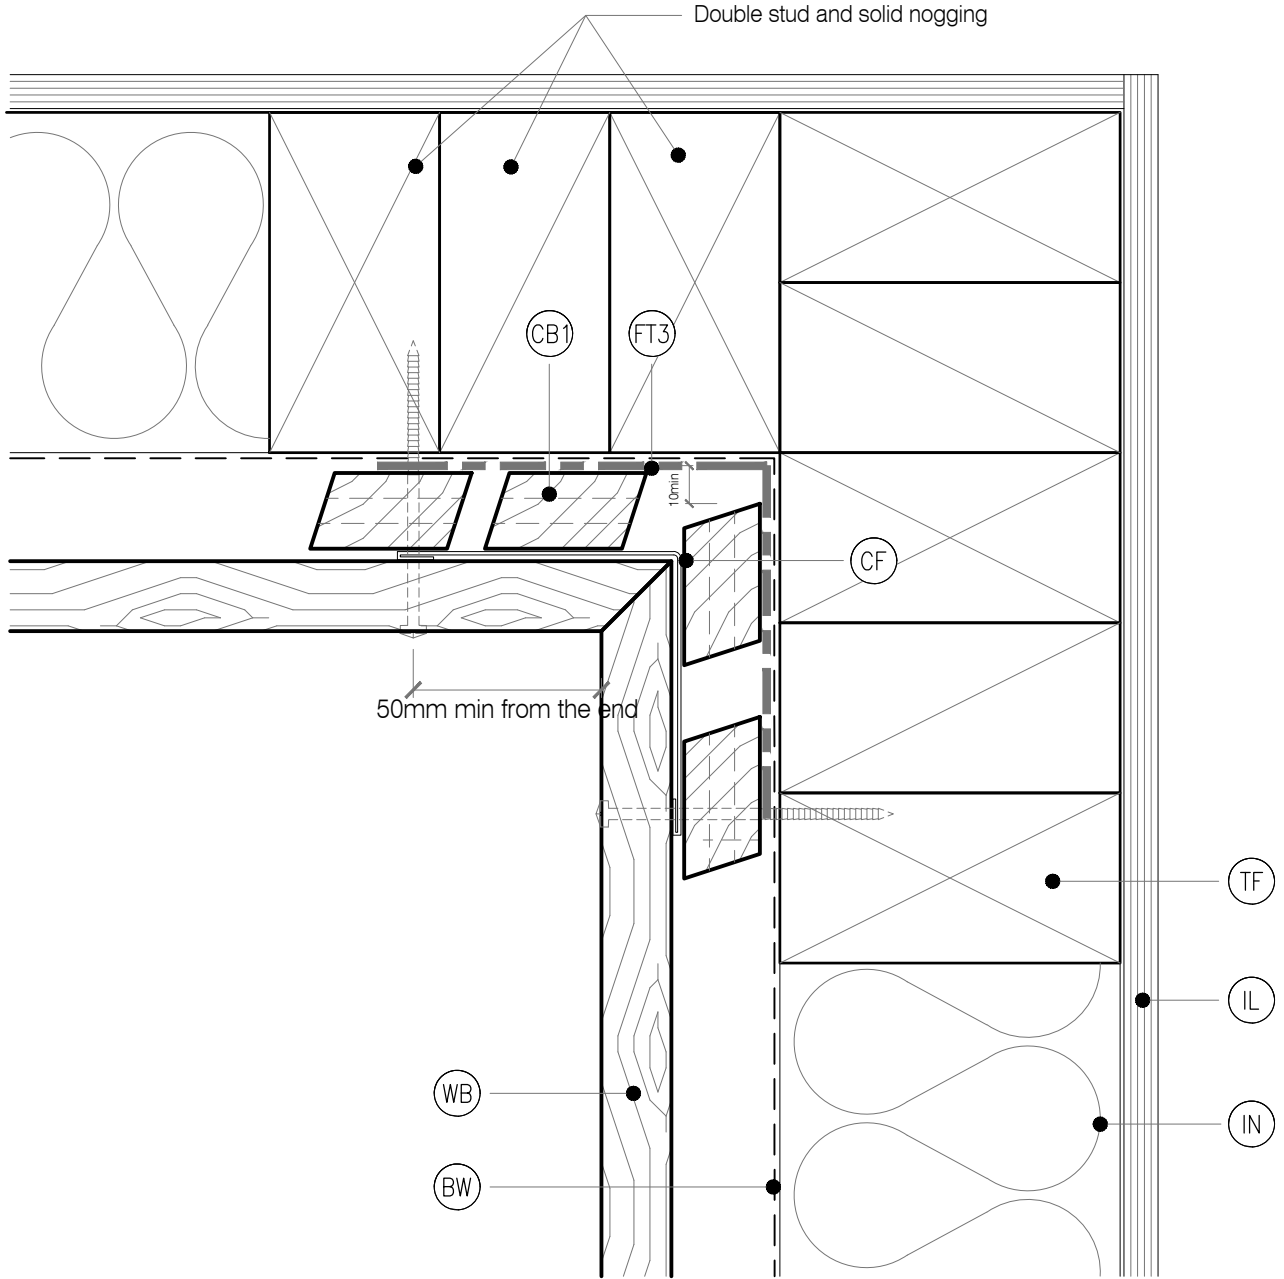


DETAIL NOTES :

- | | |
|---|---|
| <p>1. Flashing tape is recommended due to movement that may occur in corners but it is not required by E2/AS1</p> | <p>2. Aluminium extrusion must not be continuous over solid floor joists.</p> |
|---|---|

LEGEND :

- | | | |
|--|--|---|
| <p>(BW) BUILDING WRAP: Flexible Wall Underlay, As per NZBC E2/AS1 - Table 23, In extra high wind zones, Rigid Underlay required (9.1.7.2 E2/AS1)</p> <p>(CB1) CAVITY BATTEN - NON STRUCTURAL : Horizontally installed JSC-U 45mm x 20mm Radiata Pine H3.2 treated, both face castellated and 18° bevelled edges.</p> <p>(CC) CAVITY CLOSURE: Cavity closure strip, positioned to give a 15mm Min drip edge to cladding</p> <p>(CF) CAP FLASHING: Continuous parapet flashing. Materials as per E2/AS1 4.3 + Figure 9 & Table 7</p> | <p>(FT) FLASHING TAPE: As per E2/AS1 4.3.11</p> <p>(IL) INTERNAL LINING: Selected Internal Lining</p> <p>(IN) INSULATION: Selected Insulation</p> <p>(PSF) PARAPET SADDLE FLASHING: Materials as per E2/AS1 4.0, refer E2/AS1 Figure 11 & 12 . Typically 0.45mm Min 316 Stainless Steel. Refer Table 20 & Table 21 for Comparability of Materials in Contact</p> | <p>(PB) PLYWOOD BACKING: 17mm CCA treated H3.2 grade plywood substrate</p> <p>(RM) ROOFING MEMBRANE: Selected System on 17mm CCA treated H3.2 grade plywood glued and screwed to Rafters. Roof Membrane requires 400mm solid block support each way & solid support to all sheet edges</p> <p>(TF) TIMBER FRAME: H1.2 min treated timber framing</p> <p>(WB) WEATHERBOARD: Selected JSC Rusticated Weatherboard</p> |
|--|--|---|

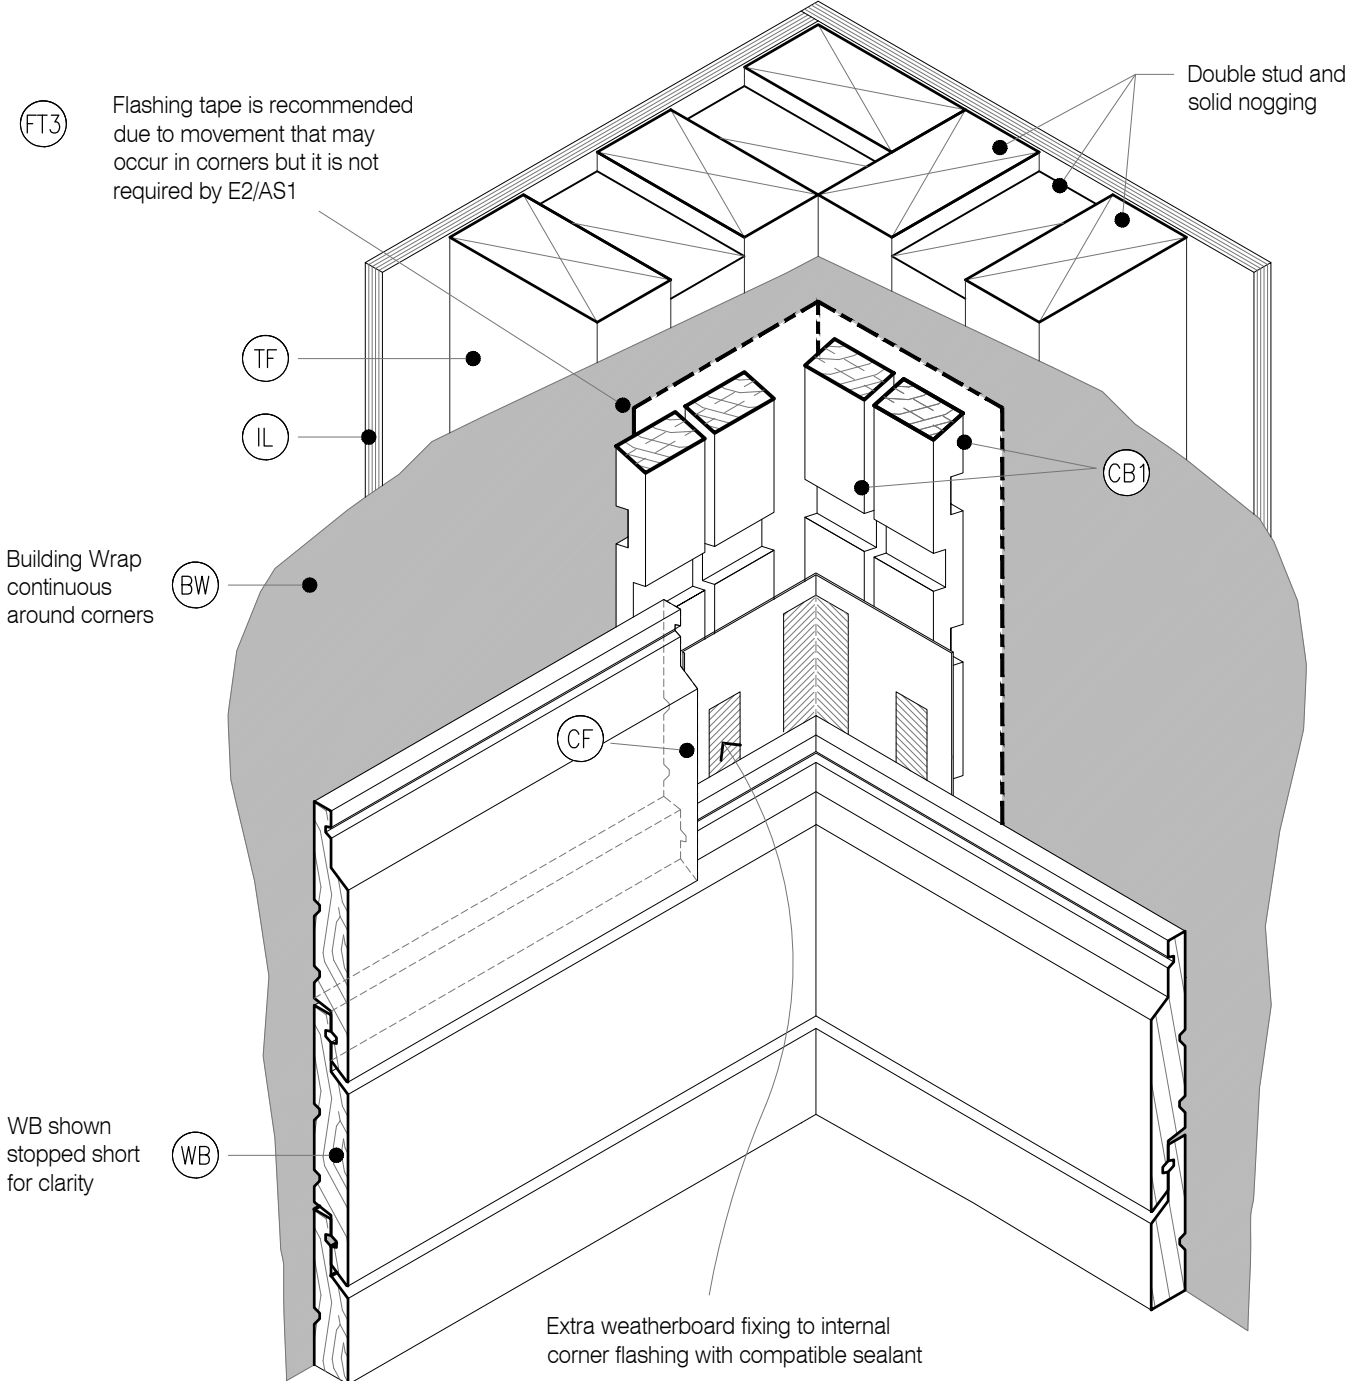


LEGEND :

- (BW)** BUILDING WRAP: Flexible Wall Underlay, As per NZBC E2/AS1 - Table 23, In extra high wind zones, Rigid Underlay required (9.1.7.2 E2/AS1)
- (CB1)** CAVITY BATTEN - NON STRUCTURAL : Horizontally installed JSC-U 45mm x 20mm Radiata Pine H3.2 treated, both face castellated and 18° bevelled edges.
- (CC)** CAVITY CLOSURE: Cavity closure strip, positioned to give a 15mm Min drip edge to cladding
- (CF)** CAP FLASHING: Continuous parapet flashing. Materials as per E2/AS1 4.3 + Figure 9 & Table 7

- (FT)** FLASHING TAPE: As per E2/AS1 4.3.11
- (IL)** INTERNAL LINING: Selected Internal Lining
- (IN)** INSULATION: Selected Insulation
- (PSF)** PARAPET SADDLE FLASHING: Materials as per E2/AS1 4.0, refer E2/AS1 Figure 11 & 12 . Typically 0.45mm Min 316 Stainless Steel. Refer Table 20 & Table 21 for Comparability of Materials in Contact

- (PB)** PLYWOOD BACKING: 17mm CCA treated H3.2 grade plywood substrate
- (RM)** ROOFING MEMBRANE: Selected System on 17mm CCA treated H3.2 grade plywood glued and screwed to Rafters. Roof Membrane requires 400mm solid block support each way & solid support to all sheet edges
- (TF)** TIMBER FRAME: H1.2 min treated timber framing
- (WB)** WEATHERBOARD: Selected JSC Rusticated Weatherboard

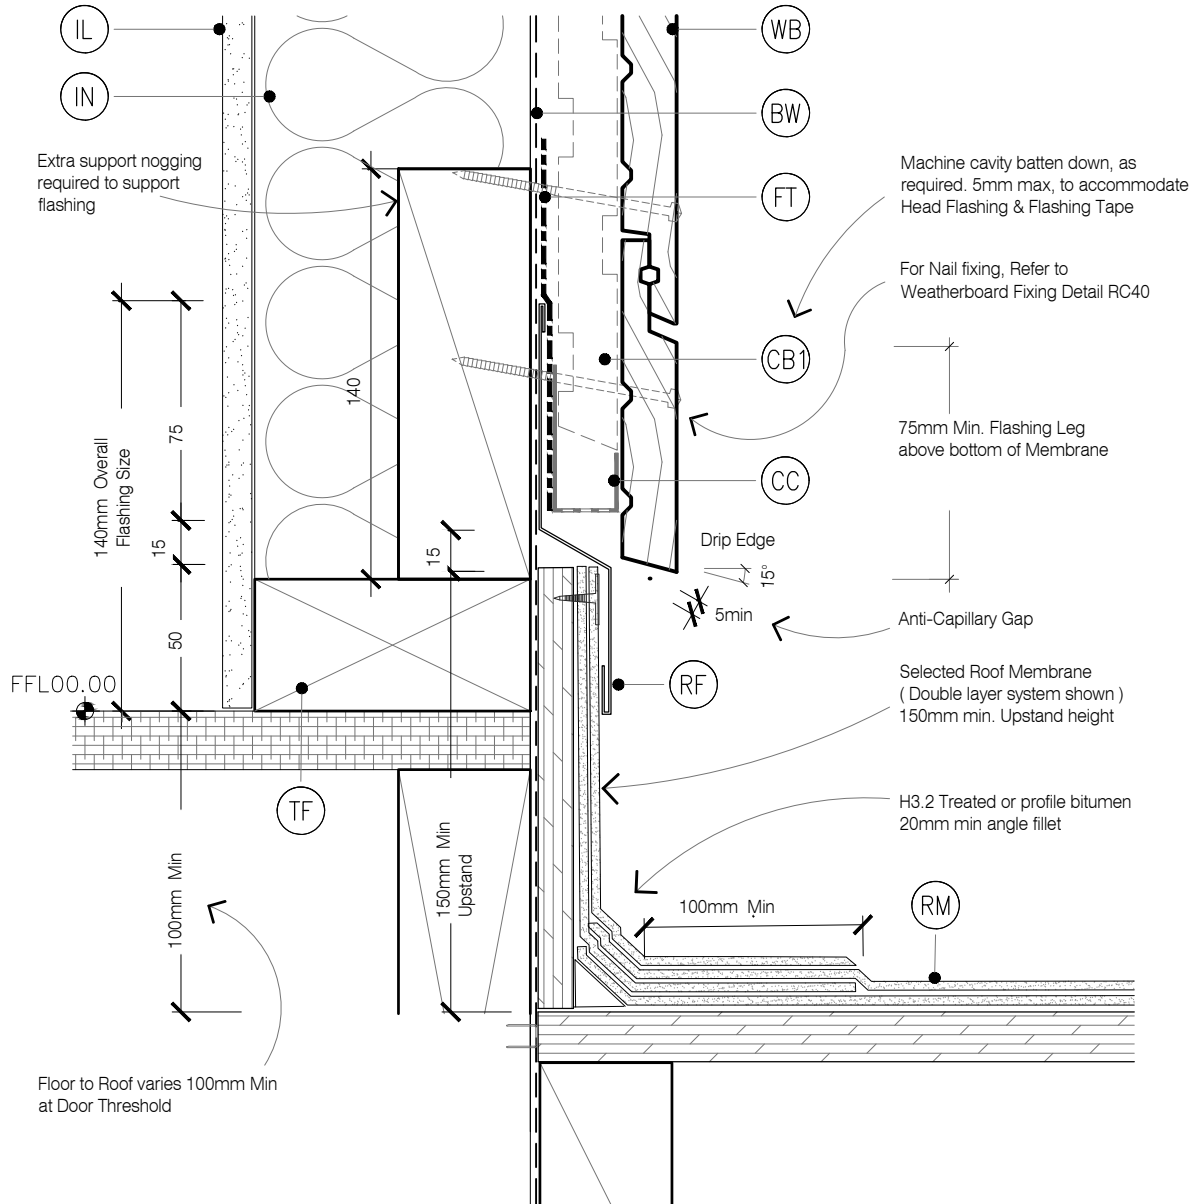


LEGEND :

- (BW)** BUILDING WRAP: Flexible Wall Underlay, As per NZBC E2/AS1 - Table 23, In extra high wind zones, Rigid Underlay required (9.1.7.2 E2/AS1)
- (CB)** CAVITY BATTEN - NON STRUCTURAL : Horizontally installed JSC-U 45mm x 20mm Radiata Pine H3.2 treated, both face castellated and 18° bevelled edges.
- (CC)** CAVITY CLOSURE: Cavity closure strip, positioned to give a 15mm Min drip edge to cladding
- (CF)** CAP FLASHING: Continuous parapet flashing. Materials as per E2/AS1 4.3 + Figure 9 & Table 7

- (FT)** FLASHING TAPE: As per E2/AS1 4.3.11
- (IL)** INTERNAL LINING: Selected Internal Lining
- (IN)** INSULATION: Selected Insulation
- (PSF)** PARAPET SADDLE FLASHING: Materials as per E2/AS1 4.0, refer E2/AS1 Figure 11 & 12 . Typically 0.45mm Min 316 Stainless Steel. Refer Table 20 & Table 21 for Comparability of Materials in Contact

- (PB)** PLYWOOD BACKING: 17mm CCA treated H3.2 grade plywood substrate
- (RM)** ROOFING MEMBRANE: Selected System on 17mm CCA treated H3.2 grade plywood glued and screwed to Rafters. Roof Membrane requires 400mm solid block support each way & solid support to all sheet edges
- (TF)** TIMBER FRAME: H1.2 min treated timber framing
- (WB)** WEATHERBOARD: Selected JSC Rusticated Weatherboard

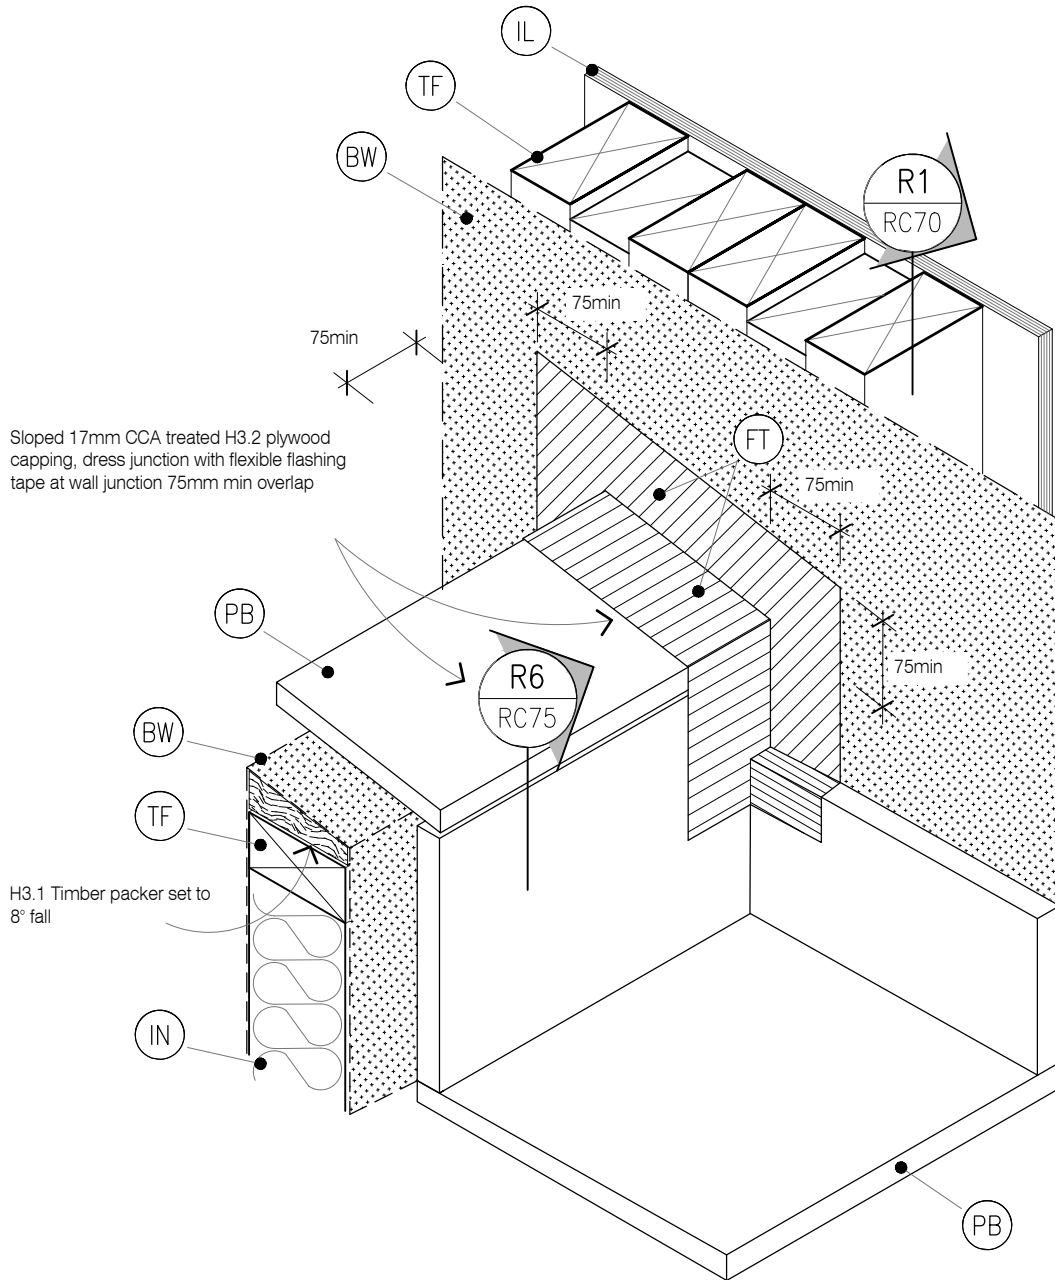


STAGE ONE

LEGEND :

- (BW)** BUILDING WRAP: Flexible Wall Underlay, As per NZBC E2/AS1 - Table 23, In extra high wind zones, Rigid Underlay required (9.1.7.2 E2/AS1)
- (CB1)** CAVITY BATTEN - NON STRUCTURAL : Horizontally installed JSC-U 45mm x 20mm Radiata Pine H3.2 treated, both face castellated and 18° bevelled edges.
- (CC)** CAVITY CLOSURE: Cavity closure strip, positioned to give a 15mm Min drip edge to cladding
- (CF)** CAP FLASHING: Continuous parapet flashing. Materials as per E2/AS1 4.3 + Figure 9 & Table 7

- (FT)** FLASHING TAPE: As per E2/AS1 4.3.11
- (IL)** INTERNAL LINING: Selected Internal Lining
- (IN)** INSULATION: Selected Insulation
- (PSF)** PARAPET SADDLE FLASHING: Materials as per E2/AS1 4.0, refer E2/AS1 Figure 11 & 12 . Typically 0.45mm Min 316 Stainless Steel. Refer Table 20 & Table 21 for Comparability of Materials in Contact

- (PB)** PLYWOOD BACKING: 17mm CCA treated H3.2 grade plywood substrate
- (RM)** ROOFING MEMBRANE: Selected System on 17mm CCA treated H3.2 grade plywood glued and screwed to Rafters. Roof Membrane requires 400mm solid block support each way & solid support to all sheet edges
- (TF)** TIMBER FRAME: H1.2 min treated timber framing
- (WB)** WEATHERBOARD: Selected JSC Rusticated Weatherboard

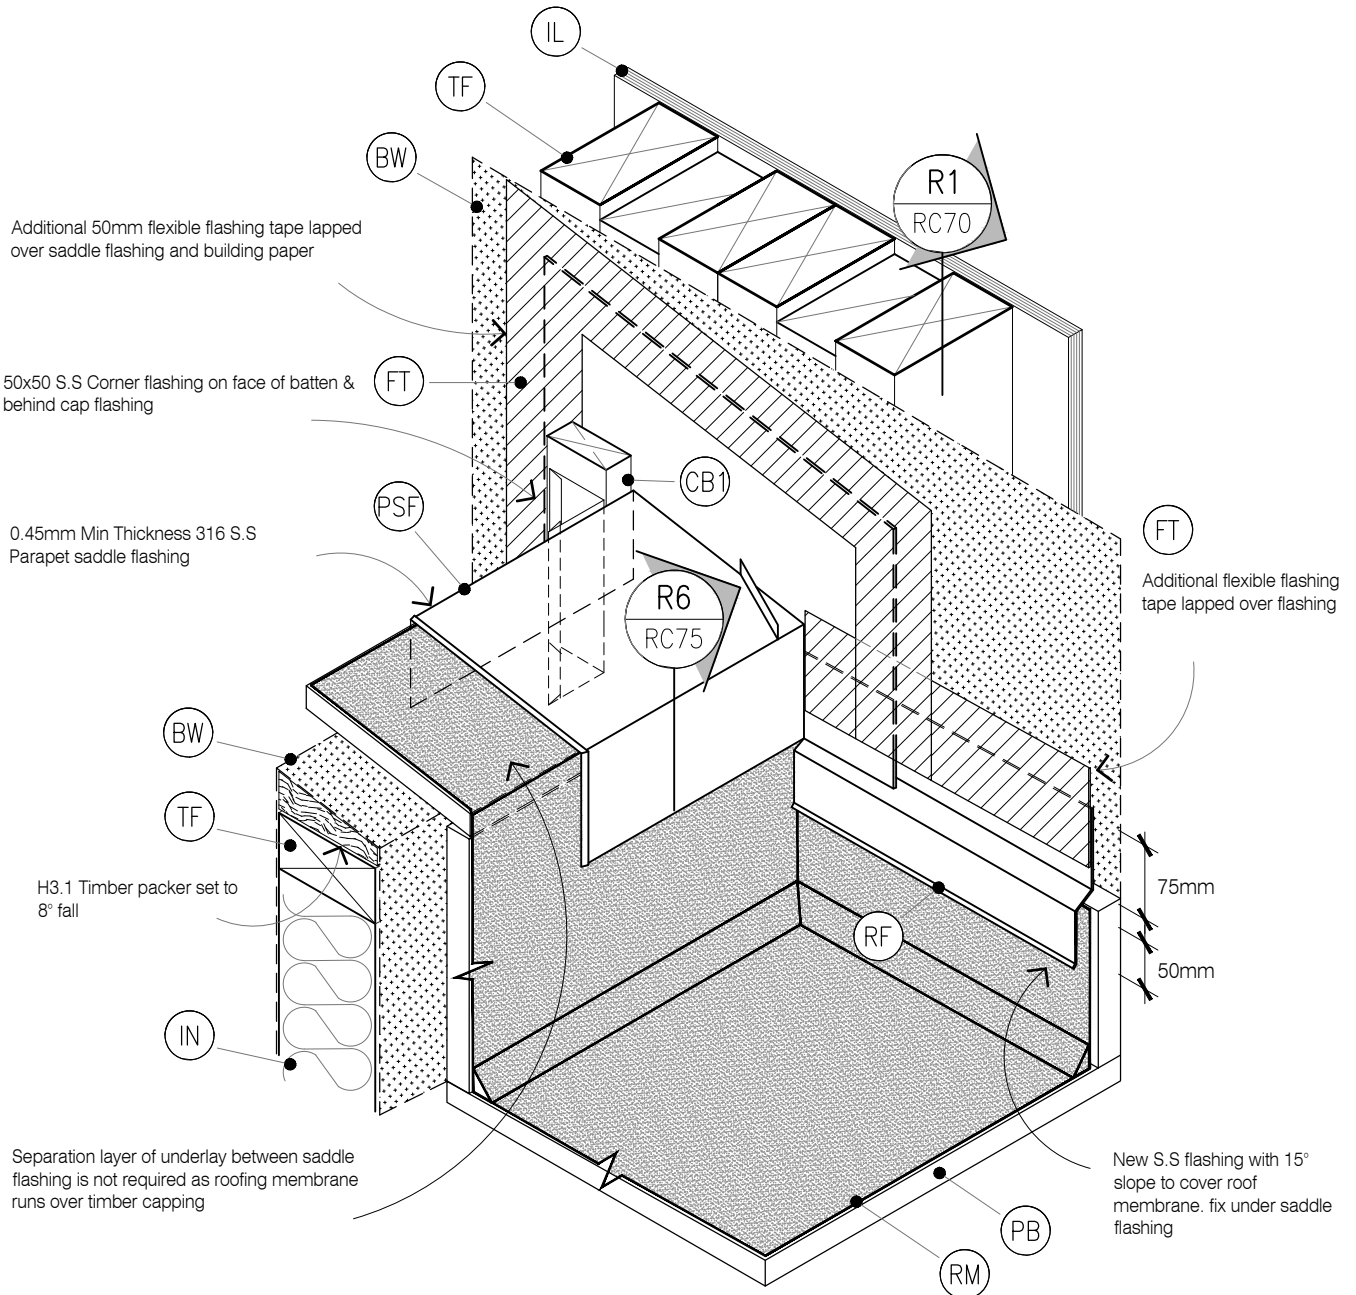


STAGE TWO

LEGEND :

- (BW)** BUILDING WRAP: Flexible Wall Underlay, As per NZBC E2/AS1 - Table 23, In extra high wind zones, Rigid Underlay required (9.1.7.2 E2/AS1)
- (CB1)** CAVITY BATTEN - NON STRUCTURAL : Horizontally installed JSC-U 45mm x 20mm Radiata Pine H3.2 treated, both face castellated and 18° bevelled edges.
- (CC)** CAVITY CLOSURE: Cavity closure strip, positioned to give a 15mm Min drip edge to cladding
- (CF)** CAP FLASHING: Continuous parapet flashing. Materials as per E2/AS1 4.3 + Figure 9 & Table 7

- (FT)** FLASHING TAPE: As per E2/AS1 4.3.11
- (IL)** INTERNAL LINING: Selected Internal Lining
- (IN)** INSULATION: Selected Insulation
- (PSF)** PARAPET SADDLE FLASHING: Materials as per E2/AS1 4.0, refer E2/AS1 Figure 11 & 12 . Typically 0.45mm Min 316 Stainless Steel. Refer Table 20 & Table 21 for Comparability of Materials in Contact

- (PB)** PLYWOOD BACKING: 17mm CCA treated H3.2 grade plywood substrate
- (RM)** ROOFING MEMBRANE: Selected System on 17mm CCA treated H3.2 grade plywood glued and screwed to Rafters. Roof Membrane requires 400mm solid block support each way & solid support to all sheet edges
- (TF)** TIMBER FRAME: H1.2 min treated timber framing
- (WB)** WEATHERBOARD: Selected JSC Rusticated Weatherboard



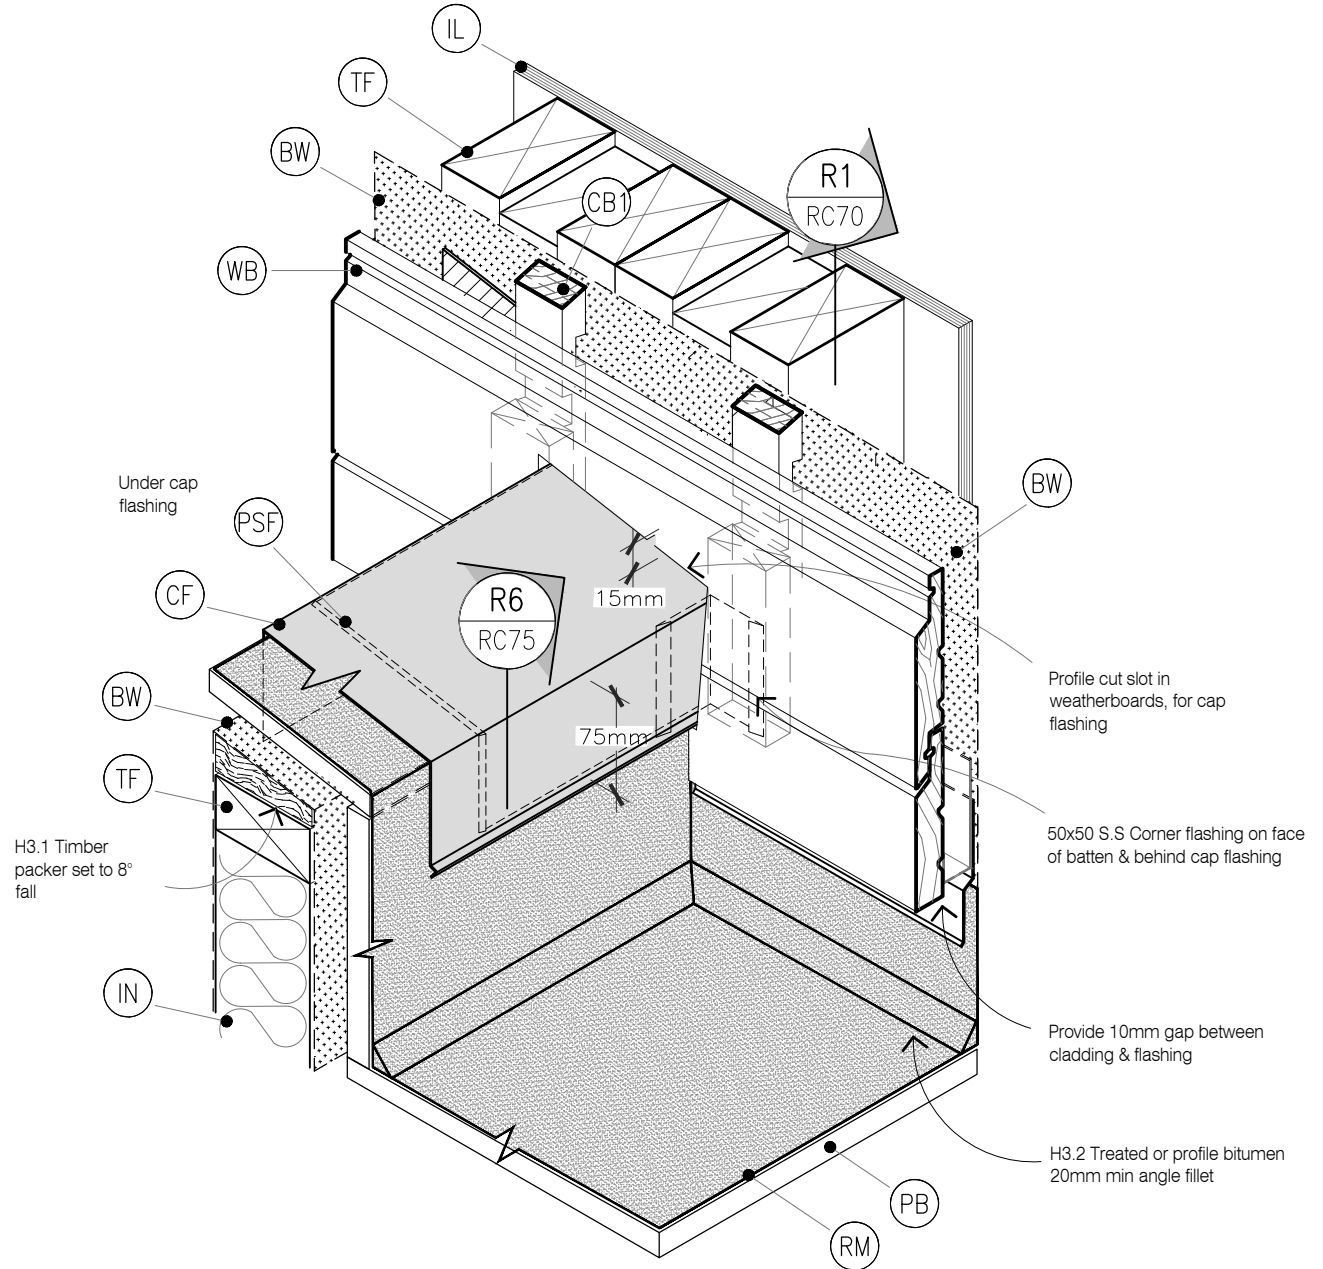


STAGE THREE



LEGEND :

- | | | |
|---|--|---|
| <p>(BW) BUILDING WRAP: Flexible Wall Underlay, As per NZBC E2/AS1 - Table 23, In extra high wind zones, Rigid Underlay required (9.1.7.2 E2/AS1)</p> <p>(CB) CAVITY BATTEN - NON STRUCTURAL : Horizontally installed JSC-U 45mm x 20mm Radiata Pine H3.2 treated, both face castellated and 18° bevelled edges.</p> <p>(CC) CAVITY CLOSURE: Cavity closure strip, positioned to give a 15mm Min drip edge to cladding</p> <p>(CF) CAP FLASHING: Continuous parapet flashing. Materials as per E2/AS1 4.3 + Figure 9 & Table 7</p> | <p>(FT) FLASHING TAPE: As per E2/AS1 4.3.11</p> <p>(IL) INTERNAL LINING: Selected Internal Lining</p> <p>(IN) INSULATION: Selected Insulation</p> <p>(PSF) PARAPET SADDLE FLASHING: Materials as per E2/AS1 4.0, refer E2/AS1 Figure 11 & 12 . Typically 0.45mm Min 316 Stainless Steel. Refer Table 20 & Table 21 for Comparability of Materials in Contact</p> | <p>(PB) PLYWOOD BACKING: 17mm CCA treated H3.2 grade plywood substrate</p> <p>(RM) ROOFING MEMBRANE: Selected System on 17mm CCA treated H3.2 grade plywood glued and screwed to Rafters. Roof Membrane requires 400mm solid block support each way & solid support to all sheet edges</p> <p>(TF) TIMBER FRAME: H1.2 min treated timber framing</p> <p>(WB) WEATHERBOARD: Selected JSC Rusticated Weatherboard</p> |
|---|--|---|

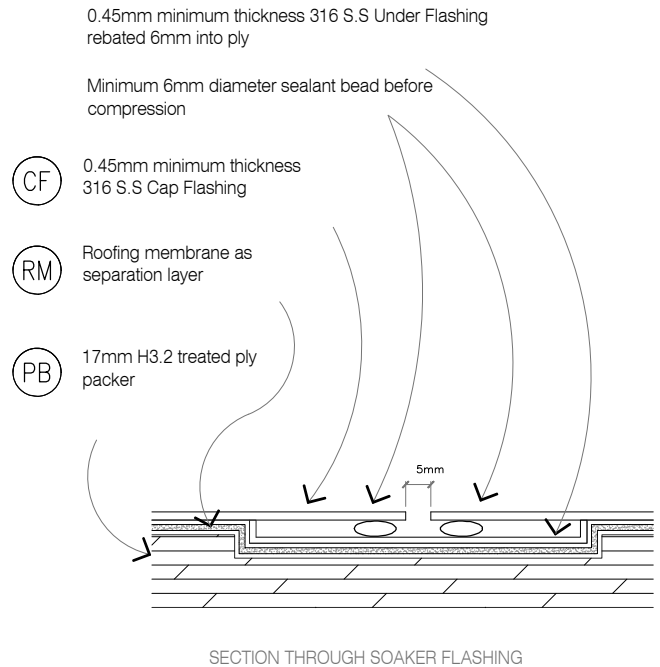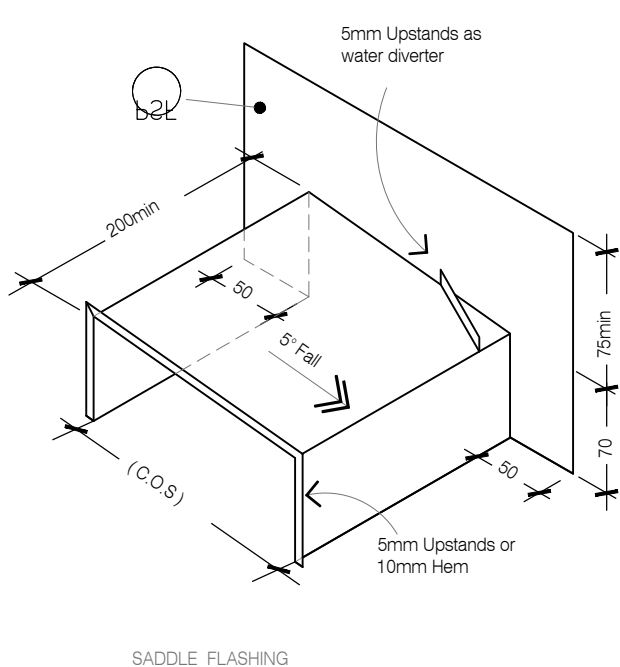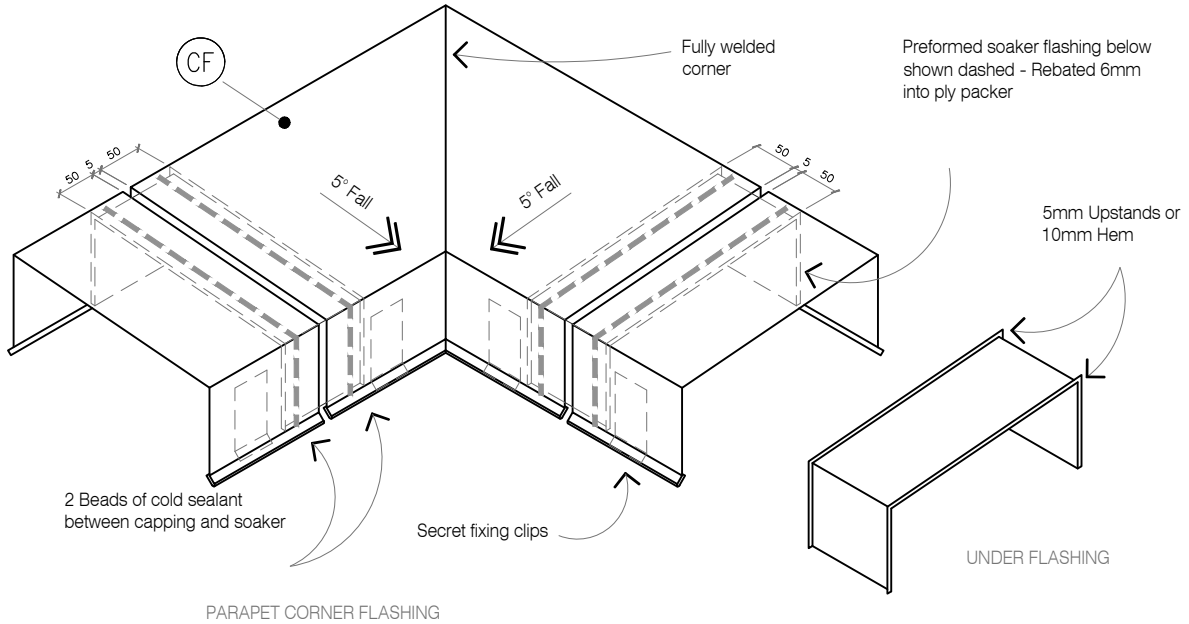


LEGEND :

- (BW)** BUILDING WRAP: Flexible Wall Underlay, As per NZBC E2/AS1 - Table 23, In extra high wind zones, Rigid Underlay required (9.1.7.2 E2/AS1)
- (CB1)** CAVITY BATTEN - NON STRUCTURAL : Horizontally installed JSC-U 45mm x 20mm Radiata Pine H3.2 treated, both face castellated and 18° bevelled edges.
- (CC)** CAVITY CLOSURE: Cavity closure strip, positioned to give a 15mm Min drip edge to cladding
- (CF)** CAP FLASHING: Continuous parapet flashing. Materials as per E2/AS1 4.3 + Figure 9 & Table 7


- (FT)** FLASHING TAPE: As per E2/AS1 4.3.11
- (IL)** INTERNAL LINING: Selected Internal Lining
- (IN)** INSULATION: Selected Insulation
- (PSF)** PARAPET SADDLE FLASHING: Materials as per E2/AS1 4.0, refer E2/AS1 Figure 11 & 12 . Typically 0.45mm Min 316 Stainless Steel. Refer Table 20 & Table 21 for Comparability of Materials in Contact

- (PB)** PLYWOOD BACKING: 17mm CCA treated H3.2 grade plywood substrate
- (RM)** ROOFING MEMBRANE: Selected System on 17mm CCA treated H3.2 grade plywood glued and screwed to Rafters. Roof Membrane requires 400mm solid block support each way & solid support to all sheet edges
- (TF)** TIMBER FRAME: H1.2 min treated timber framing
- (WB)** WEATHERBOARD: Selected JSC Rusticated Weatherboard

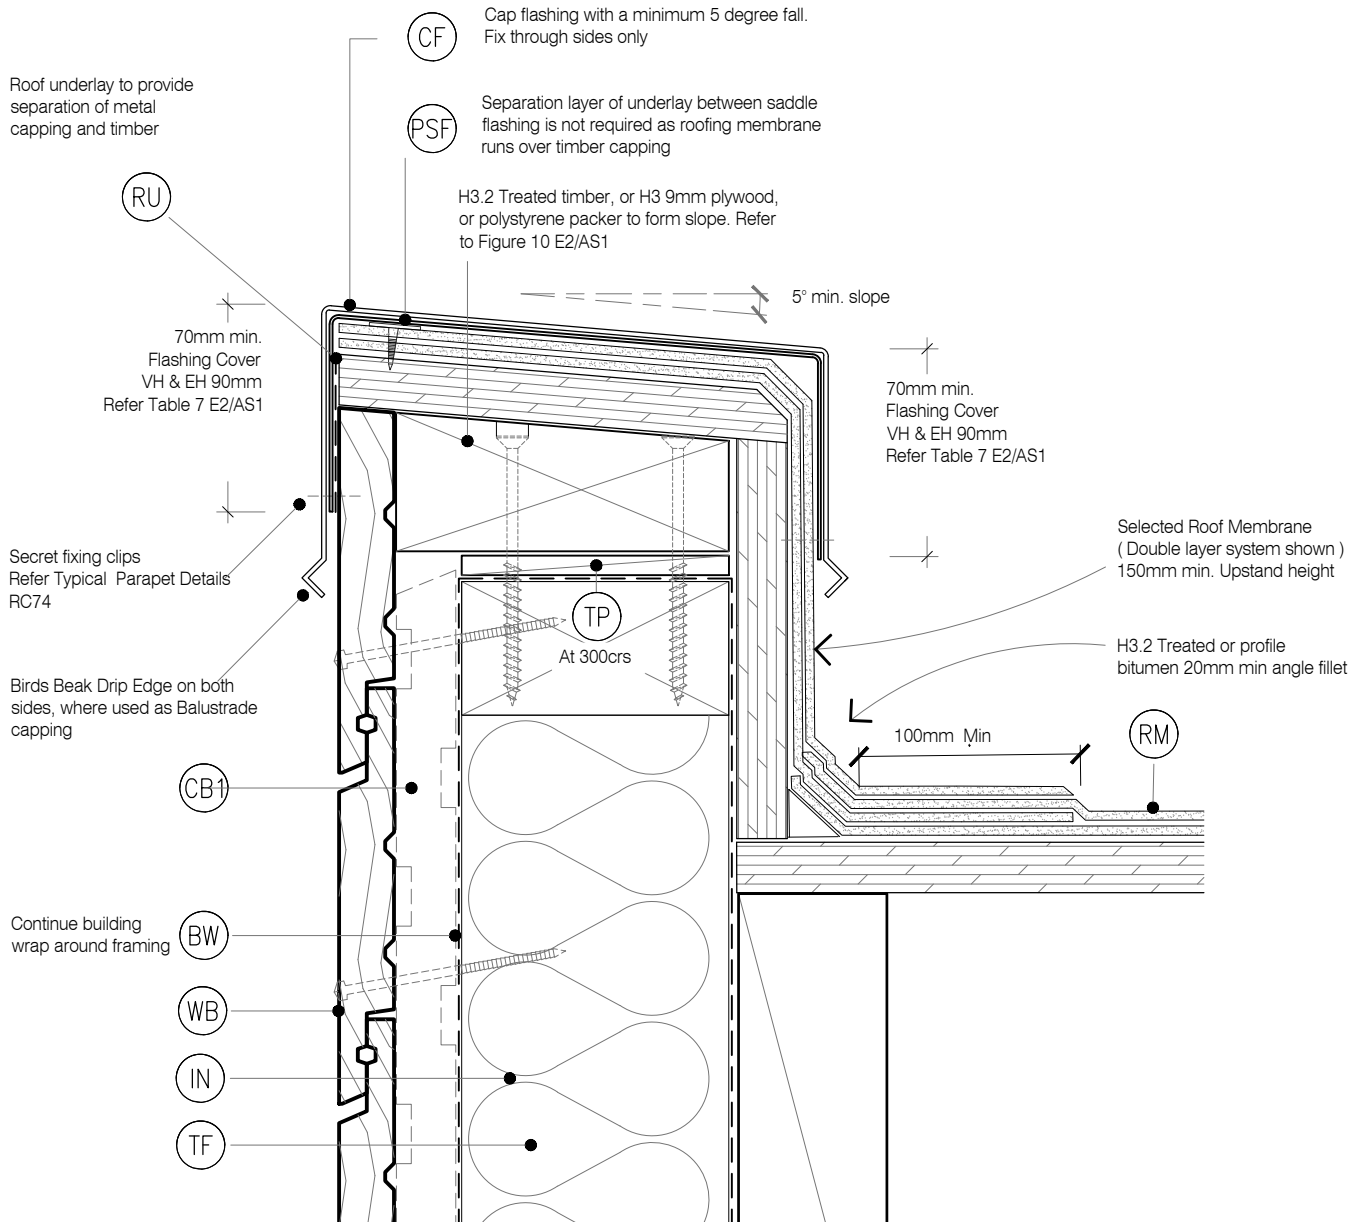

LEGEND :

- | | | |
|---|---|---|
| <p>(AF) APRON FLASHING: Materials as per E2/AS1 4.0, Coating to match roofing material or refer E2/AS1 Table 21. Flashing Cover 130mm min. (L, M & H ≥ 10°) All others 200mm Refer Table 7 E2/AS1</p> <p>(BW) BUILDING WRAP: Flexible Wall Underlay, As per NZBC E2/AS1 - Table 23, In extra high wind zones, Rigid Underlay required (9.1.7.2 E2/AS1)</p> <p>(CB1) CAVITY BATTEN - NON STRUCTURAL : Vertically installed JSC-U 45mm x 20mm Radiata Pine H3.2 treated, both face castellated and 18° bevelled edges.</p> | <p>(CC) CAVITY CLOSURE: Cavity closure strip, positioned to give a 15mm Min drip edge to cladding</p> <p>(IL) INTERNAL LINING: Selected Internal Lining</p> <p>(IN) INSULATION: Selected Insulation</p> <p>(HS) HEAD SOFFIT SCRIBER: JSC 27 mm x 40 mm Fix with 75 x 3.15mm 316 S.S nail in 2.5mm predrilled hole</p> <p>(MR) METAL ROOFING : Selected Metal Roofing</p> | <p>(SL) SOFFIT LINING: JSC Soffit Lining</p> <p>(TF) TIMBER FRAME: H1.2 min treated timber framing</p> <p>(TP) TIMBER PACKER: H3.2 Treated at 300crs to allow ventilation over the top of the wall.</p> <p>(RU) ROOFING UNDERLAY: Selected Roofing Underlay As Per AS/AZS4200 with Mesh or Self Supported</p> <p>(WB) WEATHERBOARD: Selected JSC Rusticated Weatherboard</p> |
|---|---|---|

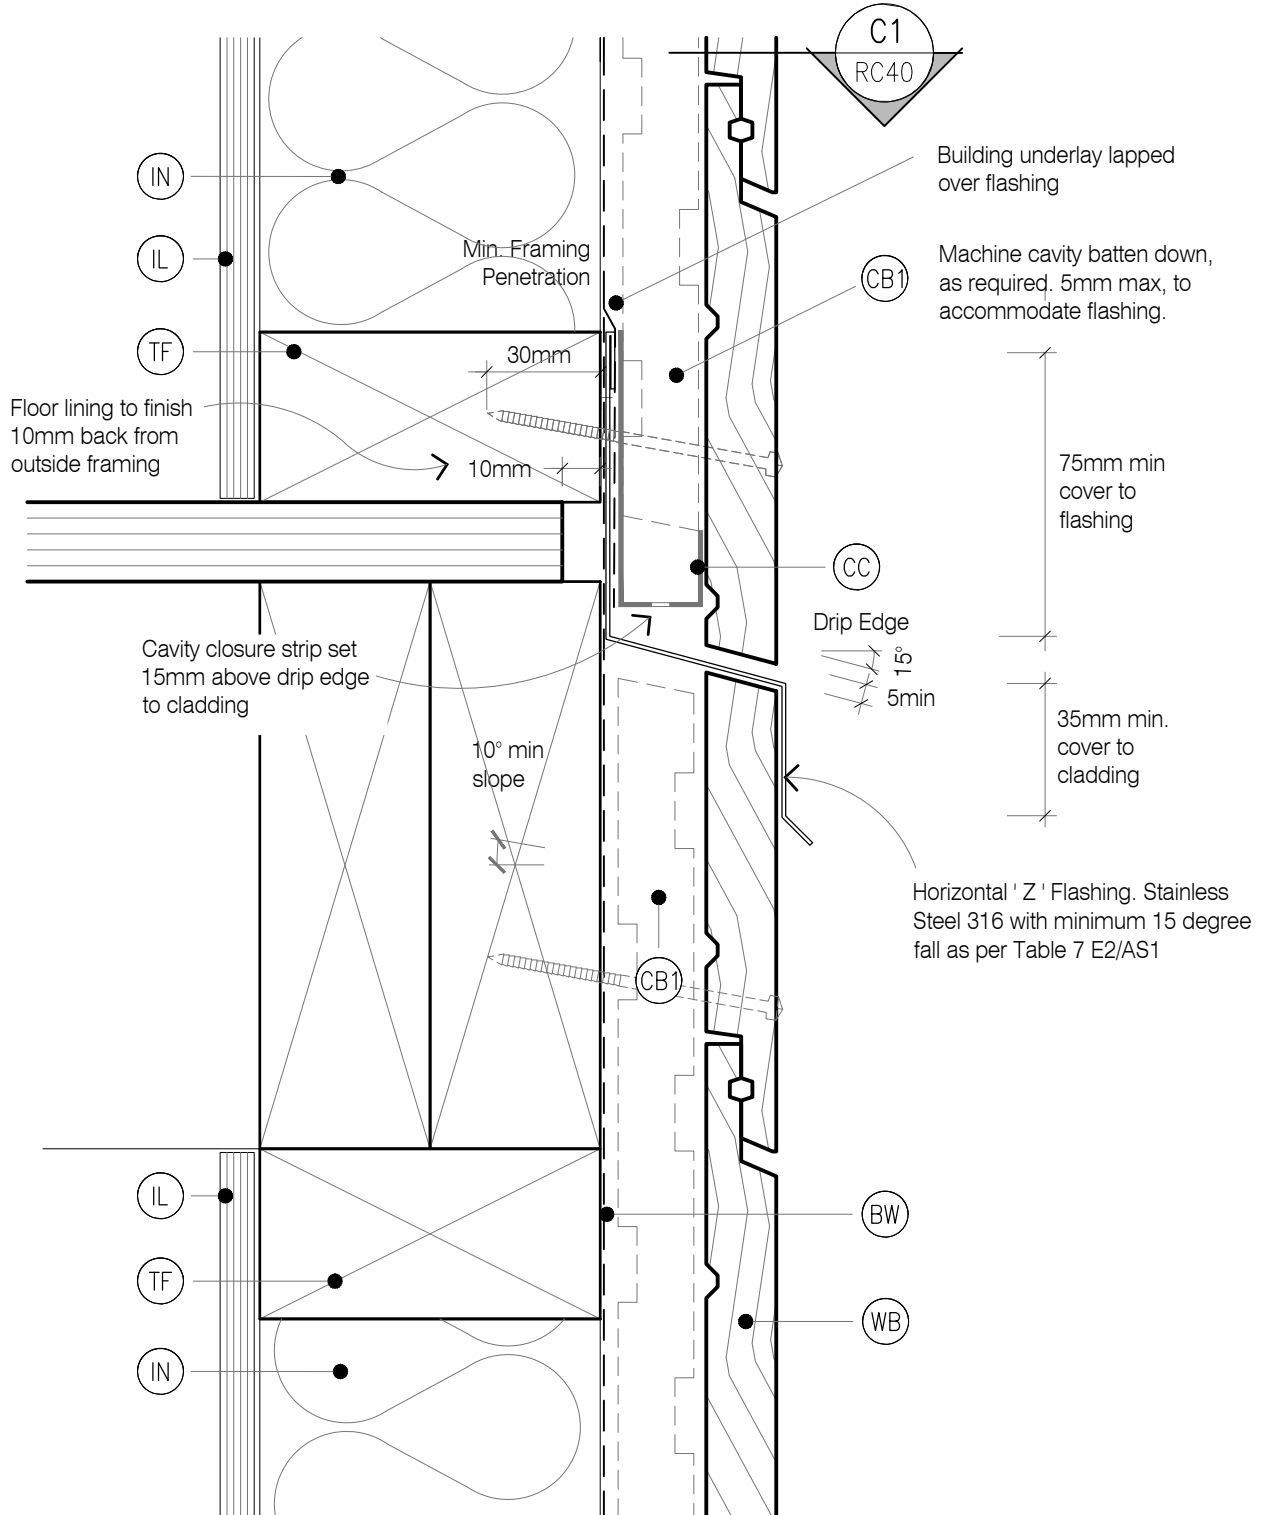


LEGEND :

- (AF) APRON FLASHING: Materials as per E2/AS1 4.0, Coating to match roofing material or refer E2/AS1 Table 21. Flashing Cover 130mm min. (L,M & H \geq 10°) All others 200mm Refer Table 7 E2/AS1
- (BW) BUILDING WRAP: Flexible Wall Underlay, As per NZBC E2/AS1 - Table 23, In extra high wind zones, Rigid Underlay required (9.1.7.2 E2/AS1)
- (CB1) CAVITY BATTEN - NON STRUCTURAL : Vertically installed JSC-U 45mm x 20mm Radiata Pine H3.2 treated, both face castellated and 18° bevelled edges.

- (CC) CAVITY CLOSURE: Cavity closure strip, positioned to give a 15mm Min drip edge to cladding
- (IL) INTERNAL LINING: Selected Internal Lining
- (IN) INSULATION: Selected Insulation
- (HS) HEAD SOFFIT SCRIBER: JSC 27 mm x 40 mm Fix with 75 x 3.15mm 316 S.S nail in 2.5mm predrilled hole
- (MR) METAL ROOFING : Selected Metal Roofing

- (SL) SOFFIT LINING: JSC Soffit Lining
- (TF) TIMBER FRAME: H1.2 min treated timber framing
- (TP) TIMBER PACKER: H3.2 Treated at 300crs to allow ventilation over the top of the wall.
- (RU) ROOFING UNDERLAY: Selected Roofing Underlay As Per AS/AZS4200 with Mesh or Self Supported
- (WB) WEATHERBOARD: Selected JSC Rusticated Weatherboard

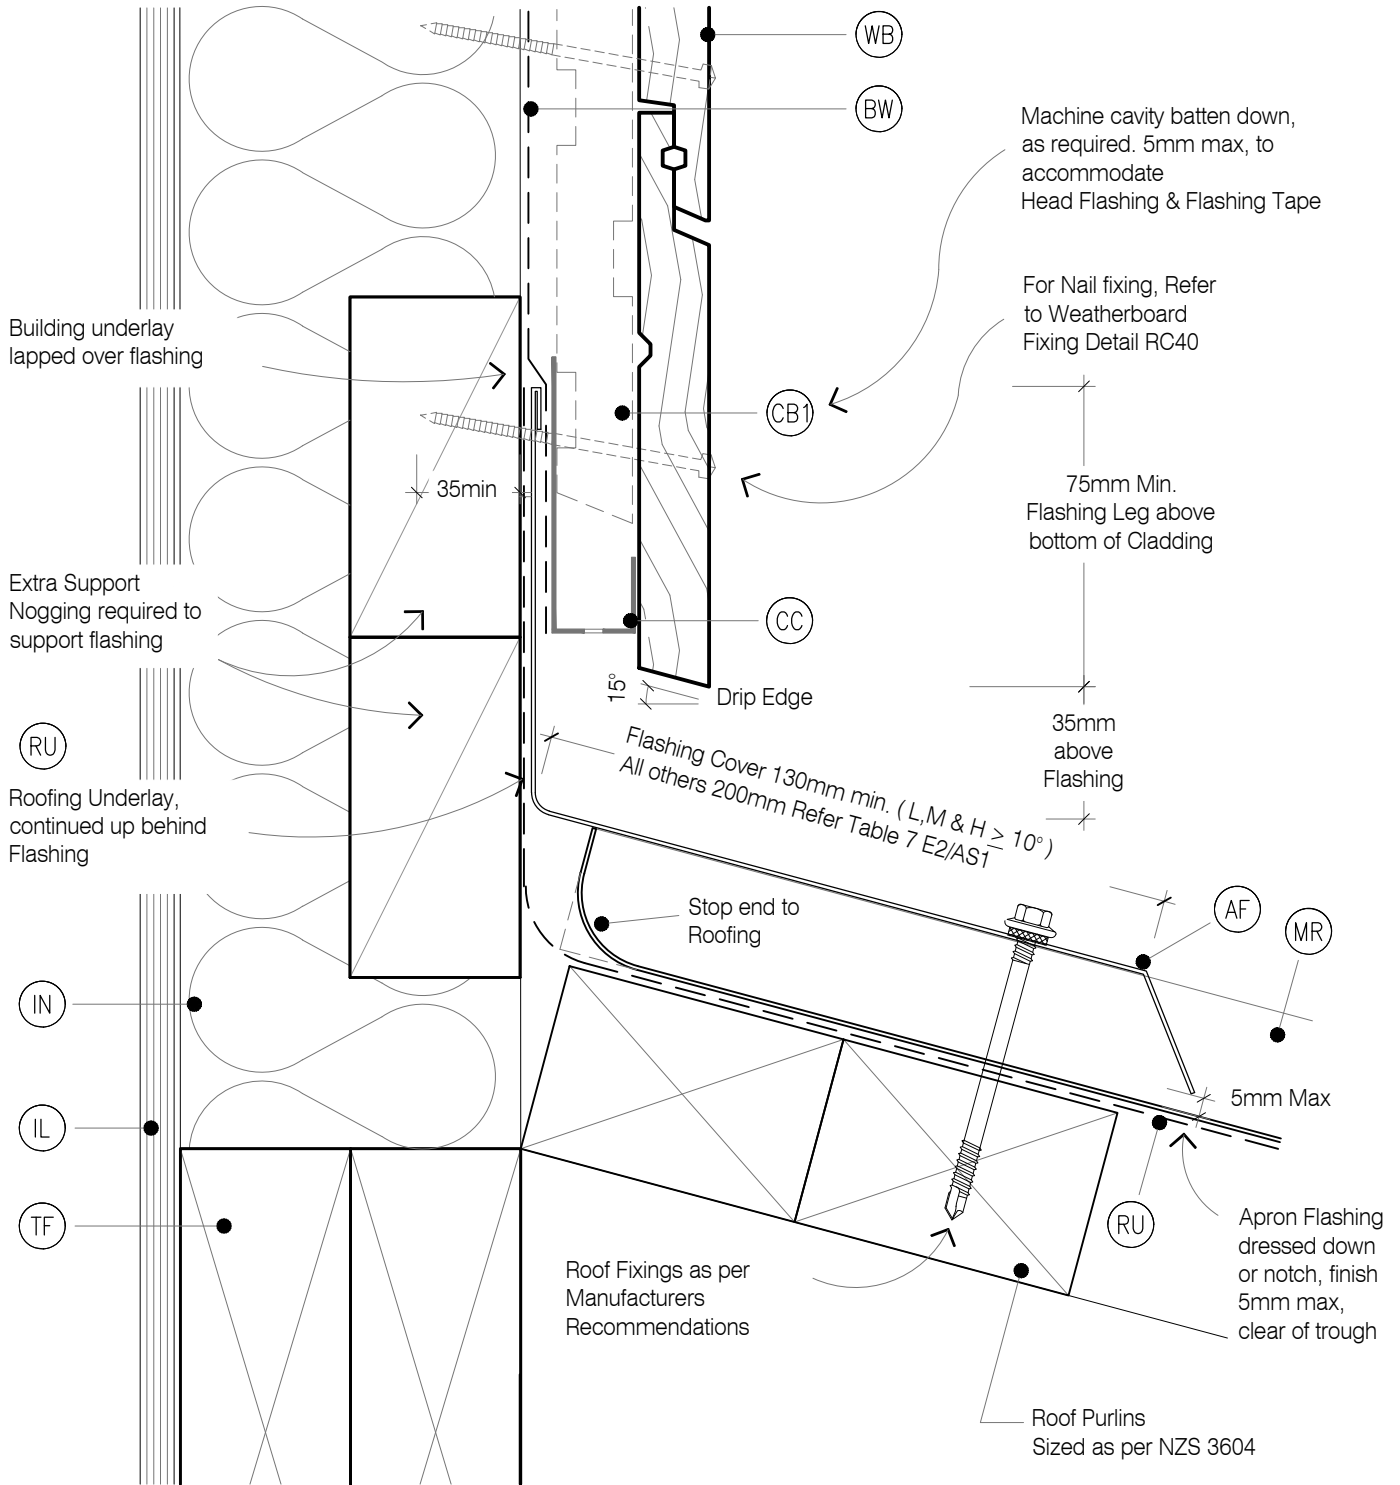


LEGEND :

- (AF) APRON FLASHING: Materials as per E2/AS1 4.0, Coating to match roofing material or refer E2/AS1 Table 21. Flashing Cover 130mm min. (L, M & H ≥ 10°) All others 200mm Refer Table 7 E2/AS1
- (BW) BUILDING WRAP: Flexible Wall Underlay, As per NZBC E2/AS1 - Table 23, In extra high wind zones, Rigid Underlay required (9.1.7.2 E2/AS1)
- (CB1) CAVITY BATTEN - NON STRUCTURAL : Vertically installed JSC-U 45mm x 20mm Radiata Pine H3.2 treated, both face castellated and 18° bevelled edges.

- (CC) CAVITY CLOSURE: Cavity closure strip, positioned to give a 15mm Min drip edge to cladding
- (IL) INTERNAL LINING: Selected Internal Lining
- (IN) INSULATION: Selected Insulation
- (HS) HEAD SOFFIT SCRIBER: JSC 27 mm x 40 mm Fix with 75 x 3.15mm 316 S.S nail in 2.5mm predrilled hole
- (MR) METAL ROOFING : Selected Metal Roofing

- (SL) SOFFIT LINING: JSC Soffit Lining
- (TF) TIMBER FRAME: H1.2 min treated timber framing
- (TP) TIMBER PACKER: H3.2 Treated at 300crs to allow ventilation over the top of the wall.
- (RU) ROOFING UNDERLAY: Selected Roofing Underlay As Per AS/AZS4200 with Mesh or Self Supported
- (WB) WEATHERBOARD: Selected JSC Rusticated Weatherboard

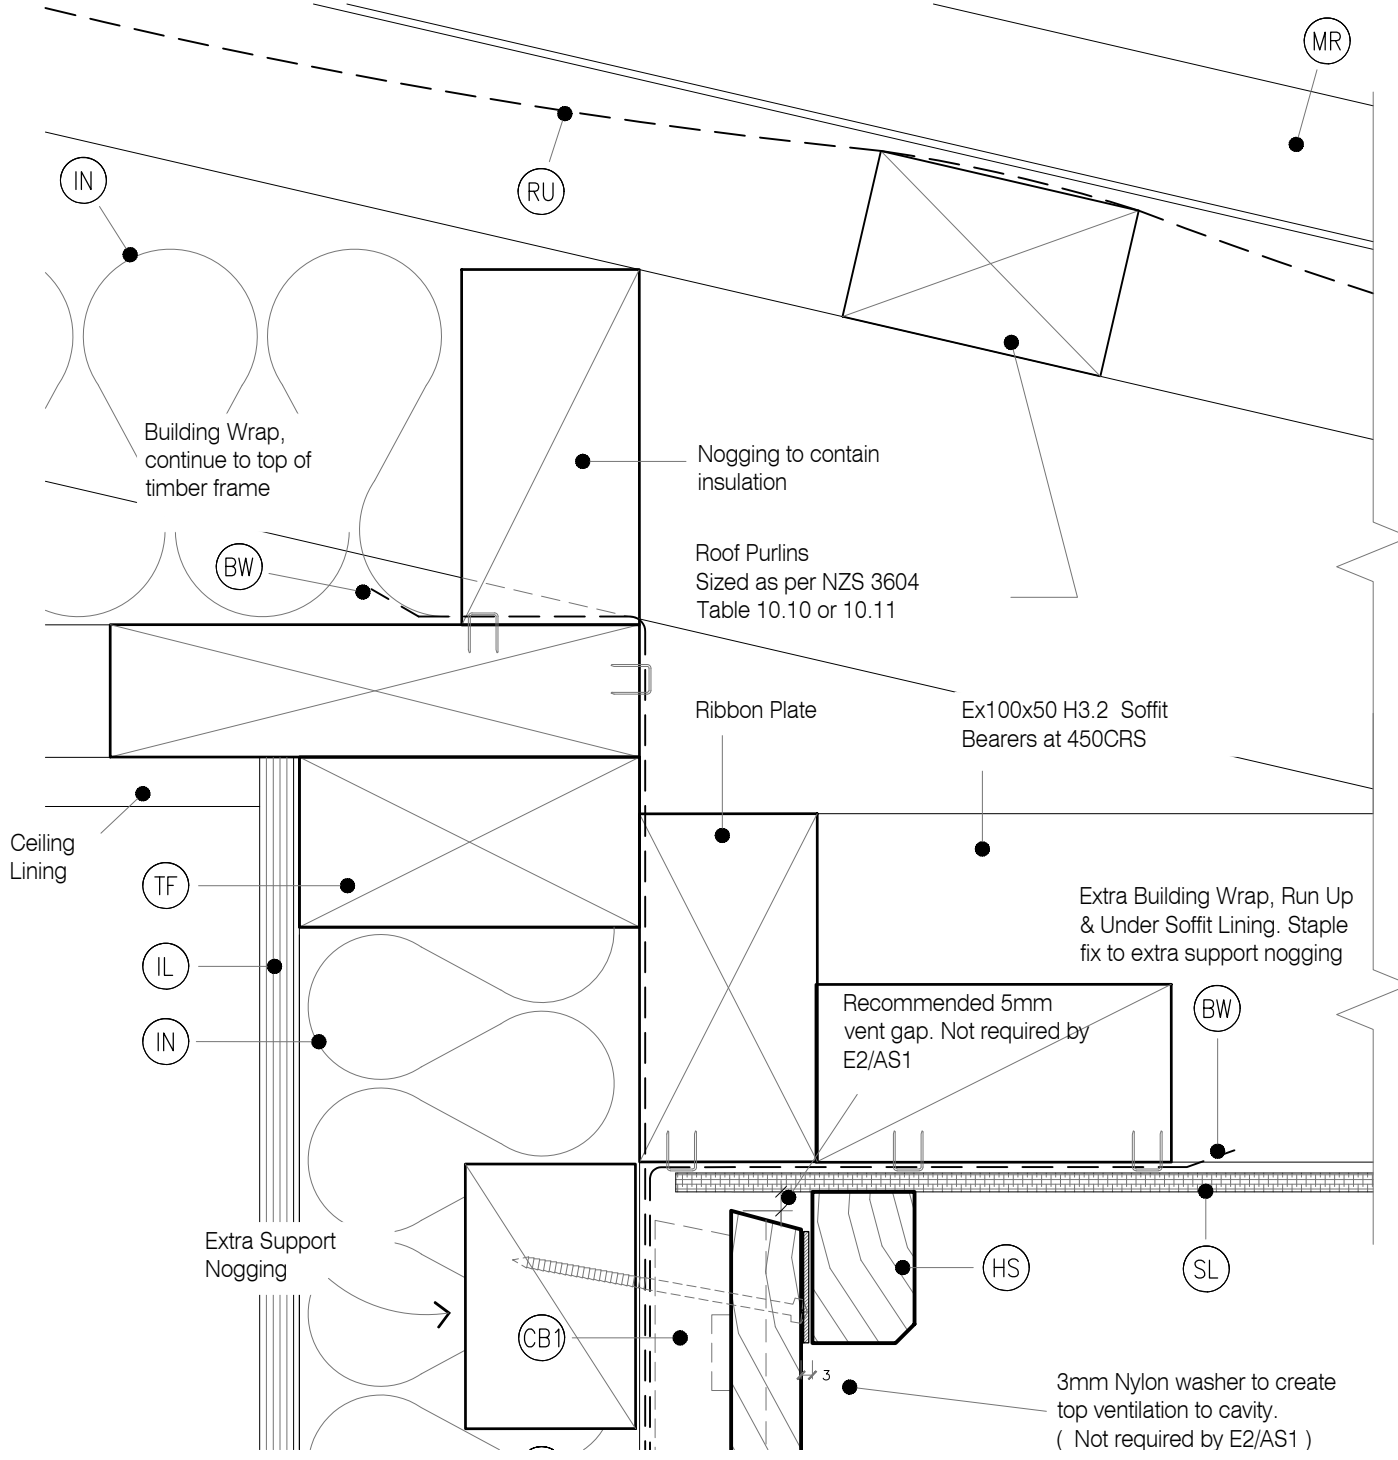


LEGEND :

- (AF) APRON FLASHING: Materials as per E2/AS1 4.0, Coating to match roofing material or refer E2/AS1 Table 21. Flashing Cover 130mm min. (L, M & H ≥ 10°) All others 200mm Refer Table 7 E2/AS1
- (BW) BUILDING WRAP: Flexible Wall Underlay, As per NZBC E2/AS1 - Table 23, In extra high wind zones, Rigid Underlay required (9.1.7.2 E2/AS1)
- (CB) CAVITY BATTEN - NON STRUCTURAL : Vertically installed JSC-U 45mm x 20mm Radiata Pine H3.2 treated, both face castellated and 18° bevelled edges.

- (CC) CAVITY CLOSURE: Cavity closure strip, positioned to give a 15mm Min drip edge to cladding
- (IL) INTERNAL LINING: Selected Internal Lining
- (IN) INSULATION: Selected Insulation
- (HS) HEAD SOFFIT SCRIBER: JSC 27 mm x 40 mm Fix with 75 x 3.15mm 316 S.S nail in 2.5mm predrilled hole
- (MR) METAL ROOFING : Selected Metal Roofing

- (SL) SOFFIT LINING: JSC Soffit Lining
- (TF) TIMBER FRAME: H1.2 min treated timber framing
- (TP) TIMBER PACKER: H3.2 Treated at 300crs to allow ventilation over the top of the wall.
- (RU) ROOFING UNDERLAY: Selected Roofing Underlay As Per AS/AZS4200 with Mesh or Self Supported
- (WB) WEATHERBOARD: Selected JSC Rusticated Weatherboard

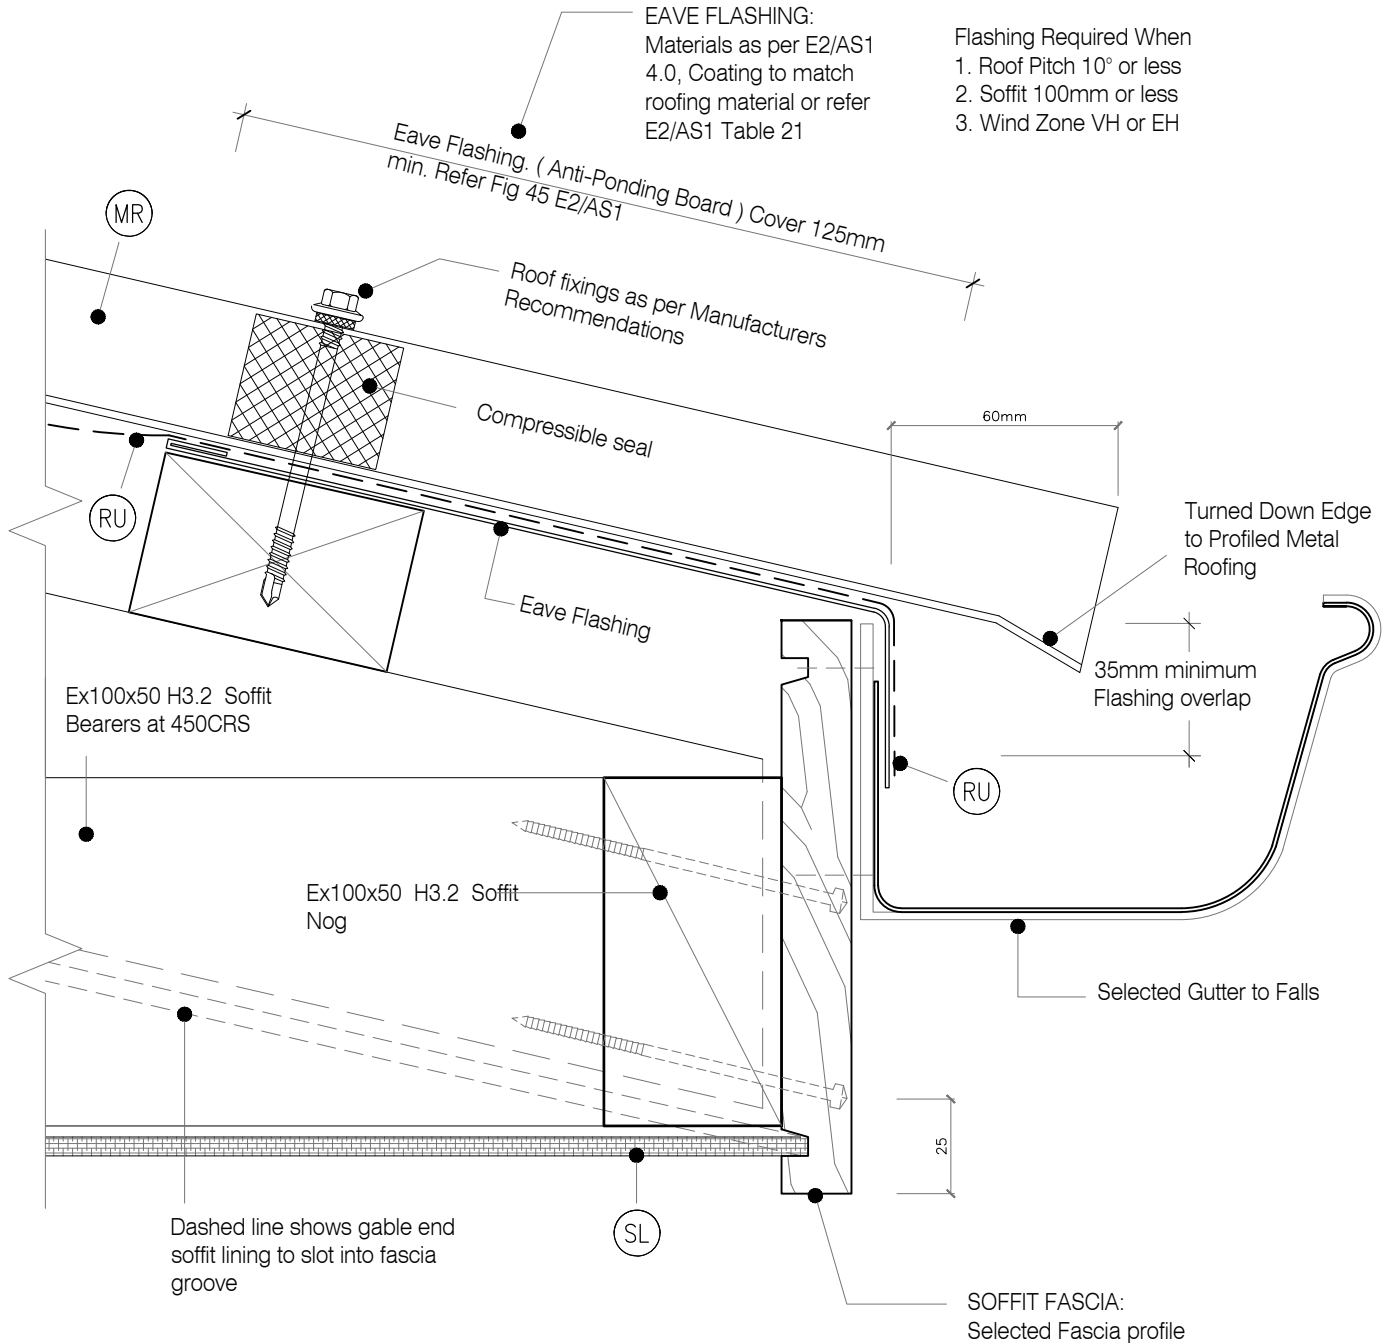

LEGEND :

- (AF) APRON FLASHING: Materials as per E2/AS1 4.0, Coating to match roofing material or refer E2/AS1 Table 21. Flashing Cover 130mm min. (L,M & H \geq 10°) All others 200mm Refer Table 7 E2/AS1
- (BW) BUILDING WRAP: Flexible Wall Underlay, As per NZBC E2/AS1 - Table 23, In extra high wind zones, Rigid Underlay required (9.1.7.2 E2/AS1)
- (CB1) CAVITY BATTEN - NON STRUCTURAL : Vertically installed JSC-U 45mm x 20mm Radiata Pine H3.2 treated, both face castellated and 18° bevelled edges.

- (CC) CAVITY CLOSURE: Cavity closure strip, positioned to give a 15mm Min drip edge to cladding
- (IL) INTERNAL LINING: Selected Internal Lining
- (IN) INSULATION: Selected Insulation
- (HS) HEAD SOFFIT SCRIBER: JSC 27 mm x 40 mm Fix with 75 x 3.15mm 316 S.S nail in 2.5mm predrilled hole
- (MR) METAL ROOFING : Selected Metal Roofing

- (SL) SOFFIT LINING: JSC Soffit Lining
- (TF) TIMBER FRAME: H1.2 min treated timber framing
- (TP) TIMBER PACKER: H3.2 Treated at 300crs to allow ventilation over the top of the wall.
- (RU) ROOFING UNDERLAY: Selected Roofing Underlay As Per AS/AZS4200 with Mesh or Self Supported
- (WB) WEATHERBOARD: Selected JSC Rusticated Weatherboard

